

Report No.:

Test Time: 2024-10-13 17:38

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: 内调75 15D

Luminous Width (mm): -70

Current: 0.142 A

Power Factor: 0.978

Luminous Length (mm): -70

Voltage: 233.7 V

Power: 32.70 W

Photometric Results

CIE Class: Direct

Measurement Flux: 3500.6 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H32.1

Vertical Diffuse Angle(50%): V32.1

Luminaire Efficacy Rating (LER): 107.10

Max. Intensity: 8854.92 cd

S/MH(C0/C180): 0.54

Total Rated Lamp Lumens: 3500.6 lm

Efficiency: 100%

Upward Ratio: 0%

Central Intensity: 8821.25 cd


Pos of Max. Intensity: H0 V2

S/MH(C90/C270): 0.54

Picture Of Luminaire



Luminous Intensity Distribution Curve

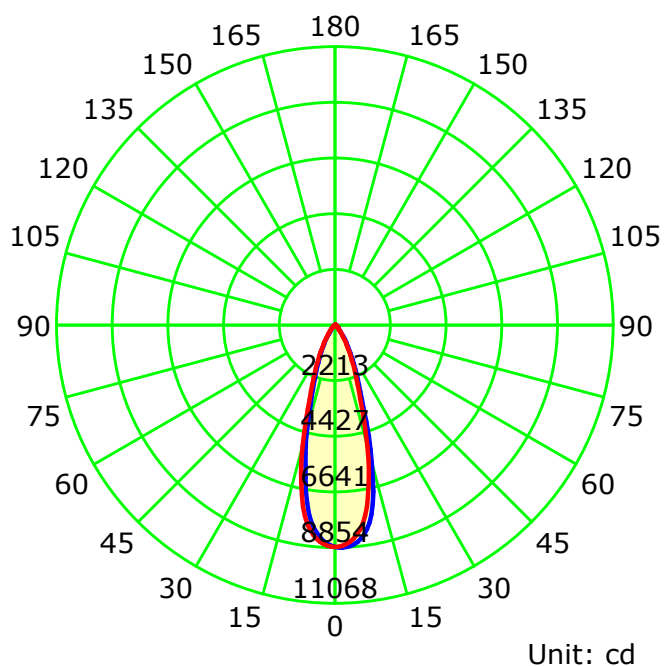

— C0-C180 — C90-C270

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0



Test Device: CHL-6E

Distance: 3.328 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

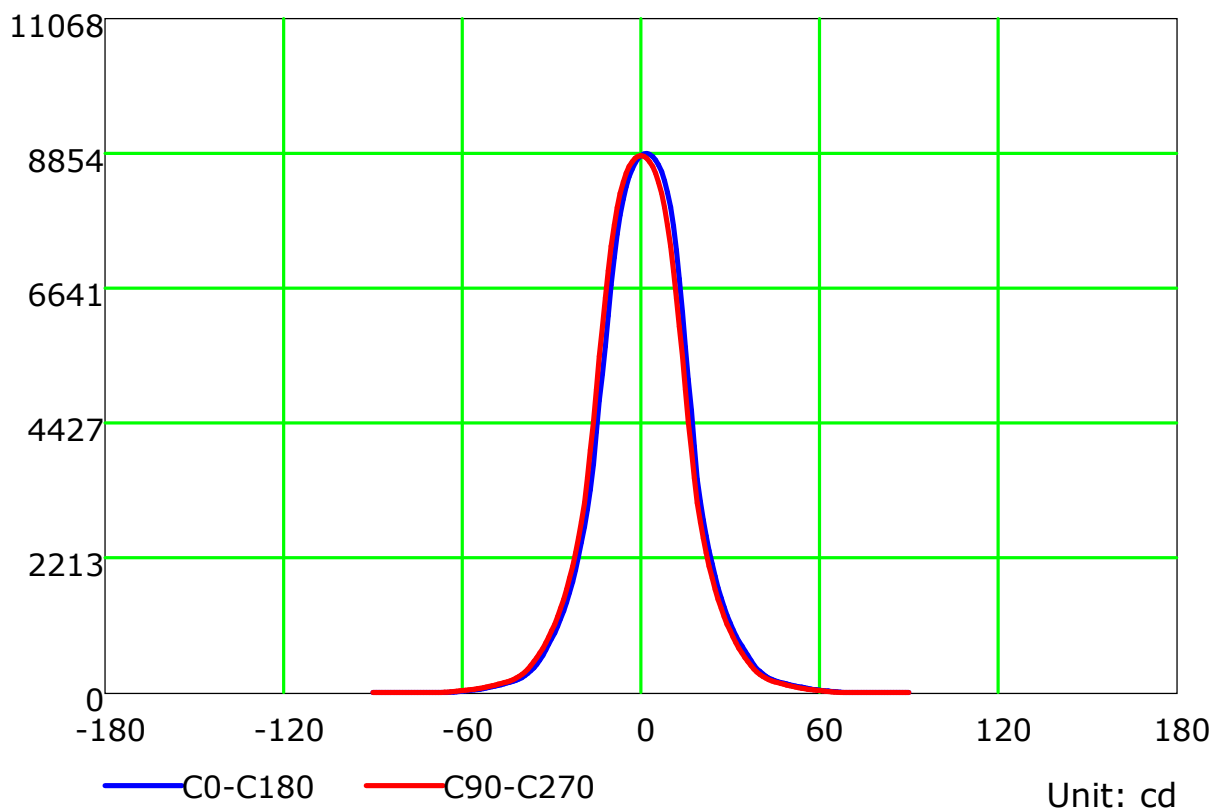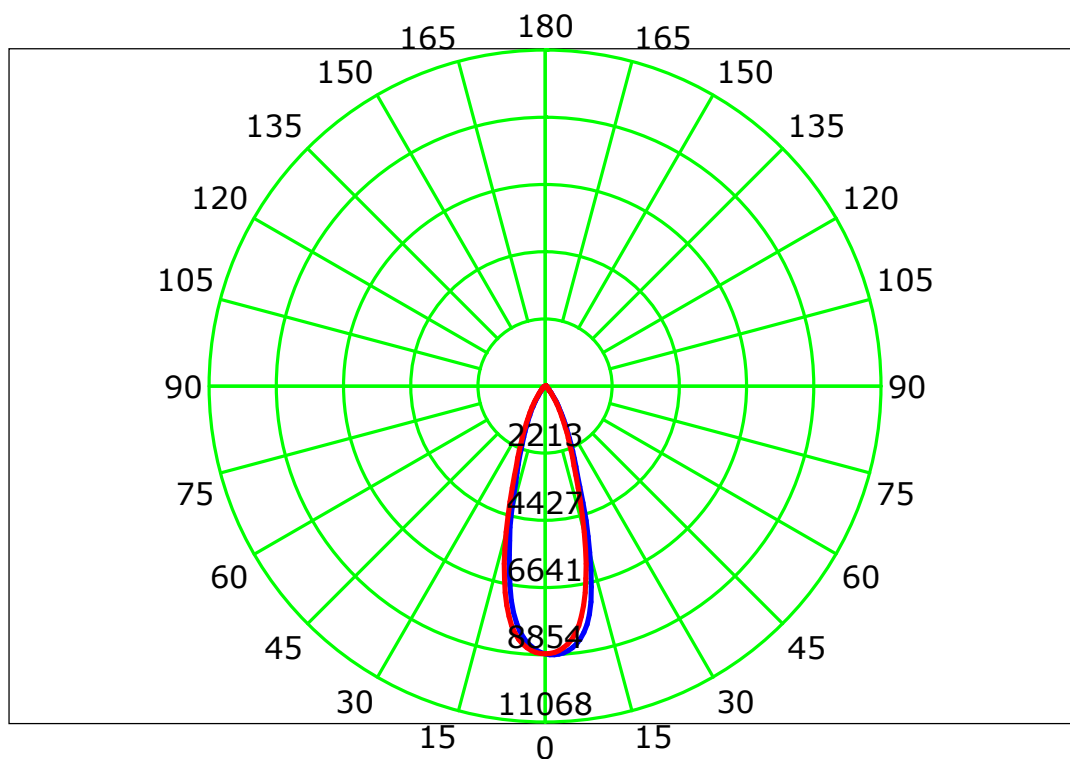

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

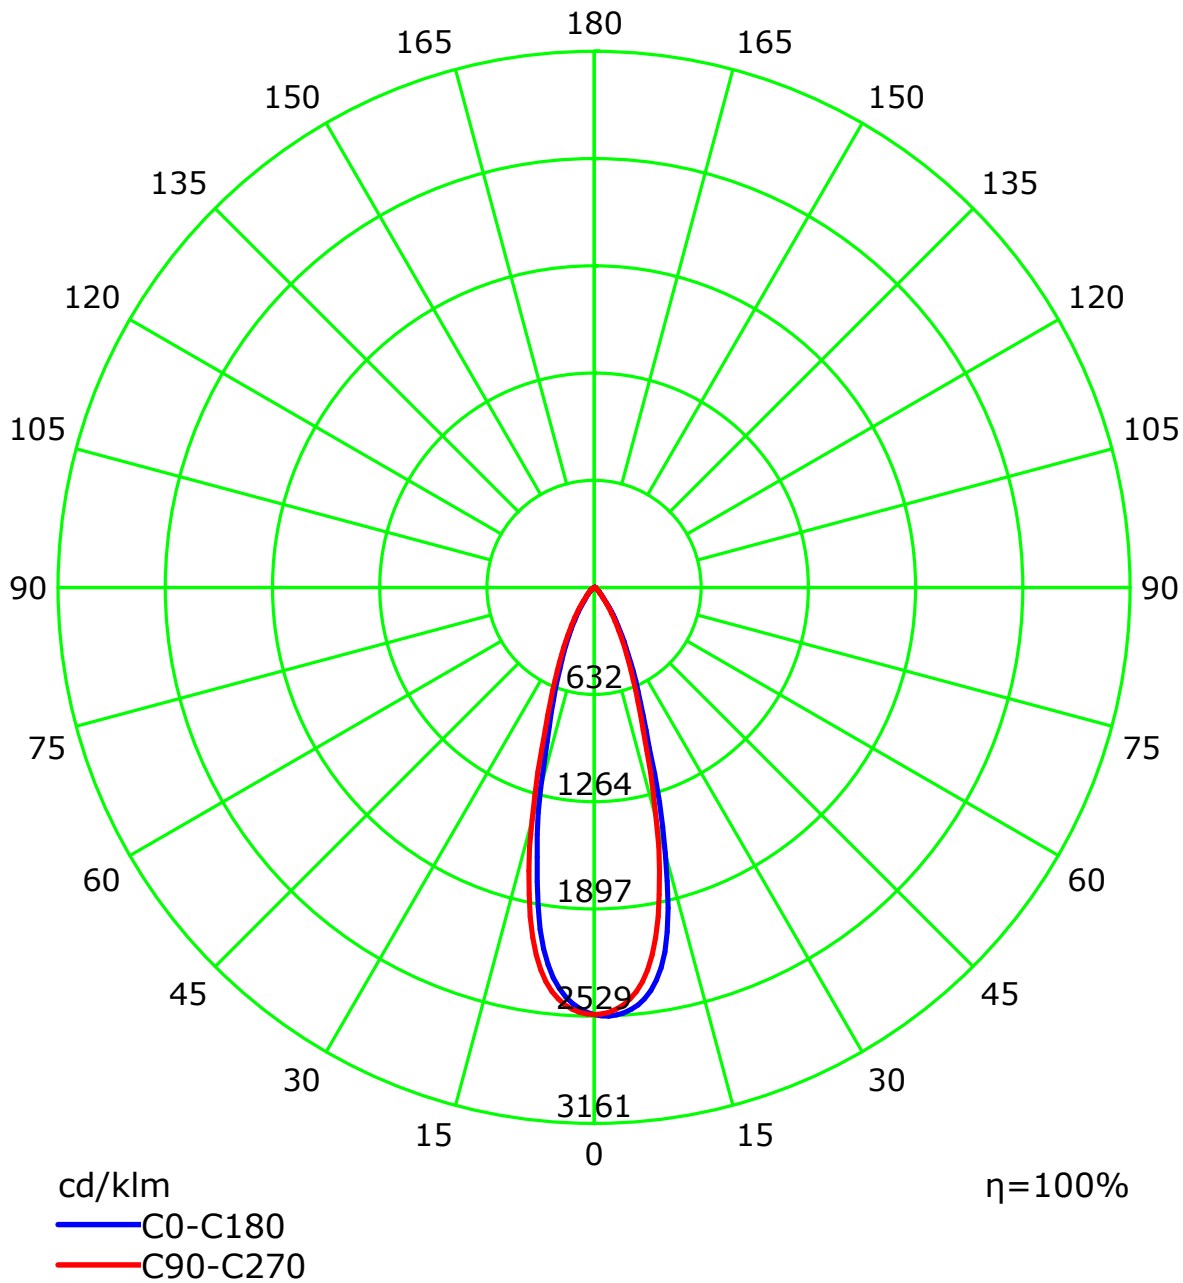

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

Isocandela (rectangle)

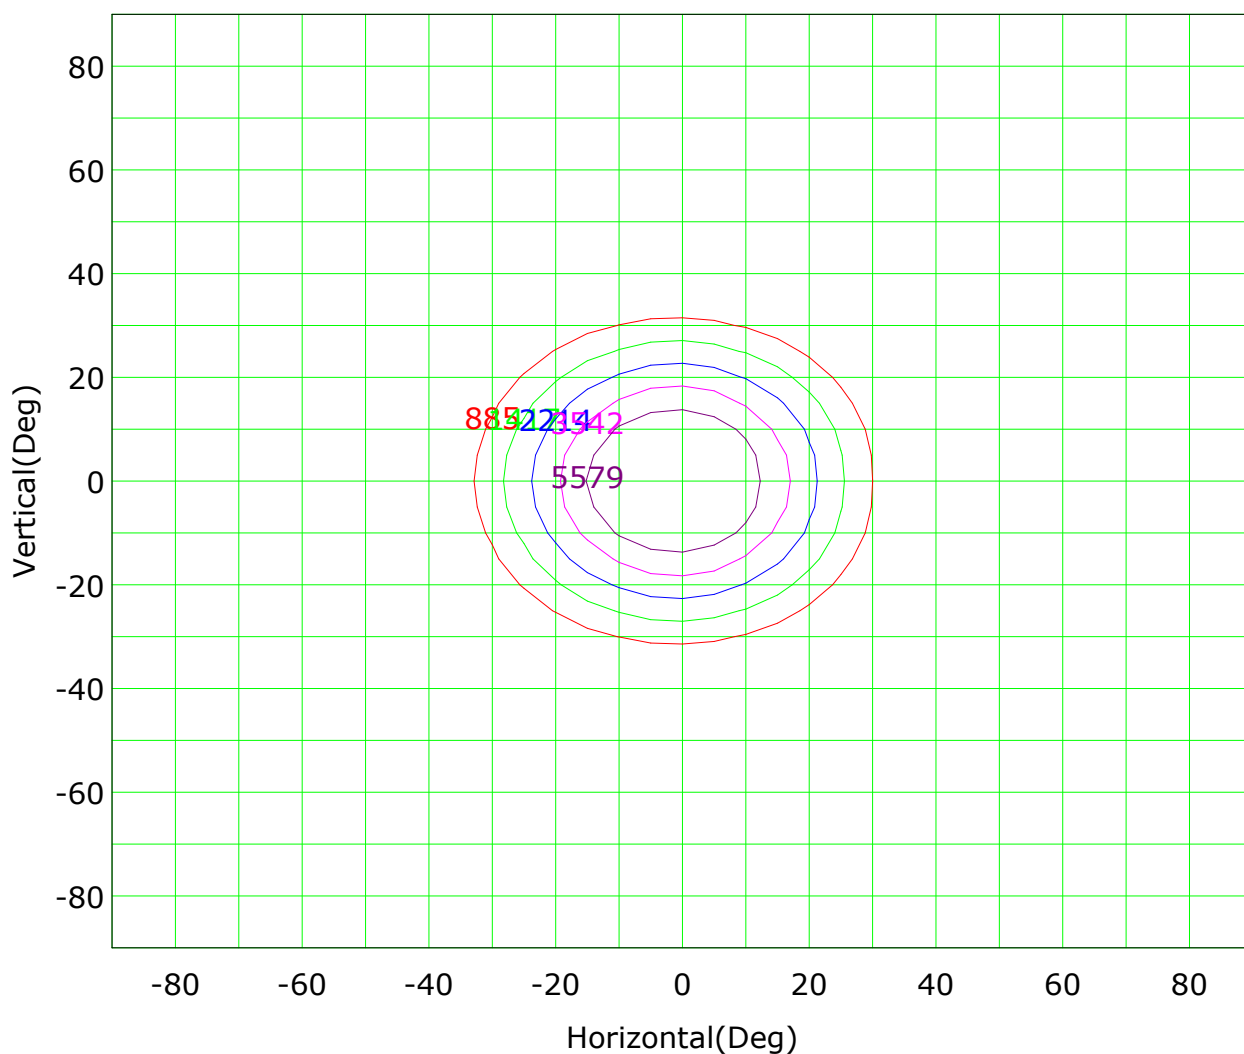

Imax (100%): 8855 cd

| | |
|-----------------|-----------------|
| (10%): 885 cd | (16%): 1417 cd |
| (25%): 2214 cd | (40%): 3542 cd |
| (63%): 5579 cd | (100%): 8855 cd |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.328 m

Humidity:

Inspector:

IsoLux Plot

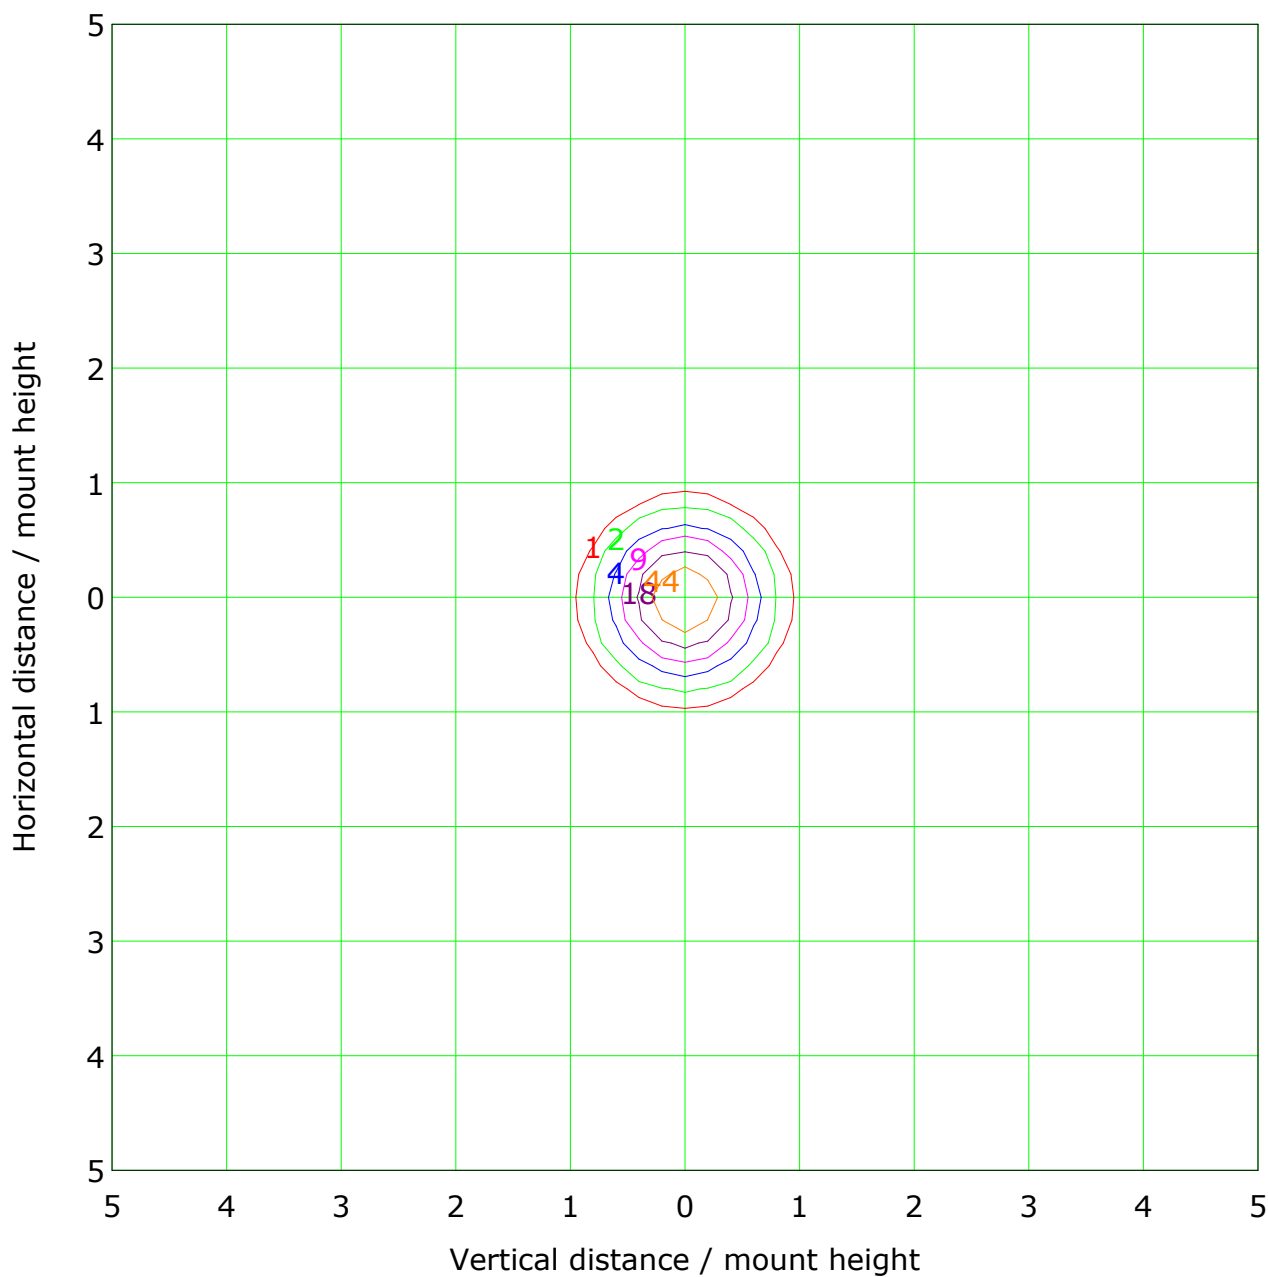

Mounting Height: 10.0m Max Lux(100%): 88.4 lx

| | |
|-----------------|-----------------|
| (1%): 0.9 lx | (2%): 1.8 lx |
| (5%): 4.4 lx | (10%): 8.8 lx |
| (20%): 17.7 lx | (50%): 44.2 lx |
| (100%): 88.4 lx | |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.328 m


Humidity:

Inspector:

Illuminance at a Distance

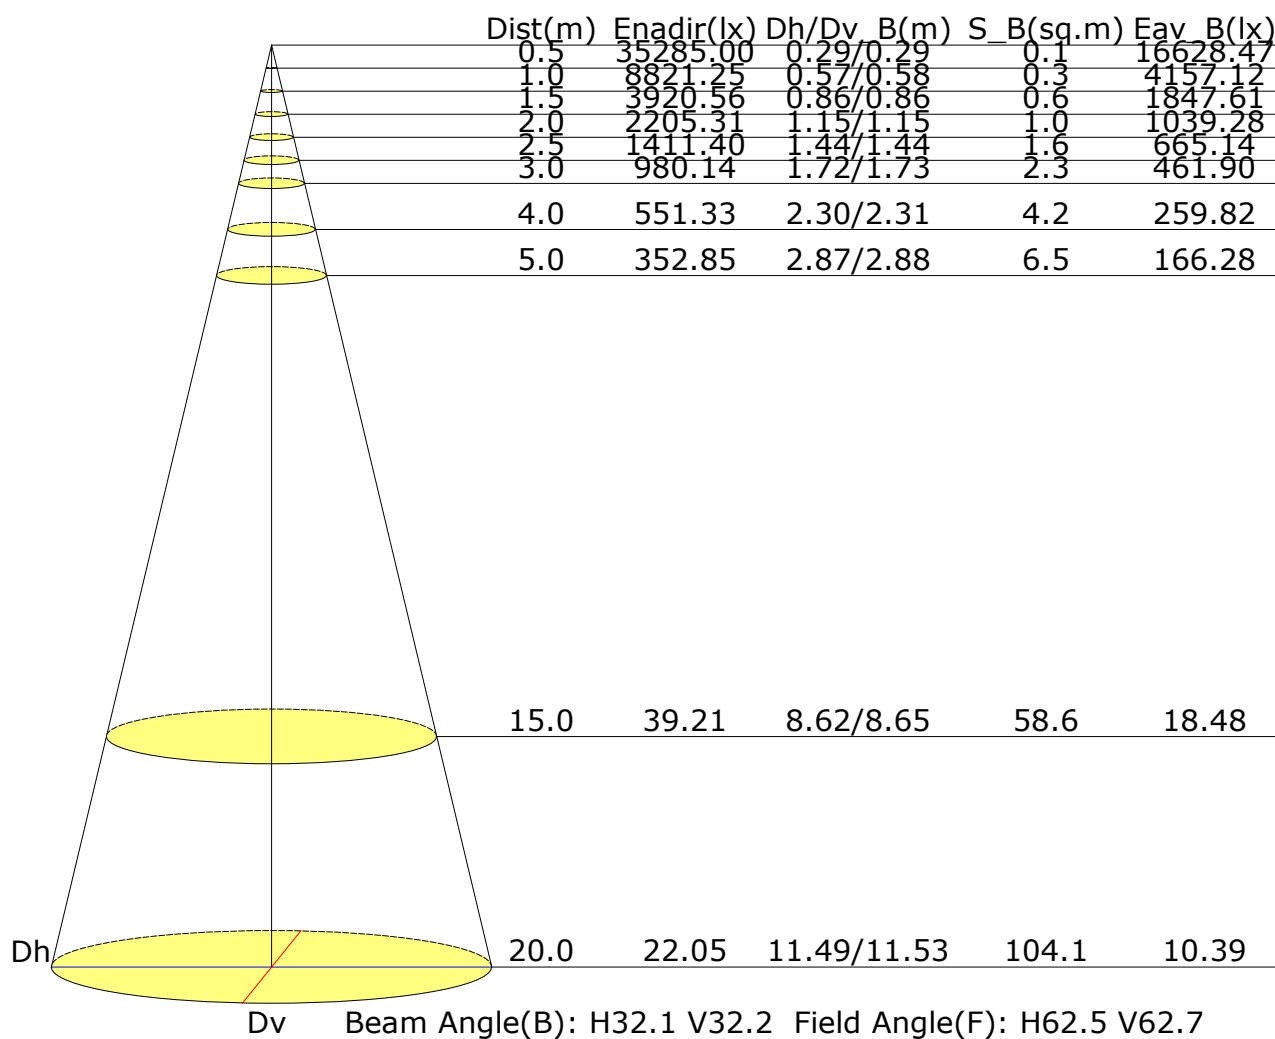

Vertical IsoLux Plot

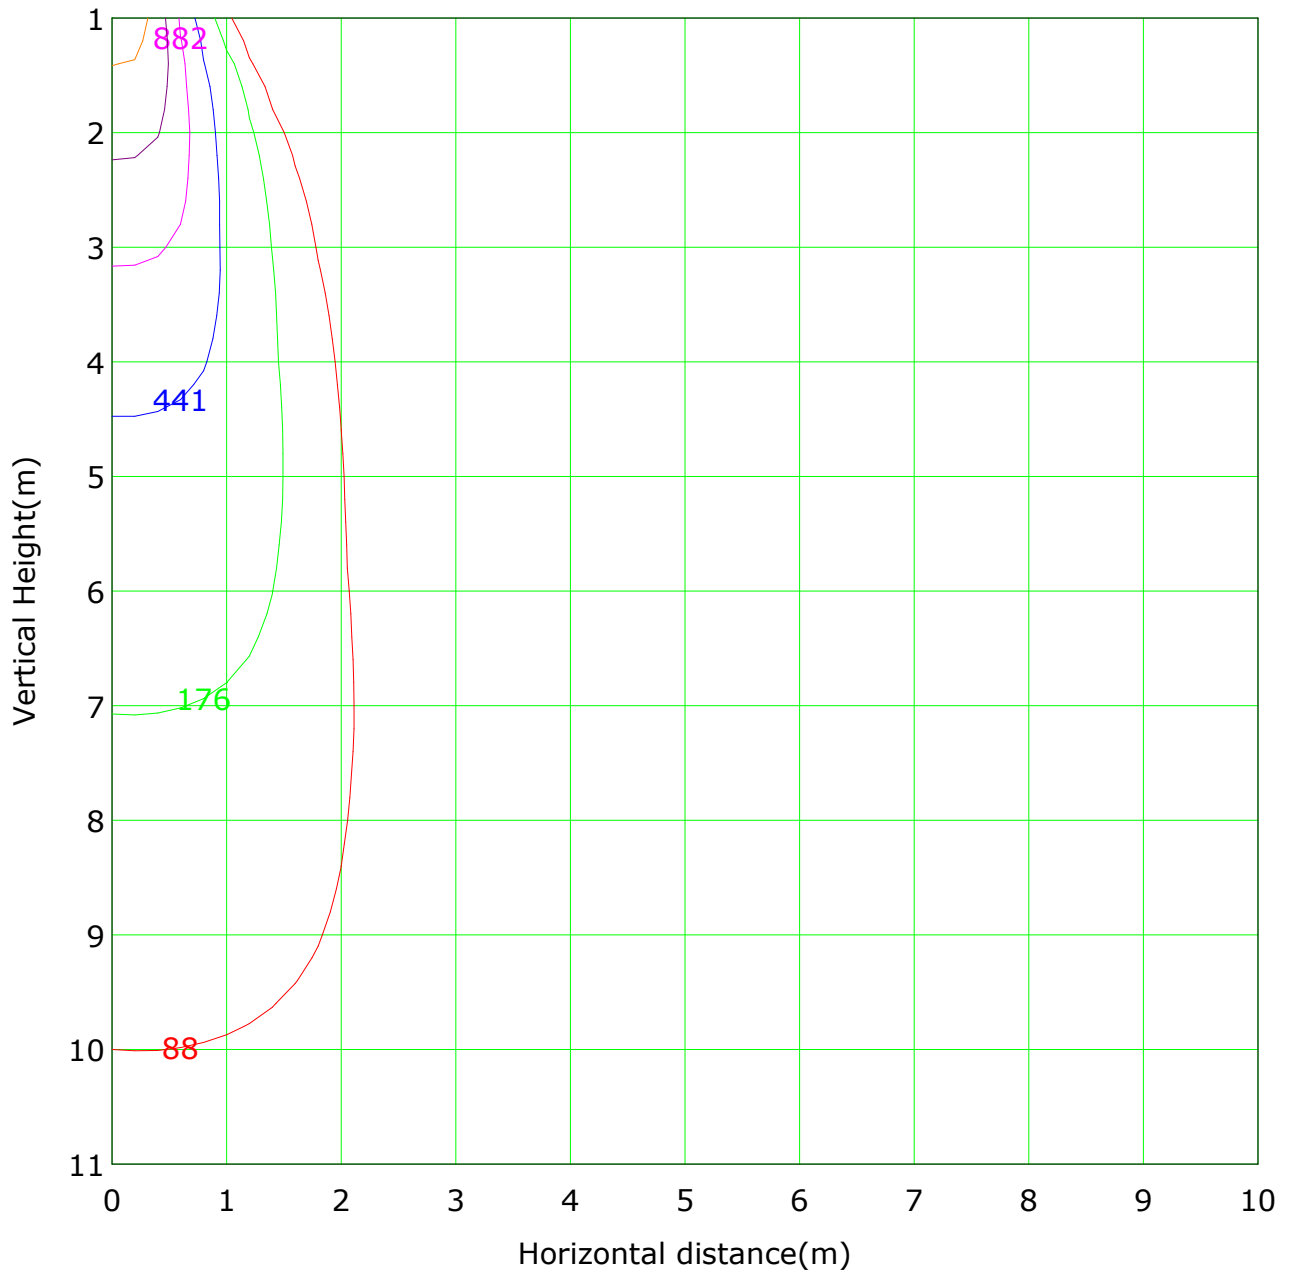


Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 8821.3 lx
— (1%): 88.2 lx — (2%): 176.4 lx
— (5%): 441.1 lx — (10%): 882.1 lx
— (20%): 1764.3 lx — (50%): 4410.6 lx
— (100%): 8821.3 lx

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

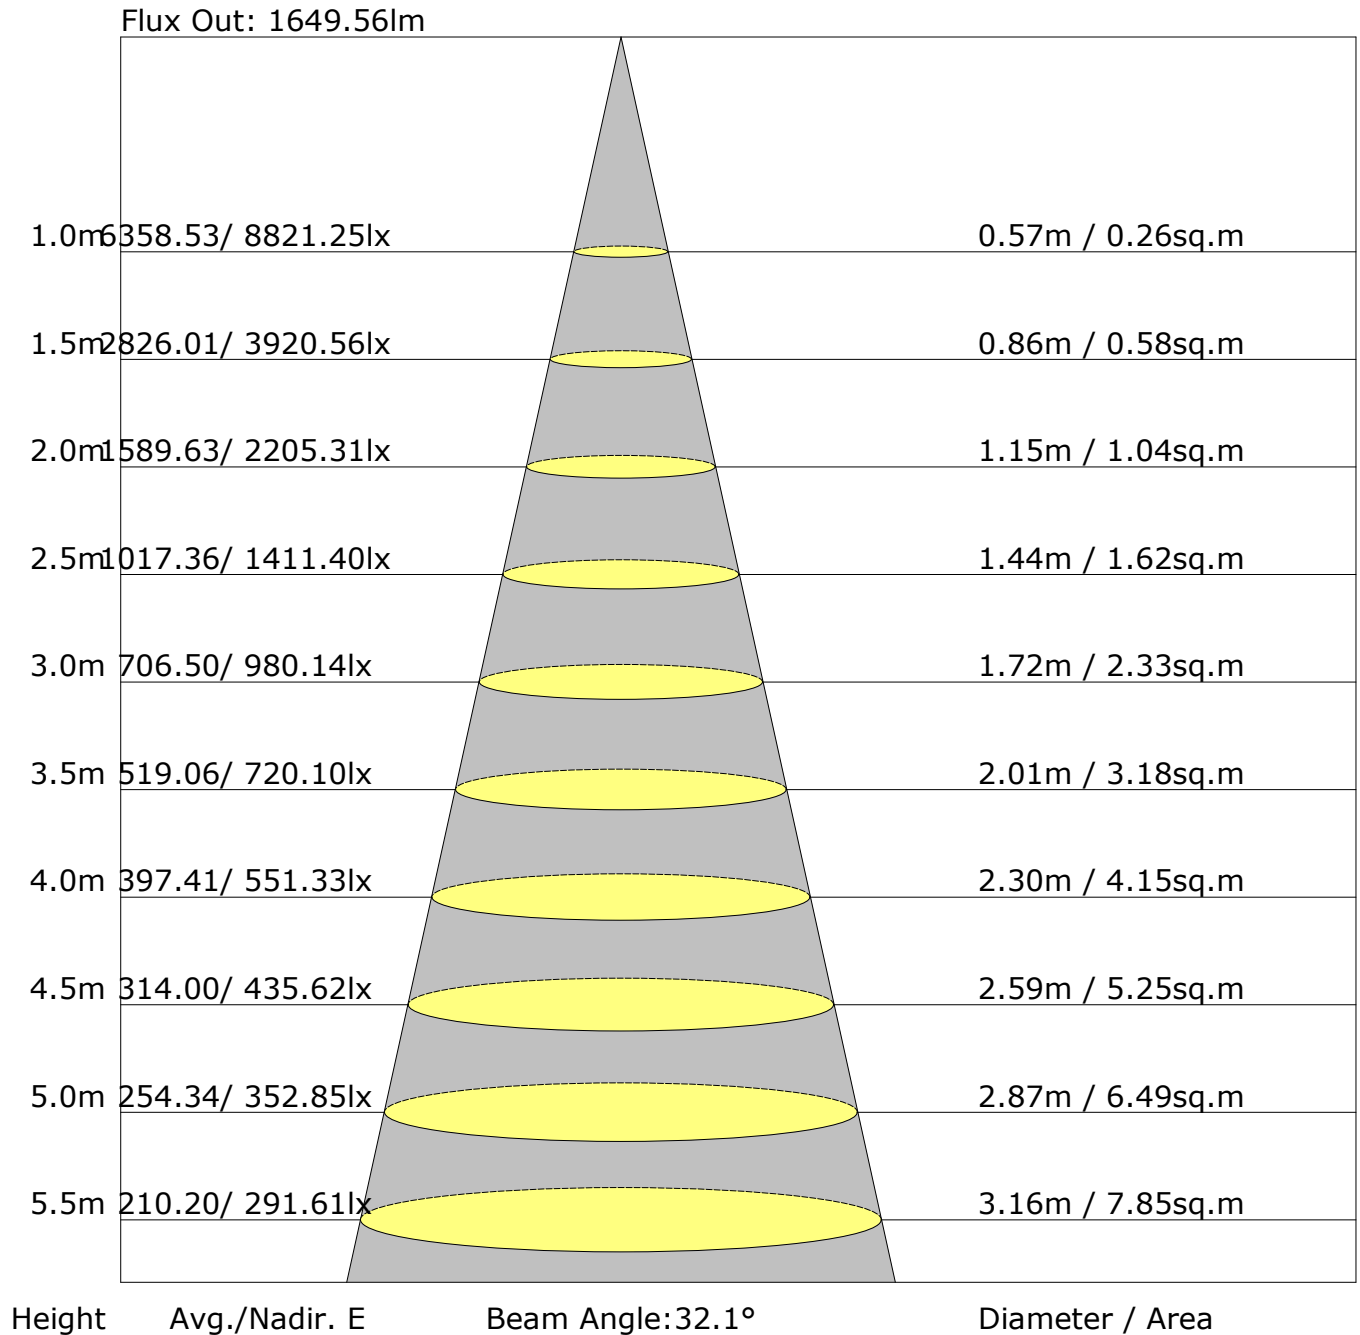

C Plane (°): 0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-90.0: 1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

UGR Table

| | | | | | | | | | | |
|--|------------------|------|------|------|------|----------------|------|------|------|------|
| Reflectance: | | | | | | | | | | |
| Ceiling (cavity) | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 | 0.7 | 0.7 | 0.5 | 0.5 | 0.3 |
| Wall | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 | 0.5 | 0.3 | 0.5 | 0.3 | 0.3 |
| Reference plane | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Room dimensions | Viewed crosswise | | | | | Viewed endwise | | | | |
| X=2H Y=2H | 21.4 | 22.1 | 21.6 | 22.3 | 22.5 | 20.8 | 21.5 | 21.0 | 21.7 | 21.9 |
| 3H | 21.2 | 21.9 | 21.5 | 22.1 | 22.4 | 20.6 | 21.3 | 20.9 | 21.5 | 21.8 |
| 4H | 21.2 | 21.8 | 21.5 | 22.0 | 22.3 | 20.5 | 21.2 | 20.9 | 21.4 | 21.7 |
| 6H | 21.1 | 21.7 | 21.4 | 22.0 | 22.2 | 20.5 | 21.1 | 20.8 | 21.3 | 21.6 |
| 8H | 21.1 | 21.6 | 21.4 | 21.9 | 22.2 | 20.4 | 21.0 | 20.8 | 21.3 | 21.6 |
| 12H | 21.0 | 21.5 | 21.4 | 21.9 | 22.2 | 20.4 | 20.9 | 20.7 | 21.2 | 21.6 |
| X=4H Y=2H | 21.2 | 21.9 | 21.5 | 22.1 | 22.4 | 20.6 | 21.3 | 20.9 | 21.5 | 21.8 |
| 3H | 21.1 | 21.6 | 21.4 | 21.9 | 22.2 | 20.5 | 21.0 | 20.8 | 21.3 | 21.7 |
| 4H | 21.0 | 21.5 | 21.4 | 21.8 | 22.2 | 20.4 | 20.9 | 20.8 | 21.2 | 21.6 |
| 6H | 20.9 | 21.3 | 21.3 | 21.7 | 22.1 | 20.3 | 20.7 | 20.7 | 21.1 | 21.5 |
| 8H | 20.9 | 21.3 | 21.3 | 21.6 | 22.1 | 20.3 | 20.7 | 20.7 | 21.1 | 21.5 |
| 12H | 20.8 | 21.2 | 21.3 | 21.6 | 22.0 | 20.2 | 20.6 | 20.7 | 21.0 | 21.4 |
| X=8H Y=4H | 20.9 | 21.3 | 21.3 | 21.6 | 22.1 | 20.3 | 20.7 | 20.7 | 21.1 | 21.5 |
| 6H | 20.8 | 21.1 | 21.2 | 21.5 | 22.0 | 20.2 | 20.5 | 20.6 | 20.9 | 21.4 |
| 8H | 20.7 | 21.0 | 21.2 | 21.5 | 21.9 | 20.1 | 20.4 | 20.6 | 20.9 | 21.3 |
| 12H | 20.7 | 20.9 | 21.2 | 21.4 | 21.9 | 20.1 | 20.3 | 20.6 | 20.8 | 21.3 |
| X=12H Y=4H | 20.8 | 21.2 | 21.3 | 21.6 | 22.0 | 20.2 | 20.6 | 20.7 | 21.0 | 21.4 |
| 6H | 20.7 | 21.0 | 21.2 | 21.5 | 21.9 | 20.1 | 20.4 | 20.6 | 20.9 | 21.3 |
| 8H | 20.7 | 20.9 | 21.2 | 21.4 | 21.9 | 20.1 | 20.3 | 20.6 | 20.8 | 21.3 |
| Variations with the observer position at spacings: | | | | | | | | | | |
| S=1.0H | +3.8/-4.4 | | | | | +3.7/-4.8 | | | | |
| S=1.5H | +6.3/-8.5 | | | | | +6.2/-9.7 | | | | |
| S=2.0H | +8.3/-25.1 | | | | | +8.2/-27.1 | | | | |

Calculate in accordance with CIE Pub.117. The table is revised with 3501lm ($8\log(F/F_0) = 4.4$).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

| | ZONE | LUMENS | % LAMP LUMENS |
|--|----------------|--------|---------------|
| | FORWARD LIGHT | 1852 | 52.9 |
| | FL (0°-30°) | 1536 | 43.9 |
| | FM (30°-60°) | 309 | 8.8 |
| | FH (60°-80°) | 7 | 0.2 |
| | FVH (80°-90°) | 0 | 0.0 |
| | BACK LIGHT | 1649 | 47.1 |
| | BL (0°-30°) | 1381 | 39.5 |
| | BM (30°-60°) | 263 | 7.5 |
| | BH (60°-80°) | 4 | 0.1 |
| | BVH (80°-90°) | 0 | 0.0 |
| | UP LIGHT | 0 | 0.0 |
| | UL (90°-100°) | 0 | 0.0 |
| | UH (100°-180°) | 0 | 0.0 |
| | TRAPPED LIGHT | NA | NA |

| BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07 | |
|--|----------|
| Asymmetrical Luminaire Types (Type I,II,III,IV) | B3 U0 G0 |
| Quadrilateral Symmetrical Luminaire Types (Type V,Area Light) | B3 U0 G0 |

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

Zonal Lumen

| Gamma [°] | I _{mean} [cd] | Zonal Flux [lm] | Sum Zonal Flux [lm] | Rel Zonal Flux [%] | Sum Rel Zonal Flux [%] |
|--------------|---------------------------|--------------------|------------------------|-----------------------|---------------------------|
| 0.0-1.0 | 8815.3 | 8.4 | 8.4 | 0.24 | 0.24 |
| 1.0-2.0 | 8793.5 | 25.2 | 33.7 | 0.72 | 0.96 |
| 2.0-3.0 | 8749.3 | 41.9 | 75.5 | 1.20 | 2.16 |
| 3.0-4.0 | 8680.7 | 58.1 | 133.6 | 1.66 | 3.82 |
| 4.0-5.0 | 8585.3 | 73.9 | 207.5 | 2.11 | 5.93 |
| 5.0-6.0 | 8458.2 | 88.9 | 296.4 | 2.54 | 8.47 |
| 6.0-7.0 | 8293.6 | 103.0 | 399.4 | 2.94 | 11.41 |
| 7.0-8.0 | 8086.0 | 115.7 | 515.1 | 3.31 | 14.71 |
| 8.0-9.0 | 7826.4 | 126.9 | 642.0 | 3.62 | 18.34 |
| 9.0-10.0 | 7508.2 | 135.9 | 777.9 | 3.88 | 22.22 |
| 10.0-11.0 | 7130.8 | 142.5 | 920.4 | 4.07 | 26.29 |
| 11.0-12.0 | 6703.2 | 146.6 | 1066.9 | 4.19 | 30.48 |
| 12.0-13.0 | 6247.2 | 148.3 | 1215.2 | 4.24 | 34.71 |
| 13.0-14.0 | 5769.2 | 147.7 | 1362.9 | 4.22 | 38.93 |
| 14.0-15.0 | 5250.6 | 144.2 | 1507.0 | 4.12 | 43.05 |
| 15.0-16.0 | 4713.2 | 138.1 | 1645.2 | 3.95 | 47.00 |
| 16.0-17.0 | 4215.5 | 131.3 | 1776.5 | 3.75 | 50.75 |
| 17.0-18.0 | 3754.6 | 123.8 | 1900.3 | 3.54 | 54.28 |
| 18.0-19.0 | 3321.1 | 115.6 | 2015.8 | 3.30 | 57.58 |
| 19.0-20.0 | 2958.9 | 108.3 | 2124.1 | 3.09 | 60.68 |
| 20.0-21.0 | 2669.1 | 102.5 | 2226.6 | 2.93 | 63.61 |
| 21.0-22.0 | 2415.7 | 97.1 | 2323.7 | 2.77 | 66.38 |
| 22.0-23.0 | 2186.3 | 91.7 | 2415.5 | 2.62 | 69.00 |
| 23.0-24.0 | 1978.1 | 86.5 | 2502.0 | 2.47 | 71.47 |
| 24.0-25.0 | 1788.6 | 81.3 | 2583.3 | 2.32 | 73.80 |
| 25.0-26.0 | 1616.0 | 76.3 | 2659.6 | 2.18 | 75.98 |
| 26.0-27.0 | 1458.9 | 71.4 | 2731.0 | 2.04 | 78.01 |
| 27.0-28.0 | 1315.8 | 66.6 | 2797.6 | 1.90 | 79.92 |
| 28.0-29.0 | 1186.5 | 62.1 | 2859.7 | 1.77 | 81.69 |
| 29.0-30.0 | 1070.2 | 57.8 | 2917.5 | 1.65 | 83.34 |
| 30.0-31.0 | 964.6 | 53.7 | 2971.2 | 1.53 | 84.88 |
| 31.0-32.0 | 866.4 | 49.6 | 3020.8 | 1.42 | 86.29 |
| 32.0-33.0 | 773.9 | 45.6 | 3066.4 | 1.30 | 87.60 |
| 33.0-34.0 | 688.2 | 41.7 | 3108.1 | 1.19 | 88.79 |
| 34.0-35.0 | 612.1 | 38.0 | 3146.1 | 1.09 | 89.87 |
| 35.0-36.0 | 543.9 | 34.6 | 3180.7 | 0.99 | 90.86 |

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

| Gamma [°] | I _{mean} [cd] | Zonal Flux [lm] | Sum Zonal Flux [lm] | Rel Zonal Flux [%] | Sum Rel Zonal Flux [%] |
|--------------|---------------------------|--------------------|------------------------|-----------------------|---------------------------|
| 36.0-37.0 | 478.1 | 31.2 | 3211.9 | 0.89 | 91.75 |
| 37.0-38.0 | 415.8 | 27.8 | 3239.7 | 0.79 | 92.55 |
| 38.0-39.0 | 361.5 | 24.7 | 3264.3 | 0.71 | 93.25 |
| 39.0-40.0 | 317.0 | 22.1 | 3286.5 | 0.63 | 93.88 |
| 40.0-41.0 | 280.8 | 20.0 | 3306.5 | 0.57 | 94.45 |
| 41.0-42.0 | 251.2 | 18.3 | 3324.7 | 0.52 | 94.97 |
| 42.0-43.0 | 225.6 | 16.7 | 3341.4 | 0.48 | 95.45 |
| 43.0-44.0 | 203.5 | 15.4 | 3356.8 | 0.44 | 95.89 |
| 44.0-45.0 | 186.1 | 14.3 | 3371.1 | 0.41 | 96.30 |
| 45.0-46.0 | 170.8 | 13.4 | 3384.4 | 0.38 | 96.68 |
| 46.0-47.0 | 156.1 | 12.4 | 3396.9 | 0.35 | 97.04 |
| 47.0-48.0 | 143.1 | 11.6 | 3408.4 | 0.33 | 97.37 |
| 48.0-49.0 | 131.5 | 10.8 | 3419.2 | 0.31 | 97.67 |
| 49.0-50.0 | 119.4 | 10.0 | 3429.2 | 0.28 | 97.96 |
| 50.0-51.0 | 107.8 | 9.1 | 3438.3 | 0.26 | 98.22 |
| 51.0-52.0 | 97.9 | 8.4 | 3446.7 | 0.24 | 98.46 |
| 52.0-53.0 | 87.6 | 7.6 | 3454.3 | 0.22 | 98.68 |
| 53.0-54.0 | 77.9 | 6.9 | 3461.2 | 0.20 | 98.87 |
| 54.0-55.0 | 68.9 | 6.1 | 3467.3 | 0.18 | 99.05 |
| 55.0-56.0 | 60.5 | 5.5 | 3472.8 | 0.16 | 99.21 |
| 56.0-57.0 | 53.6 | 4.9 | 3477.7 | 0.14 | 99.35 |
| 57.0-58.0 | 46.4 | 4.3 | 3482.0 | 0.12 | 99.47 |
| 58.0-59.0 | 40.5 | 3.8 | 3485.8 | 0.11 | 99.58 |
| 59.0-60.0 | 35.2 | 3.3 | 3489.1 | 0.10 | 99.67 |
| 60.0-61.0 | 29.6 | 2.8 | 3492.0 | 0.08 | 99.75 |
| 61.0-62.0 | 24.6 | 2.4 | 3494.3 | 0.07 | 99.82 |
| 62.0-63.0 | 20.3 | 2.0 | 3496.3 | 0.06 | 99.88 |
| 63.0-64.0 | 15.9 | 1.6 | 3497.9 | 0.04 | 99.92 |
| 64.0-65.0 | 11.2 | 1.1 | 3499.0 | 0.03 | 99.95 |
| 65.0-66.0 | 7.5 | 0.7 | 3499.7 | 0.02 | 99.97 |
| 66.0-67.0 | 5.0 | 0.5 | 3500.2 | 0.01 | 99.99 |
| 67.0-68.0 | 3.1 | 0.3 | 3500.5 | 0.01 | 100.00 |
| 68.0-69.0 | 0.9 | 0.1 | 3500.6 | 0.00 | 100.00 |
| 69.0-70.0 | 0.0 | 0.0 | 3500.6 | 0.00 | 100.00 |
| 70.0-71.0 | 0.0 | 0.0 | 3500.6 | 0.00 | 100.00 |
| 71.0-72.0 | 0.0 | 0.0 | 3500.6 | 0.00 | 100.00 |

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

| G\C | C0.0 | C180.0 | | | | | | | | |
|-------|--------|--------|--|--|--|--|--|--|--|--|
| G0.0 | 8821.3 | 8821.3 | | | | | | | | |
| G1.0 | 8846.2 | 8772.6 | | | | | | | | |
| G2.0 | 8854.9 | 8700.3 | | | | | | | | |
| G3.0 | 8840.0 | 8601.8 | | | | | | | | |
| G4.0 | 8806.3 | 8474.7 | | | | | | | | |
| G5.0 | 8748.9 | 8311.4 | | | | | | | | |
| G6.0 | 8669.2 | 8103.2 | | | | | | | | |
| G7.0 | 8557.0 | 7845.1 | | | | | | | | |
| G8.0 | 8407.4 | 7534.7 | | | | | | | | |
| G9.0 | 8214.1 | 7149.5 | | | | | | | | |
| G10.0 | 7973.5 | 6695.7 | | | | | | | | |
| G11.0 | 7663.1 | 6190.8 | | | | | | | | |
| G12.0 | 7270.4 | 5688.4 | | | | | | | | |
| G13.0 | 6794.2 | 5235.9 | | | | | | | | |
| G14.0 | 6248.2 | 4798.3 | | | | | | | | |
| G15.0 | 5674.7 | 4281.0 | | | | | | | | |
| G16.0 | 5143.6 | 3753.6 | | | | | | | | |
| G17.0 | 4632.5 | 3332.3 | | | | | | | | |
| G18.0 | 4044.1 | 3009.4 | | | | | | | | |
| G19.0 | 3506.8 | 2723.9 | | | | | | | | |
| G20.0 | 3135.3 | 2469.6 | | | | | | | | |
| G21.0 | 2836.1 | 2235.2 | | | | | | | | |
| G22.0 | 2574.3 | 2017.1 | | | | | | | | |
| G23.0 | 2330.0 | 1823.8 | | | | | | | | |
| G24.0 | 2113.1 | 1645.6 | | | | | | | | |
| G25.0 | 1909.9 | 1486.0 | | | | | | | | |
| G26.0 | 1724.1 | 1343.9 | | | | | | | | |
| G27.0 | 1555.8 | 1211.7 | | | | | | | | |
| G28.0 | 1406.2 | 1089.6 | | | | | | | | |
| G29.0 | 1267.8 | 982.3 | | | | | | | | |
| G30.0 | 1144.4 | 886.4 | | | | | | | | |
| G31.0 | 1033.5 | 794.1 | | | | | | | | |
| G32.0 | 933.7 | 704.3 | | | | | | | | |
| G33.0 | 844.0 | 613.3 | | | | | | | | |
| G34.0 | 763.0 | 532.3 | | | | | | | | |
| G35.0 | 688.2 | 465.0 | | | | | | | | |
| G36.0 | 613.3 | 408.9 | | | | | | | | |

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.328 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

| G\C | C0.0 | C180.0 | | | | | | | | |
|-------|-------|--------|--|--|--|--|--|--|--|--|
| G37.0 | 531.1 | 359.0 | | | | | | | | |
| G38.0 | 453.8 | 319.1 | | | | | | | | |
| G39.0 | 393.9 | 279.3 | | | | | | | | |
| G40.0 | 347.8 | 246.8 | | | | | | | | |
| G41.0 | 306.7 | 221.9 | | | | | | | | |
| G42.0 | 271.8 | 204.4 | | | | | | | | |
| G43.0 | 240.6 | 185.8 | | | | | | | | |
| G44.0 | 216.9 | 170.8 | | | | | | | | |
| G45.0 | 198.2 | 158.3 | | | | | | | | |
| G46.0 | 180.8 | 145.9 | | | | | | | | |
| G47.0 | 167.1 | 130.9 | | | | | | | | |
| G48.0 | 155.8 | 118.4 | | | | | | | | |
| G49.0 | 143.4 | 108.5 | | | | | | | | |
| G50.0 | 129.6 | 96.0 | | | | | | | | |
| G51.0 | 119.7 | 86.0 | | | | | | | | |
| G52.0 | 109.7 | 76.1 | | | | | | | | |
| G53.0 | 98.5 | 66.1 | | | | | | | | |
| G54.0 | 89.8 | 57.3 | | | | | | | | |
| G55.0 | 79.8 | 48.6 | | | | | | | | |
| G56.0 | 71.1 | 42.4 | | | | | | | | |
| G57.0 | 61.1 | 39.9 | | | | | | | | |
| G58.0 | 52.4 | 32.4 | | | | | | | | |
| G59.0 | 47.4 | 29.9 | | | | | | | | |
| G60.0 | 39.9 | 23.7 | | | | | | | | |
| G61.0 | 34.9 | 20.0 | | | | | | | | |
| G62.0 | 29.9 | 13.7 | | | | | | | | |
| G63.0 | 27.4 | 10.0 | | | | | | | | |
| G64.0 | 20.0 | 6.2 | | | | | | | | |
| G65.0 | 16.2 | 2.5 | | | | | | | | |
| G66.0 | 11.2 | 0.0 | | | | | | | | |
| G67.0 | 8.7 | 0.0 | | | | | | | | |
| G68.0 | 3.7 | 0.0 | | | | | | | | |
| G69.0 | 0.0 | 0.0 | | | | | | | | |
| G70.0 | 0.0 | 0.0 | | | | | | | | |
| G71.0 | 0.0 | 0.0 | | | | | | | | |
| G72.0 | 0.0 | 0.0 | | | | | | | | |
| G73.0 | 0.0 | 0.0 | | | | | | | | |

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0

Test Device: CHL-6E

Distance: 3.328 m

Humidity:

Inspector:

Unit: cd

[illegible]

Inspector: