中山雅大光电有限公司
www.artdon.cn
0760-22211886
0760-22211890

Report No.: Test Time: 2026-09-11 15:55

Luminaire Property

Luminaire Manufacturer:
Luminaire Description: ADJ 62
Luminous Length (mm): -55
Luminous Width (mm): -55
Voltage: 227.3 V
Current: 0.046 A
Power: 9.70 W
Power Factor: 0.928


Photometric Results

CIE Class: Direct
Total Rated Lamp Lumens: 828.2 lm
Measurement Flux: 828.2 lm
Efficiency: 100%
Downward Ratio: 100%
Upward Ratio: 0%
Horizontal Diffuse Angle(50%): H22.3
Vertical Diffuse Angle(50%): V22.3
Luminaire Efficacy Rating (LER): 85.43
Central Intensity: 3362.98 cd
Max. Intensity: 3362.98 cd
Pos of Max. Intensity: H0 V0
S/MH(C0/C180): 0.38
S/MH(C90/C270): 0.38

Picture Of Luminaire





Luminous Intensity Distribution Curve

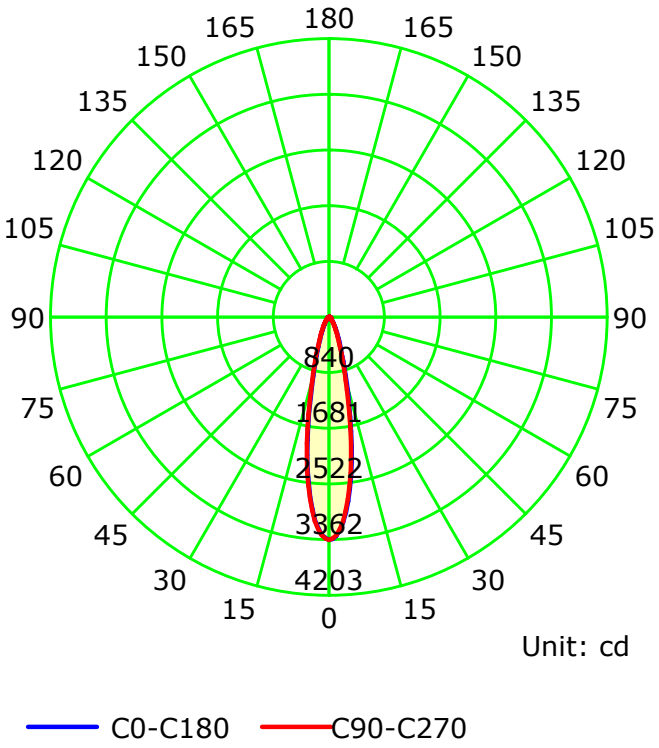

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Luminous Intensity Distribution Curve

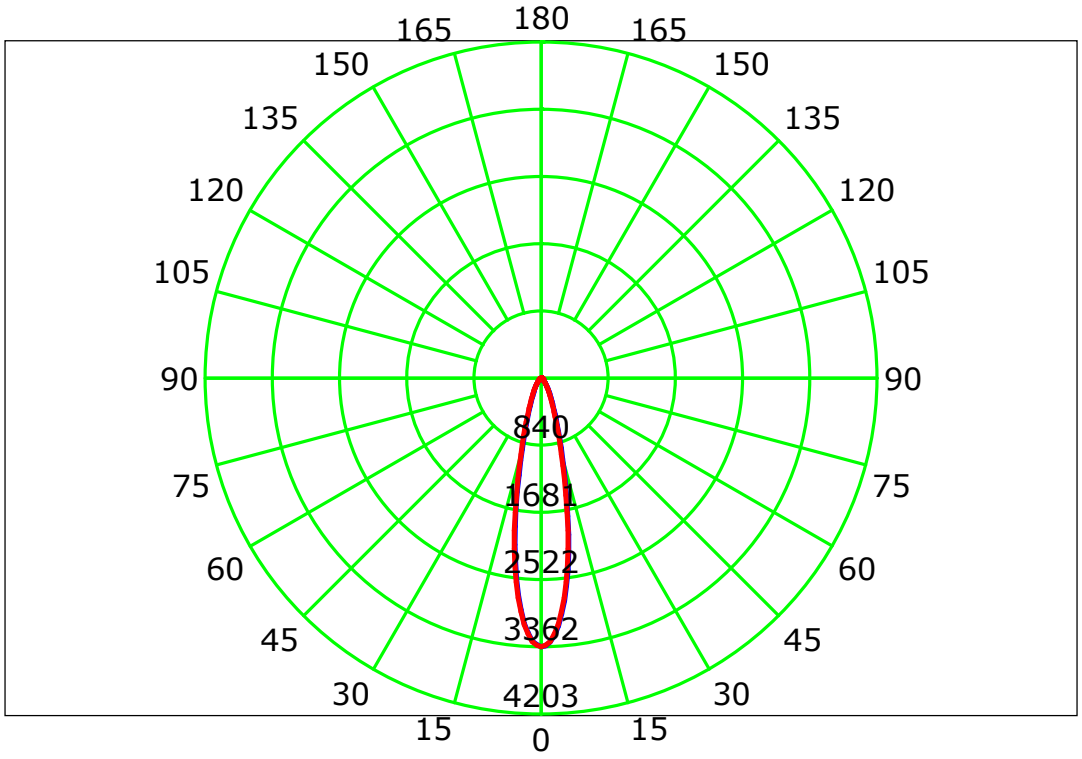


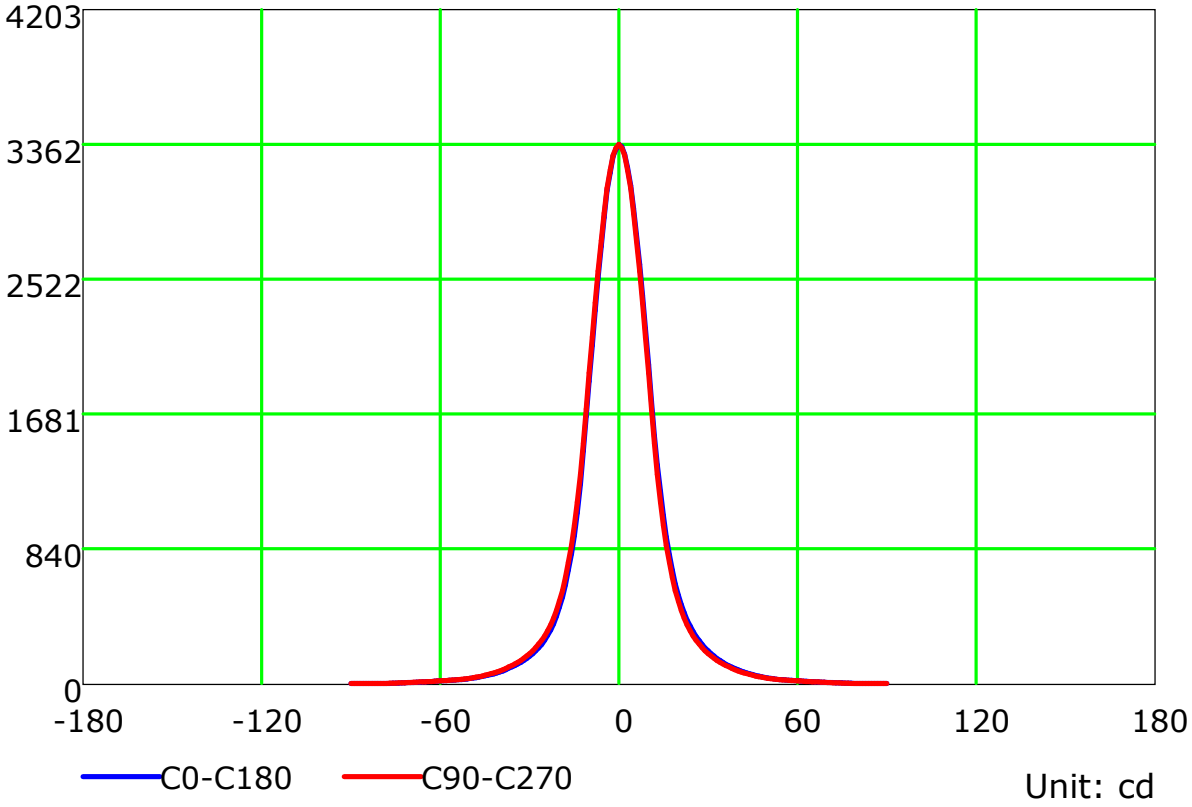

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

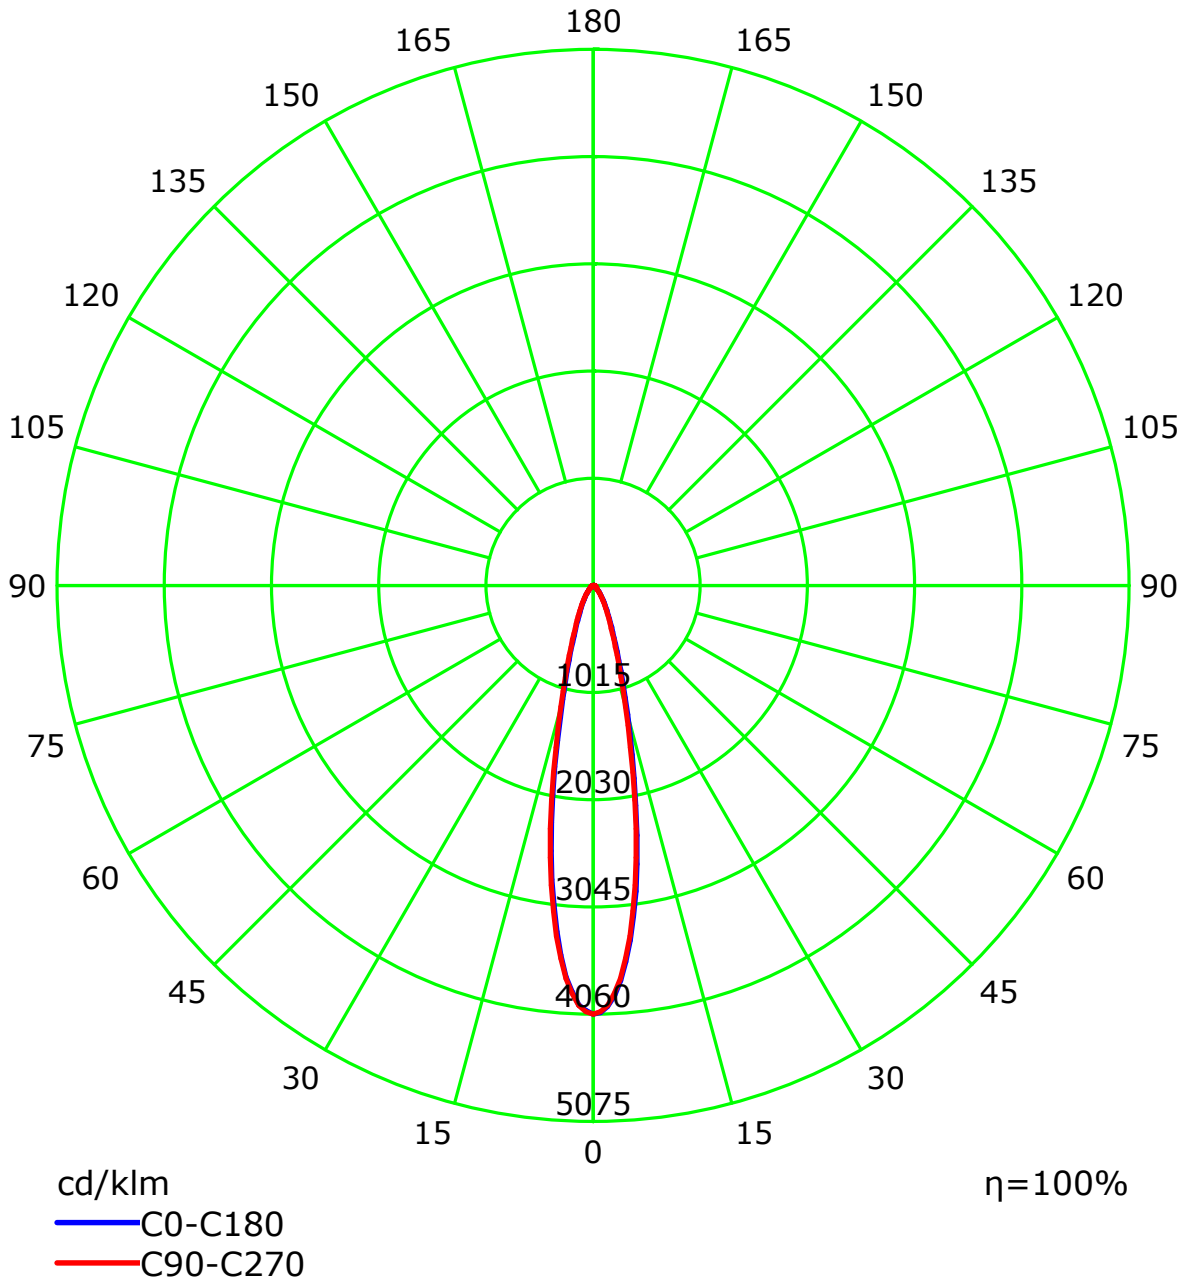

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

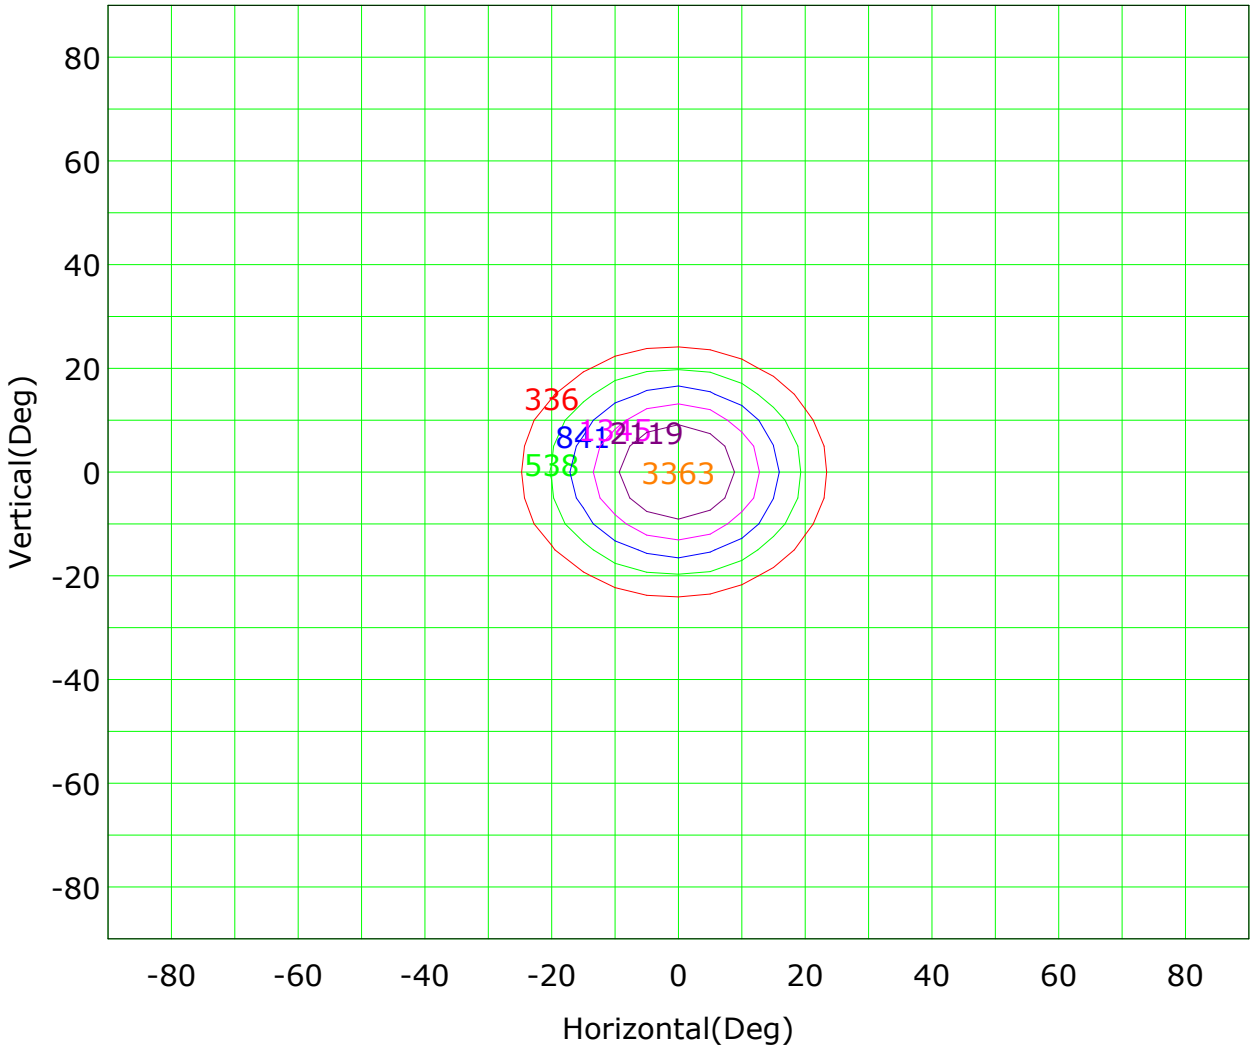


Imax (100%): 3363 cd

(10%): 336 cd
(16%): 538 cd
(25%): 841 cd
(40%): 1345 cd
(63%): 2119 cd
(100%): 3363 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

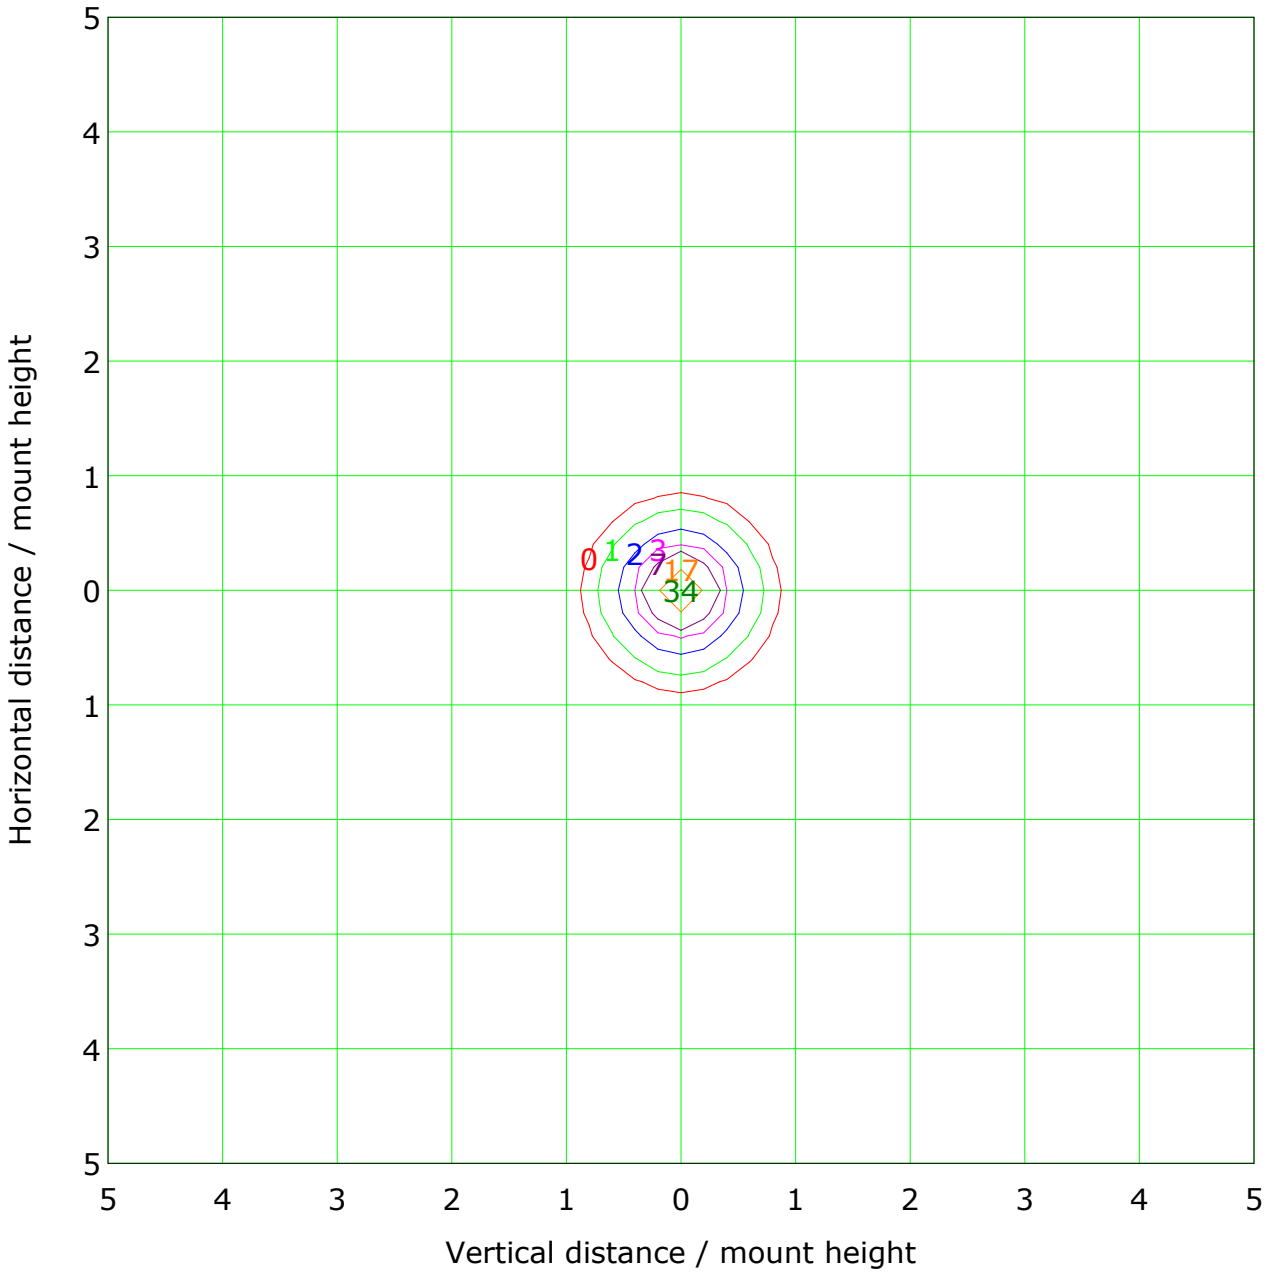


Mounting Height: 10.0m Max Lux(100%): 33.6 lx

(1%): 0.3 lx
(2%): 0.7 lx
(5%): 1.7 lx
(10%): 3.4 lx
(20%): 6.7 lx
(50%): 16.8 lx
(100%): 33.6 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Illuminance at a Distance

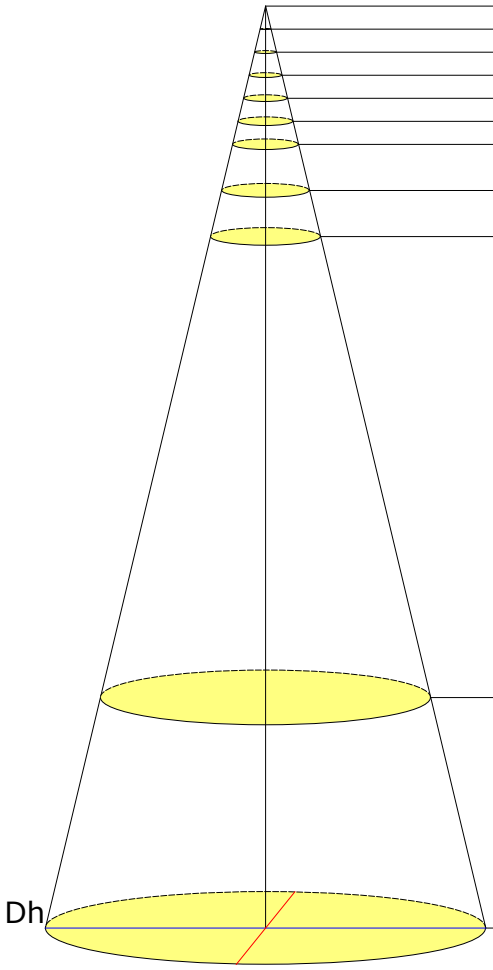


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	13451.92	0.20/0.20	0.0	6517.61
1.0	3362.98	0.39/0.39	0.1	1629.40
1.5	1494.66	0.59/0.59	0.3	724.18
2.0	840.74	0.79/0.79	0.5	407.35
2.5	538.08	0.99/0.99	0.8	260.70
3.0	373.66	1.18/1.18	1.1	181.04
4.0	210.19	1.58/1.58	2.0	101.84
5.0	134.52	1.97/1.97	3.1	65.18
15.0	14.95	5.91/5.91	27.5	7.24
20.0	8.41	7.88/7.88	48.8	4.07

Beam Angle(B): H22.3 V22.3 Field Angle(F): H47.6 V47.6

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

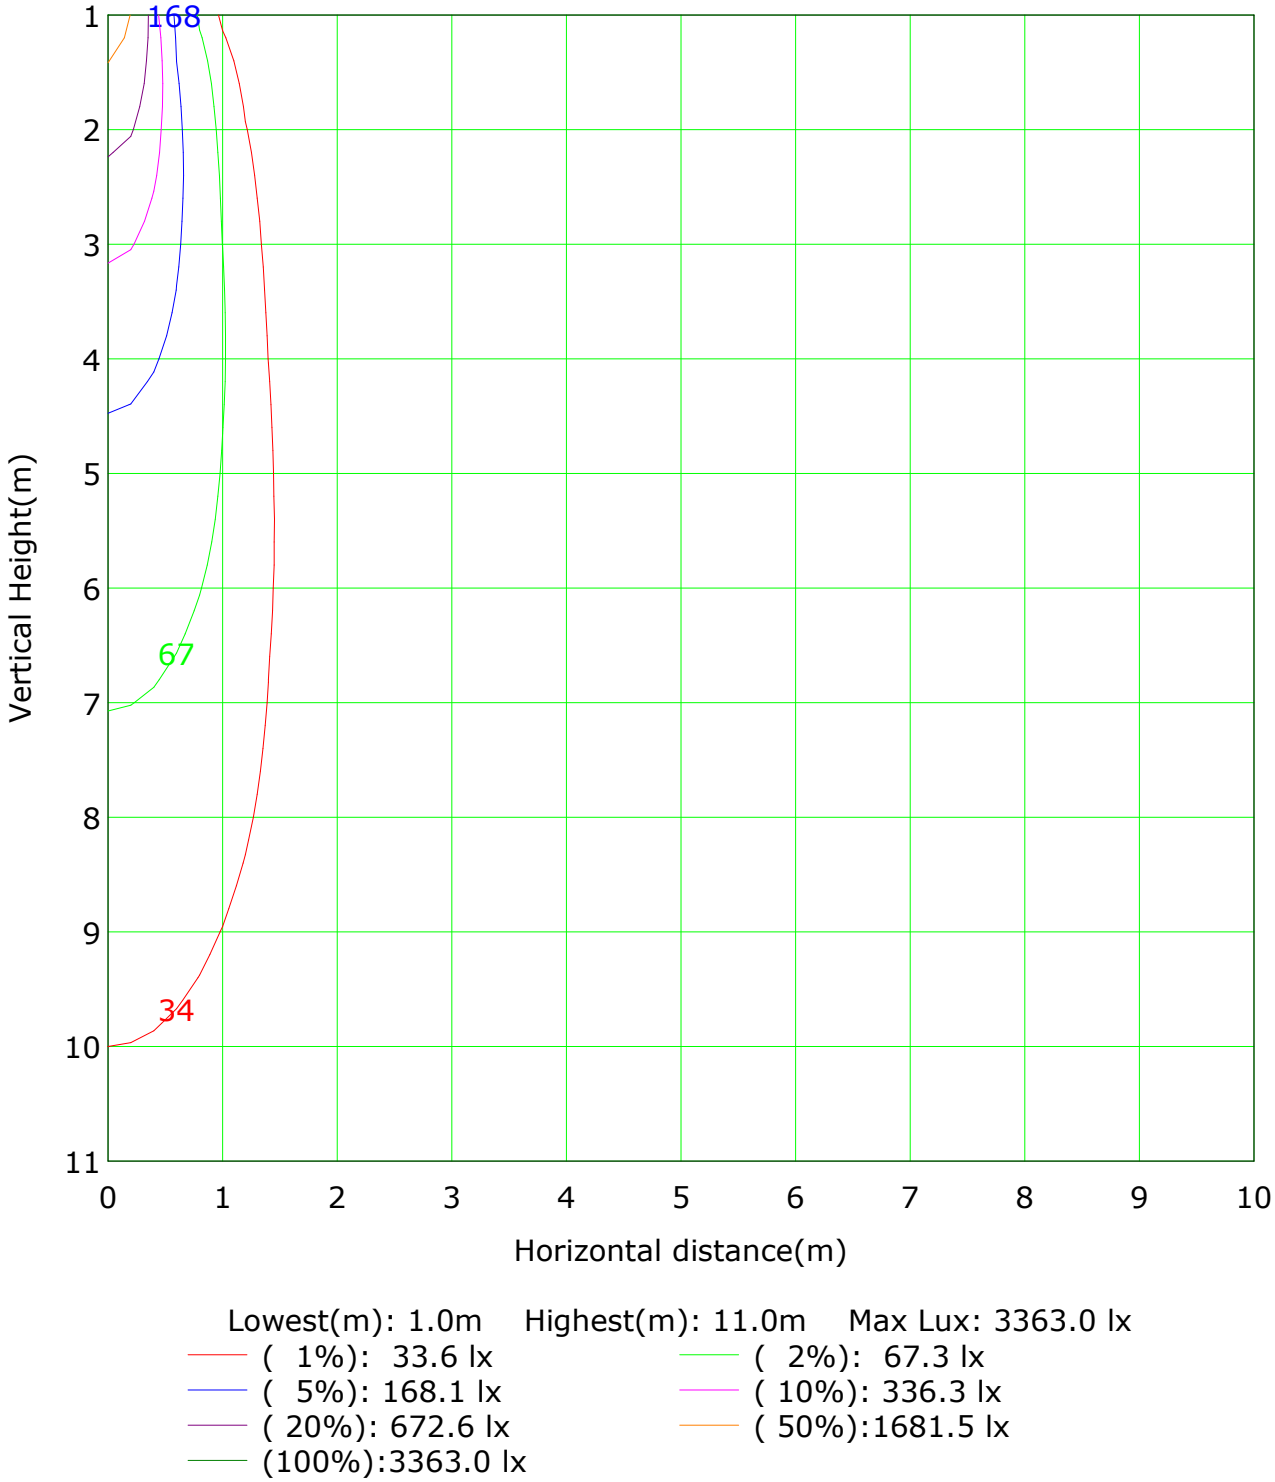

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3363.0 lx

(1%): 33.6 lx	(2%): 67.3 lx
(5%): 168.1 lx	(10%): 336.3 lx
(20%): 672.6 lx	(50%):1681.5 lx
(100%):3363.0 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Area Flux Table


Unit: lm

Horizontal plane	Vertical plane																									
	Flux(E)	Flux(T)	90	80	70	60	50	40	30	20	10	0	-10	-20	-30	-40	-50	-60	-70	-80	-90
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-70	0.0	1.2	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
-60	0.0	3.5	0.0	0.0	0.0	0.1	0.1	0.2	0.3	0.3	0.4	0.4	0.4	0.4	0.3	0.3	0.2	0.1	0.0	0.0	0.0
-50	0.0	7.9	0.0	0.0	0.1	0.1	0.2	0.4	0.5	0.7	0.9	1.1	1.1	0.9	0.7	0.5	0.4	0.2	0.1	0.0	0.0
-40	0.0	18.0	0.0	0.1	0.2	0.4	0.6	1.0	1.6	2.3	2.8	2.8	2.8	2.3	1.6	1.0	0.6	0.4	0.2	0.1	0.0
-30	5.5	40.2	0.0	0.1	0.3	0.5	0.9	1.8	3.4	5.5	7.6	7.6	7.6	5.5	3.4	1.8	0.9	0.5	0.3	0.1	0.0
-20	76.0	102.2	0.0	0.1	0.3	0.6	1.3	2.9	6.1	13.5	26.3	26.3	26.3	13.5	6.1	2.9	1.3	0.6	0.3	0.1	0.0
-10	206.8	230.2	0.0	0.1	0.4	0.7	1.6	3.7	8.9	27.9	71.9	71.9	71.9	27.9	8.9	3.7	1.6	0.7	0.4	0.1	0.0
0	211.5	234.4	0.0	0.1	0.4	0.7	1.6	3.7	9.1	28.5	73.1	73.1	73.1	28.5	9.1	3.7	1.6	0.7	0.4	0.1	0.0
10	84.8	110.3	0.0	0.1	0.3	0.7	1.4	3.0	6.5	14.6	28.6	28.6	28.6	14.6	6.5	3.0	1.4	0.7	0.3	0.1	0.0
20	10.2	45.2	0.0	0.1	0.3	0.5	1.0	2.0	3.7	6.3	8.8	8.8	8.8	6.3	3.7	2.0	1.0	0.5	0.3	0.1	0.0
30	0.0	20.2	0.0	0.1	0.2	0.4	0.6	1.1	1.8	2.7	3.3	3.3	3.3	2.7	1.8	1.1	0.6	0.4	0.2	0.1	0.0
40	0.0	8.7	0.0	0.0	0.1	0.2	0.4	0.5	0.8	1.0	1.2	1.2	1.2	1.0	0.8	0.5	0.4	0.2	0.1	0.0	0.0
50	0.0	3.7	0.0	0.0	0.1	0.1	0.2	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.3	0.3	0.2	0.1	0.1	0.0	0.0
60	0.0	1.4	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.1	0.0	0.0	0.0	0.0
70	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90		828	0.0	0.0	0.8	2.7	5.3	10.3	21.0	43.4	104.4	226.0	226.0	104.4	43.4	21.0	10.3	5.3	2.7	0.8	0.0
-90	595		0.0	0.0	0.0	0.0	0.0	0.0	0.0	8.4	81.8	207.1	207.1	81.8	8.4	0.0	0.0	0.0	0.0	0.0	0.0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

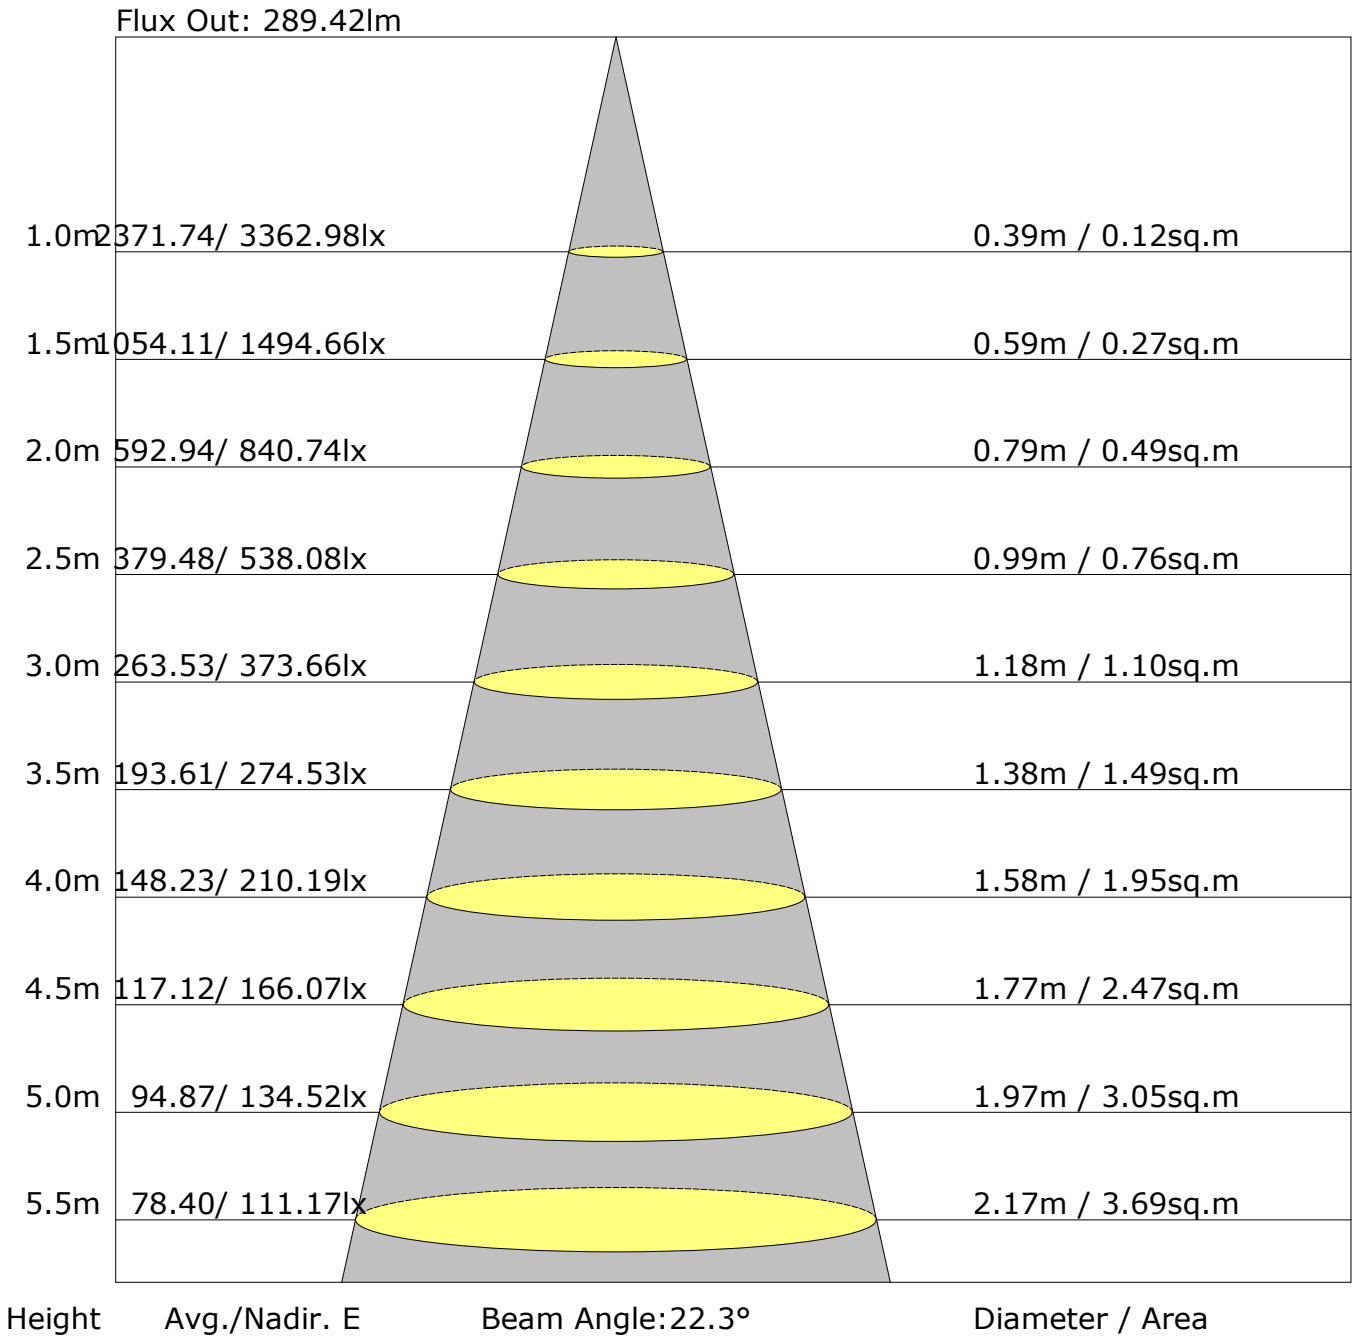

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	18.6	19.3	18.8	19.5	19.7	18.3	19.1	18.6	19.3	19.5
3H	18.9	19.6	19.2	19.8	20.1	18.7	19.4	19.0	19.6	19.8
4H	19.0	19.6	19.3	19.9	20.1	18.7	19.4	19.1	19.6	19.9
6H	19.0	19.6	19.3	19.8	20.1	18.7	19.3	19.0	19.6	19.9
8H	18.9	19.5	19.3	19.8	20.1	18.7	19.2	19.0	19.5	19.8
12H	18.9	19.4	19.3	19.7	20.1	18.6	19.2	19.0	19.5	19.8
X=4H Y=2H	18.7	19.3	19.0	19.6	19.8	18.5	19.1	18.8	19.4	19.6
3H	19.2	19.7	19.5	20.0	20.3	18.9	19.5	19.3	19.8	20.1
4H	19.3	19.7	19.6	20.1	20.4	19.0	19.5	19.4	19.9	20.2
6H	19.3	19.7	19.7	20.1	20.4	19.0	19.4	19.4	19.8	20.2
8H	19.2	19.6	19.6	20.0	20.4	19.0	19.4	19.4	19.7	20.2
12H	19.2	19.5	19.6	19.9	20.4	18.9	19.3	19.4	19.7	20.1
X=8H Y=4H	19.2	19.6	19.6	20.0	20.4	19.0	19.4	19.4	19.8	20.2
6H	19.2	19.5	19.7	20.0	20.4	19.0	19.3	19.4	19.7	20.2
8H	19.2	19.5	19.7	19.9	20.4	18.9	19.2	19.4	19.7	20.1
12H	19.1	19.4	19.6	19.9	20.3	18.9	19.1	19.4	19.6	20.1
X=12H Y=4H	19.2	19.5	19.6	19.9	20.4	19.0	19.3	19.4	19.7	20.2
6H	19.2	19.5	19.7	19.9	20.4	18.9	19.2	19.4	19.7	20.1
8H	19.1	19.4	19.6	19.9	20.4	18.9	19.1	19.4	19.6	20.1
Variations with the observer position at spacings:										
S=1.0H	+1.7/-1.7					+1.6/-1.7				
S=1.5H	+3.5/-2.6					+3.3/-2.6				
S=2.0H	+5.1/-3.4					+4.9/-3.5				

Calculate in accordance with CIE Pub.117. The table is revised with 828lm (8log(F/F0) = -0.7).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

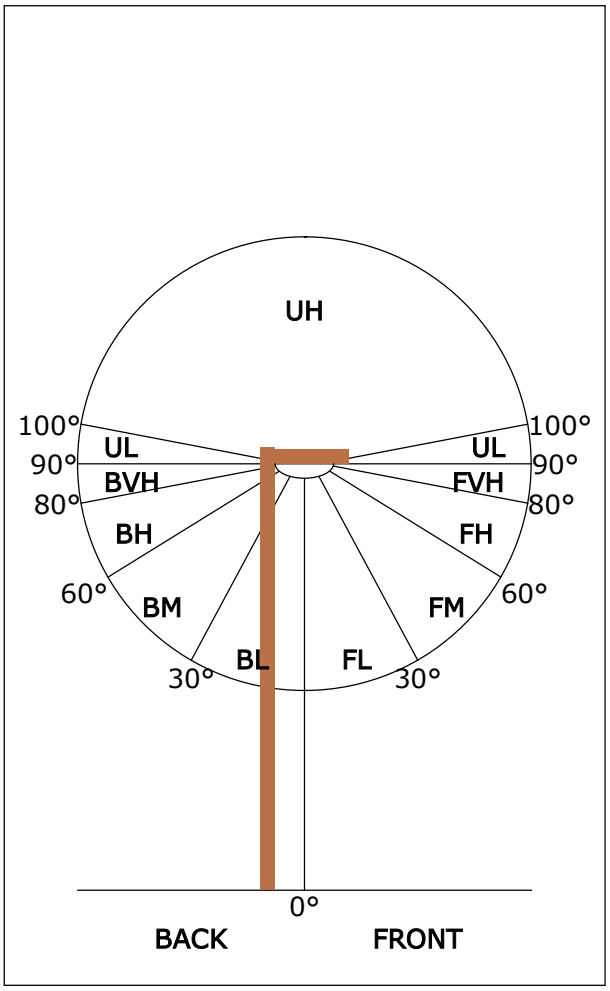

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	424	51.3
FL (0°-30°)	343	41.4
FM (30°-60°)	73	8.8
FH (60°-80°)	8	1.0
FVH (80°-90°)	0	0.0
BACK LIGHT	404	48.7
BL (0°-30°)	328	39.6
BM (30°-60°)	68	8.2
BH (60°-80°)	8	0.9
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3352.1	3.2	3.2	0.39	0.39
1.0-2.0	3319.1	9.5	12.7	1.15	1.54
2.0-3.0	3250.5	15.5	28.3	1.88	3.42
3.0-4.0	3147.6	21.1	49.4	2.54	5.96
4.0-5.0	3013.2	25.9	75.3	3.13	9.09
5.0-6.0	2849.4	29.9	105.2	3.62	12.71
6.0-7.0	2668.3	33.1	138.4	4.00	16.70
7.0-8.0	2473.8	35.4	173.8	4.28	20.98
8.0-9.0	2267.8	36.8	210.5	4.44	25.42
9.0-10.0	2049.1	37.1	247.6	4.48	29.90
10.0-11.0	1825.2	36.5	284.1	4.40	34.30
11.0-12.0	1606.3	35.1	319.2	4.24	38.54
12.0-13.0	1402.2	33.3	352.5	4.02	42.56
13.0-14.0	1218.4	31.2	383.7	3.77	46.32
14.0-15.0	1059.4	29.1	412.8	3.51	49.84
15.0-16.0	924.5	27.1	439.9	3.27	53.11
16.0-17.0	808.7	25.2	465.0	3.04	56.15
17.0-18.0	708.3	23.4	488.4	2.82	58.97
18.0-19.0	621.2	21.6	510.0	2.61	61.58
19.0-20.0	547.3	20.0	530.0	2.42	64.00
20.0-21.0	484.8	18.6	548.7	2.25	66.25
21.0-22.0	431.8	17.4	566.0	2.10	68.34
22.0-23.0	386.6	16.2	582.2	1.96	70.30
23.0-24.0	347.5	15.2	597.4	1.83	72.14
24.0-25.0	313.3	14.2	611.7	1.72	73.86
25.0-26.0	283.6	13.4	625.1	1.62	75.47
26.0-27.0	257.9	12.6	637.7	1.52	77.00
27.0-28.0	235.2	11.9	649.6	1.44	78.43
28.0-29.0	214.9	11.2	660.9	1.36	79.79
29.0-30.0	196.2	10.6	671.5	1.28	81.07
30.0-31.0	179.6	10.0	681.5	1.21	82.28
31.0-32.0	165.0	9.5	690.9	1.14	83.42
32.0-33.0	151.6	8.9	699.8	1.08	84.50
33.0-34.0	139.3	8.4	708.3	1.02	85.52
34.0-35.0	128.1	8.0	716.2	0.96	86.48
35.0-36.0	117.9	7.5	723.7	0.91	87.38

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	108.7	7.1	730.8	0.86	88.24
37.0-38.0	99.7	6.7	737.5	0.80	89.04
38.0-39.0	91.0	6.2	743.7	0.75	89.79
39.0-40.0	83.1	5.8	749.5	0.70	90.49
40.0-41.0	76.3	5.4	754.9	0.66	91.15
41.0-42.0	70.3	5.1	760.0	0.62	91.77
42.0-43.0	64.8	4.8	764.8	0.58	92.35
43.0-44.0	59.7	4.5	769.3	0.54	92.89
44.0-45.0	54.7	4.2	773.5	0.51	93.40
45.0-46.0	50.0	3.9	777.5	0.47	93.87
46.0-47.0	45.9	3.6	781.1	0.44	94.31
47.0-48.0	42.0	3.4	784.5	0.41	94.72
48.0-49.0	38.3	3.1	787.7	0.38	95.10
49.0-50.0	35.1	2.9	790.6	0.35	95.46
50.0-51.0	32.4	2.7	793.3	0.33	95.79
51.0-52.0	29.8	2.6	795.9	0.31	96.10
52.0-53.0	27.7	2.4	798.3	0.29	96.39
53.0-54.0	25.8	2.3	800.6	0.27	96.66
54.0-55.0	24.2	2.2	802.7	0.26	96.92
55.0-56.0	22.7	2.1	804.8	0.25	97.17
56.0-57.0	21.5	2.0	806.7	0.24	97.41
57.0-58.0	20.3	1.9	808.6	0.23	97.63
58.0-59.0	19.3	1.8	810.4	0.22	97.85
59.0-60.0	18.2	1.7	812.1	0.21	98.06
60.0-61.0	17.0	1.6	813.8	0.20	98.26
61.0-62.0	15.5	1.5	815.3	0.18	98.44
62.0-63.0	14.1	1.4	816.6	0.17	98.60
63.0-64.0	13.3	1.3	817.9	0.16	98.76
64.0-65.0	12.4	1.2	819.2	0.15	98.91
65.0-66.0	11.5	1.1	820.3	0.14	99.05
66.0-67.0	10.6	1.1	821.4	0.13	99.17
67.0-68.0	9.5	1.0	822.3	0.12	99.29
68.0-69.0	8.6	0.9	823.2	0.11	99.40
69.0-70.0	7.7	0.8	824.0	0.10	99.49
70.0-71.0	6.9	0.7	824.7	0.09	99.58
71.0-72.0	6.0	0.6	825.3	0.08	99.65

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	5.4	0.6	825.9	0.07	99.72
73.0-74.0	4.8	0.5	826.4	0.06	99.78
74.0-75.0	4.0	0.4	826.8	0.05	99.83
75.0-76.0	3.4	0.4	827.2	0.04	99.88
76.0-77.0	2.7	0.3	827.5	0.04	99.91
77.0-78.0	2.1	0.2	827.7	0.03	99.94
78.0-79.0	1.6	0.2	827.9	0.02	99.96
79.0-80.0	1.2	0.1	828.0	0.02	99.97
80.0-81.0	0.8	0.1	828.1	0.01	99.99
81.0-82.0	0.4	0.0	828.1	0.01	99.99
82.0-83.0	0.2	0.0	828.2	0.00	99.99
83.0-84.0	0.1	0.0	828.2	0.00	100.00
84.0-85.0	0.1	0.0	828.2	0.00	100.00
85.0-86.0	0.1	0.0	828.2	0.00	100.00
86.0-87.0	0.1	0.0	828.2	0.00	100.00
87.0-88.0	0.0	0.0	828.2	0.00	100.00
88.0-89.0	0.0	0.0	828.2	0.00	100.00
89.0-90.0	0.0	0.0	828.2	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3363.0	3363.0								
G1.0	3349.5	3333.1								
G2.0	3302.9	3291.1								
G3.0	3220.2	3187.8								
G4.0	3106.7	3075.6								
G5.0	2961.7	2908.7								
G6.0	2797.9	2729.4								
G7.0	2614.4	2531.7								
G8.0	2422.2	2326.9								
G9.0	2213.1	2108.9								
G10.0	1988.6	1886.1								
G11.0	1758.4	1667.8								
G12.0	1545.7	1453.2								
G13.0	1364.5	1245.3								
G14.0	1199.3	1064.5								
G15.0	1049.6	924.3								
G16.0	915.4	808.8								
G17.0	802.8	707.9								
G18.0	707.0	615.4								
G19.0	622.5	539.8								
G20.0	550.9	476.2								
G21.0	492.3	419.9								
G22.0	442.0	373.0								
G23.0	397.0	334.5								
G24.0	358.1	300.4								
G25.0	324.0	270.9								
G26.0	294.4	245.3								
G27.0	268.6	223.1								
G28.0	245.0	204.2								
G29.0	223.6	186.9								
G30.0	203.7	170.7								
G31.0	187.7	156.4								
G32.0	171.9	144.0								
G33.0	157.6	132.7								
G34.0	144.6	122.4								
G35.0	132.3	113.2								
G36.0	121.6	104.7								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	111.7	96.7								
G38.0	102.8	87.7								
G39.0	94.1	79.3								
G40.0	86.8	72.2								
G41.0	79.7	66.7								
G42.0	73.3	61.7								
G43.0	67.3	57.0								
G44.0	61.7	52.7								
G45.0	56.2	48.2								
G46.0	51.3	44.3								
G47.0	47.0	40.8								
G48.0	42.5	37.7								
G49.0	38.7	34.4								
G50.0	35.4	32.0								
G51.0	32.4	29.6								
G52.0	30.0	27.3								
G53.0	27.8	25.5								
G54.0	25.8	24.0								
G55.0	24.0	22.8								
G56.0	22.7	21.5								
G57.0	21.5	20.4								
G58.0	20.1	19.4								
G59.0	19.2	18.3								
G60.0	18.0	17.4								
G61.0	16.5	16.2								
G62.0	14.9	14.4								
G63.0	14.1	13.2								
G64.0	13.2	12.6								
G65.0	12.2	11.6								
G66.0	11.6	10.7								
G67.0	10.7	9.5								
G68.0	9.6	8.4								
G69.0	8.7	7.5								
G70.0	8.0	6.6								
G71.0	6.9	6.0								
G72.0	6.0	5.1								
G73.0	5.7	4.7								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	4.8	3.9								
G75.0	4.1	3.2								
G76.0	3.6	2.7								
G77.0	2.7	2.0								
G78.0	2.3	1.4								
G79.0	1.8	1.2								
G80.0	1.2	0.8								
G81.0	1.0	0.2								
G82.0	0.4	0.0								
G83.0	0.4	0.0								
G84.0	0.2	0.0								
G85.0	0.2	0.0								
G86.0	0.3	0.0								
G87.0	0.2	0.0								
G88.0	0.0	0.0								
G89.0	0.0	0.0								
G90.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: