中山雅大光电有限公司
www.artdon.cn
0760-22211886
0760-22211890

Report No.:

Test Time: 2026-09-11 16:18

Luminaire Property


Luminaire Manufacturer:
Luminaire Description: ADJ 62 60D
Luminous Length (mm): -55
Luminous Width (mm): -55
Voltage: 226.1 V
Current: 0.045 A
Power: 9.60 W
Power Factor: 0.929

Photometric Results

CIE Class: Direct
Total Rated Lamp Lumens: 868.2 lm
Measurement Flux: 868.2 lm
Efficiency: 100%
Downward Ratio: 100%
Upward Ratio: 0%
Horizontal Diffuse Angle(50%): H59.2
Vertical Diffuse Angle(50%): V59.2
Luminaire Efficacy Rating (LER): 90.49
Central Intensity: 896.94 cd
Max. Intensity: 896.95 cd
Pos of Max. Intensity: H0 V0
S/MH(C0/C180): 0.90
S/MH(C90/C270): 0.90


Picture Of Luminaire


Luminous Intensity Distribution Curve

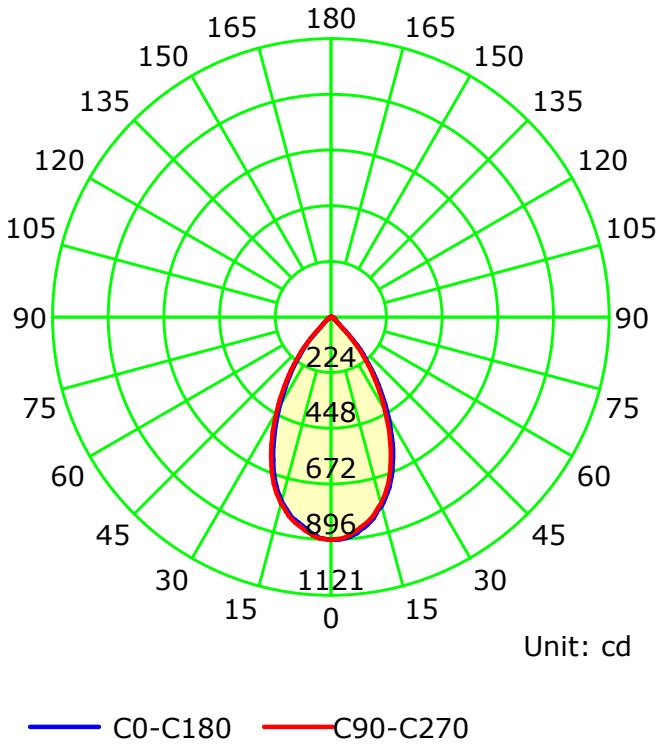

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Luminous Intensity Distribution Curve

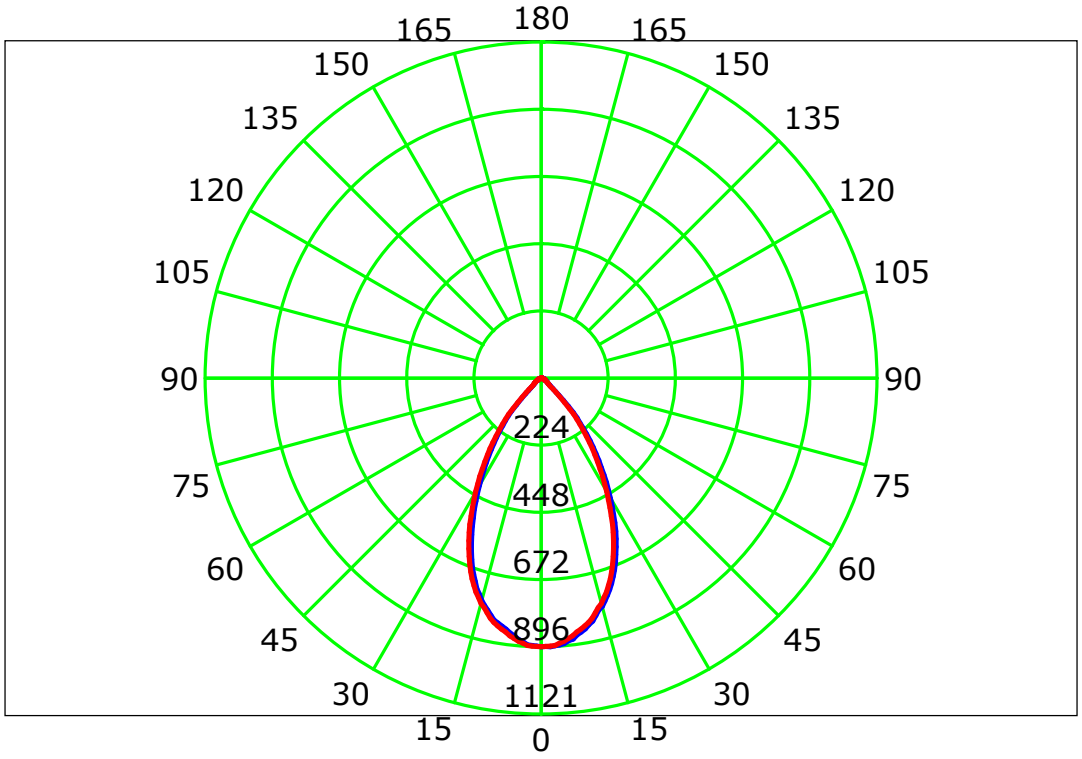


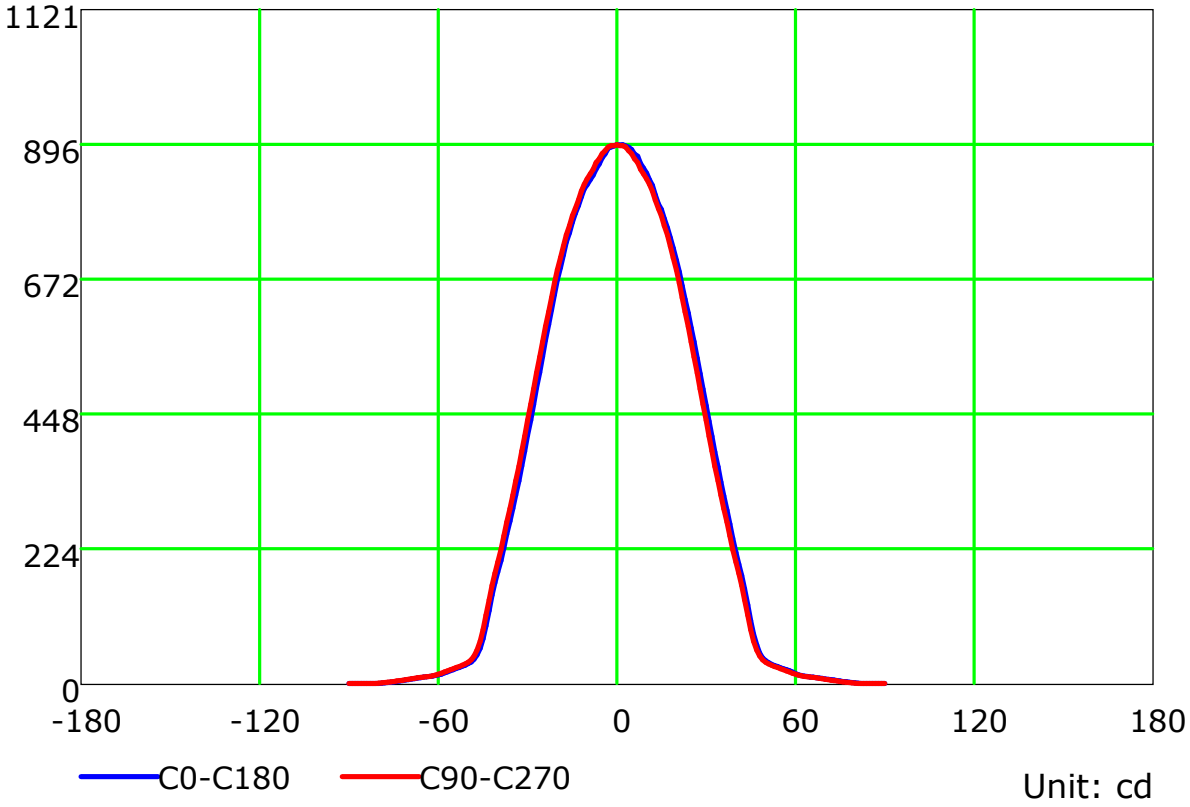

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

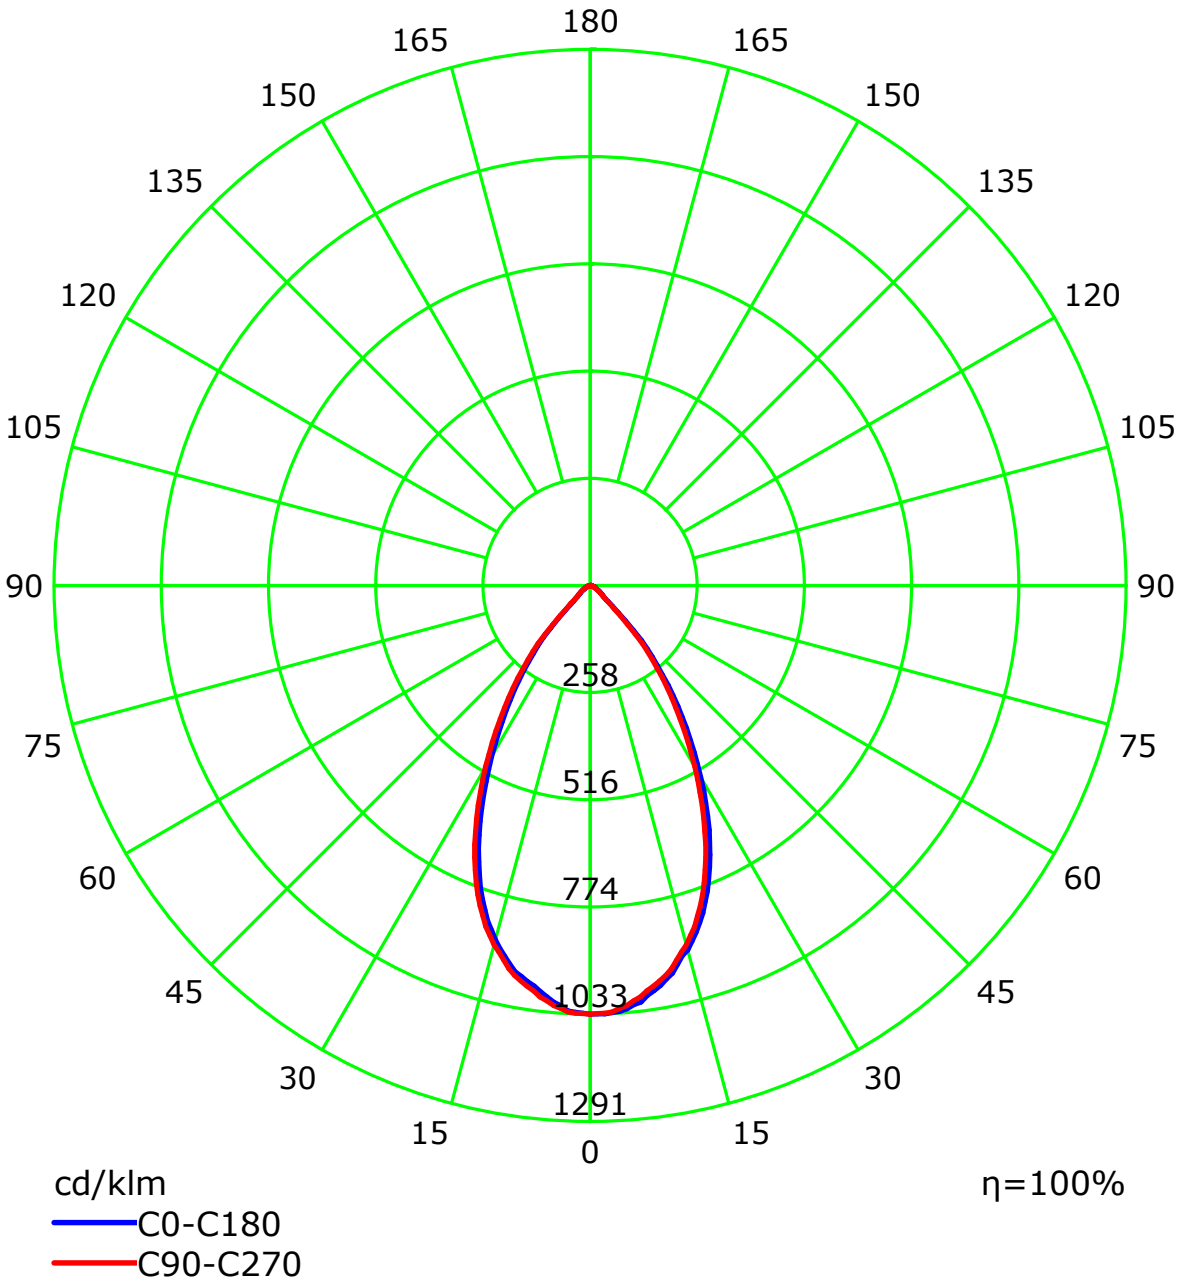

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

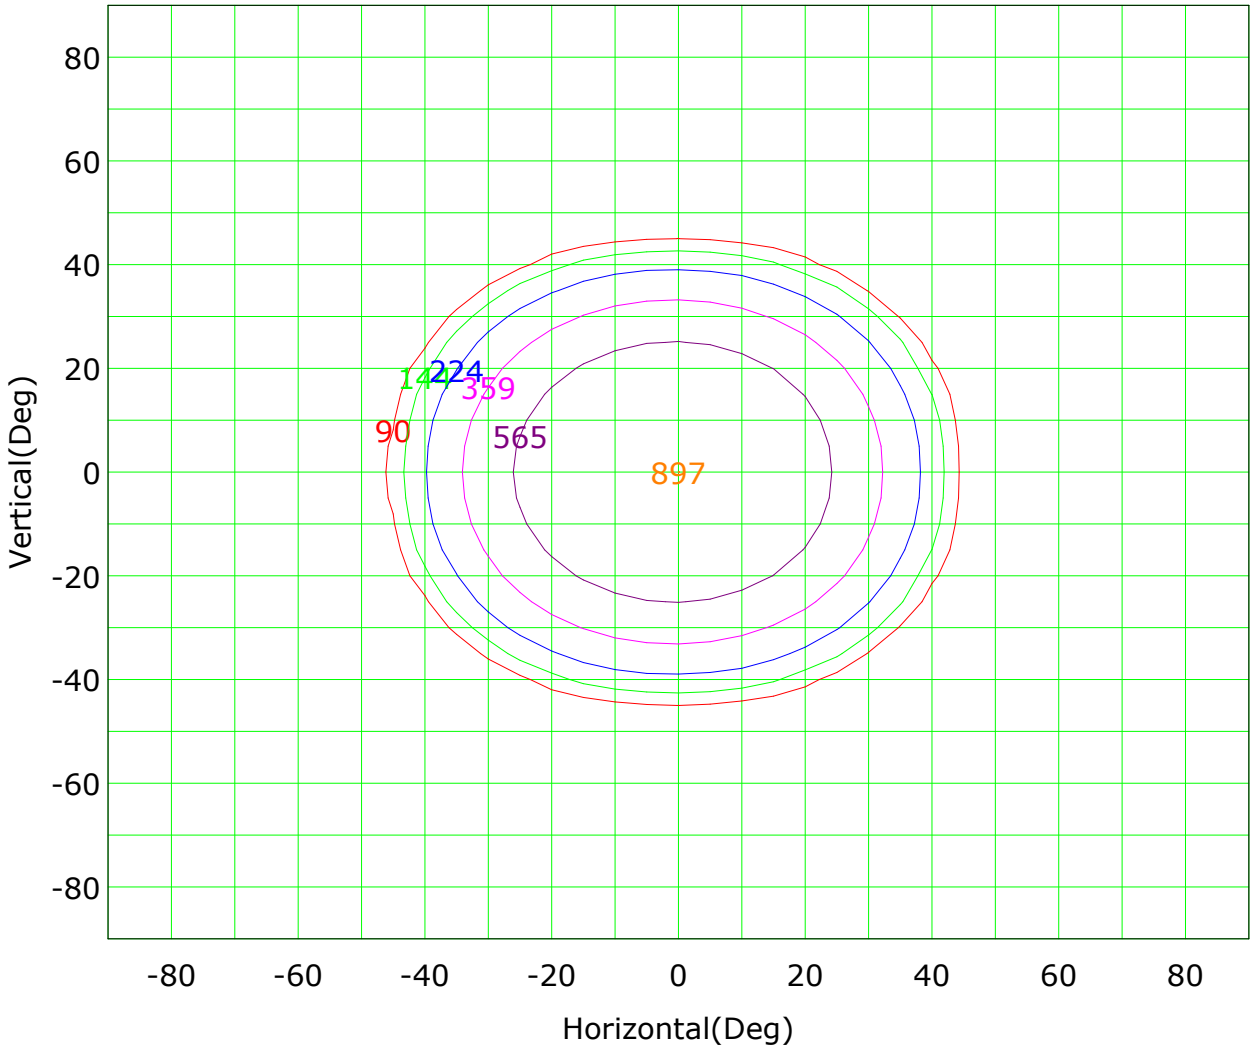


Imax (100%): 897 cd

(10%): 90 cd
(16%): 144 cd
(25%): 224 cd
(40%): 359 cd
(63%): 565 cd
(100%): 897 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

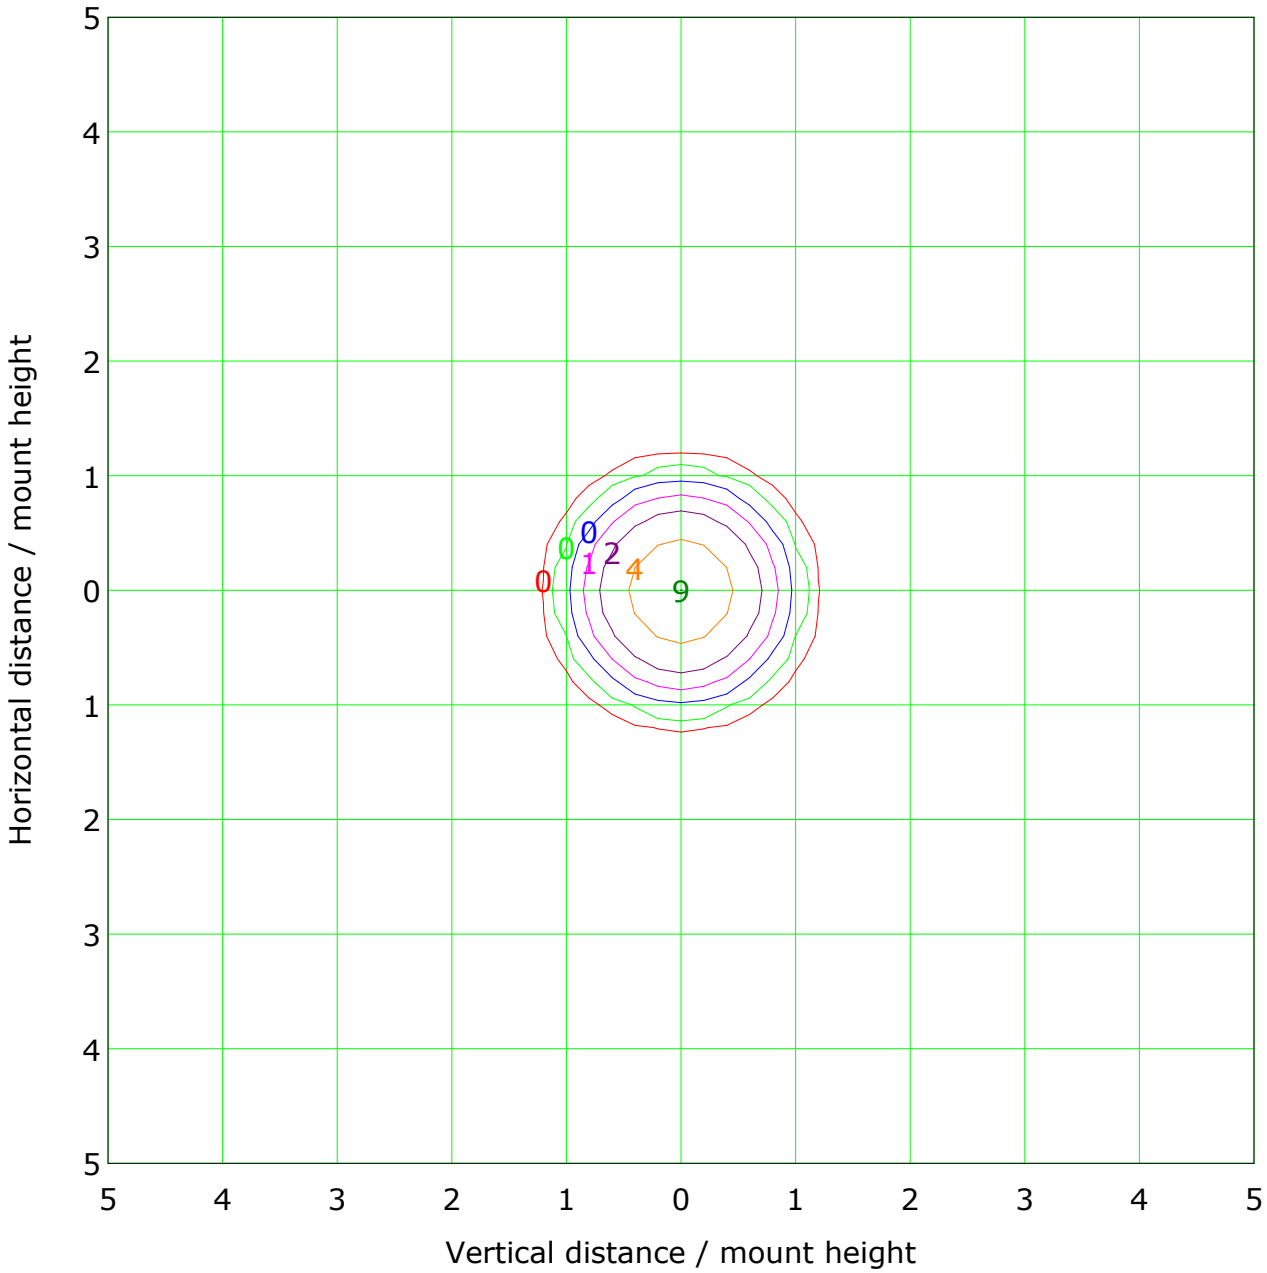


Mounting Height: 10.0m Max Lux(100%): 9.0 lx

(1%): 0.1 lx	(2%): 0.2 lx
(5%): 0.4 lx	(10%): 0.9 lx
(20%): 1.8 lx	(50%): 4.5 lx
(100%): 9.0 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Illuminance at a Distance

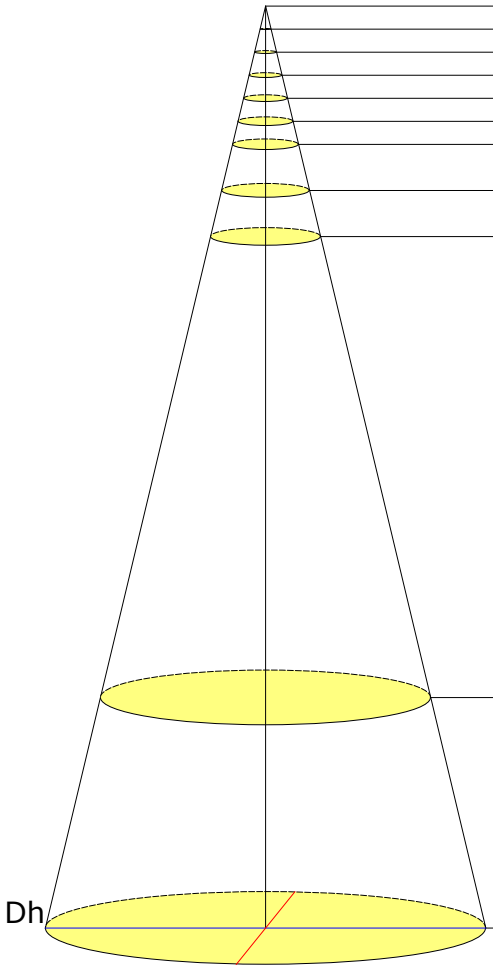


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	3587.76	0.57/0.57	0.3	1418.96
1.0	896.94	1.14/1.14	1.0	354.74
1.5	398.64	1.70/1.70	2.3	157.66
2.0	224.24	2.27/2.27	4.1	88.69
2.5	143.51	2.84/2.84	6.3	56.76
3.0	99.66	3.41/3.41	9.1	39.42
4.0	56.06	4.54/4.55	16.2	22.17
5.0	35.88	5.68/5.68	25.3	14.19
15.0	3.99	17.03/17.05	228.0	1.58
20.0	2.24	22.71/22.73	405.3	0.89

Beam Angle(B): H59.2 V59.2 Field Angle(F): H90.0 V90.0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

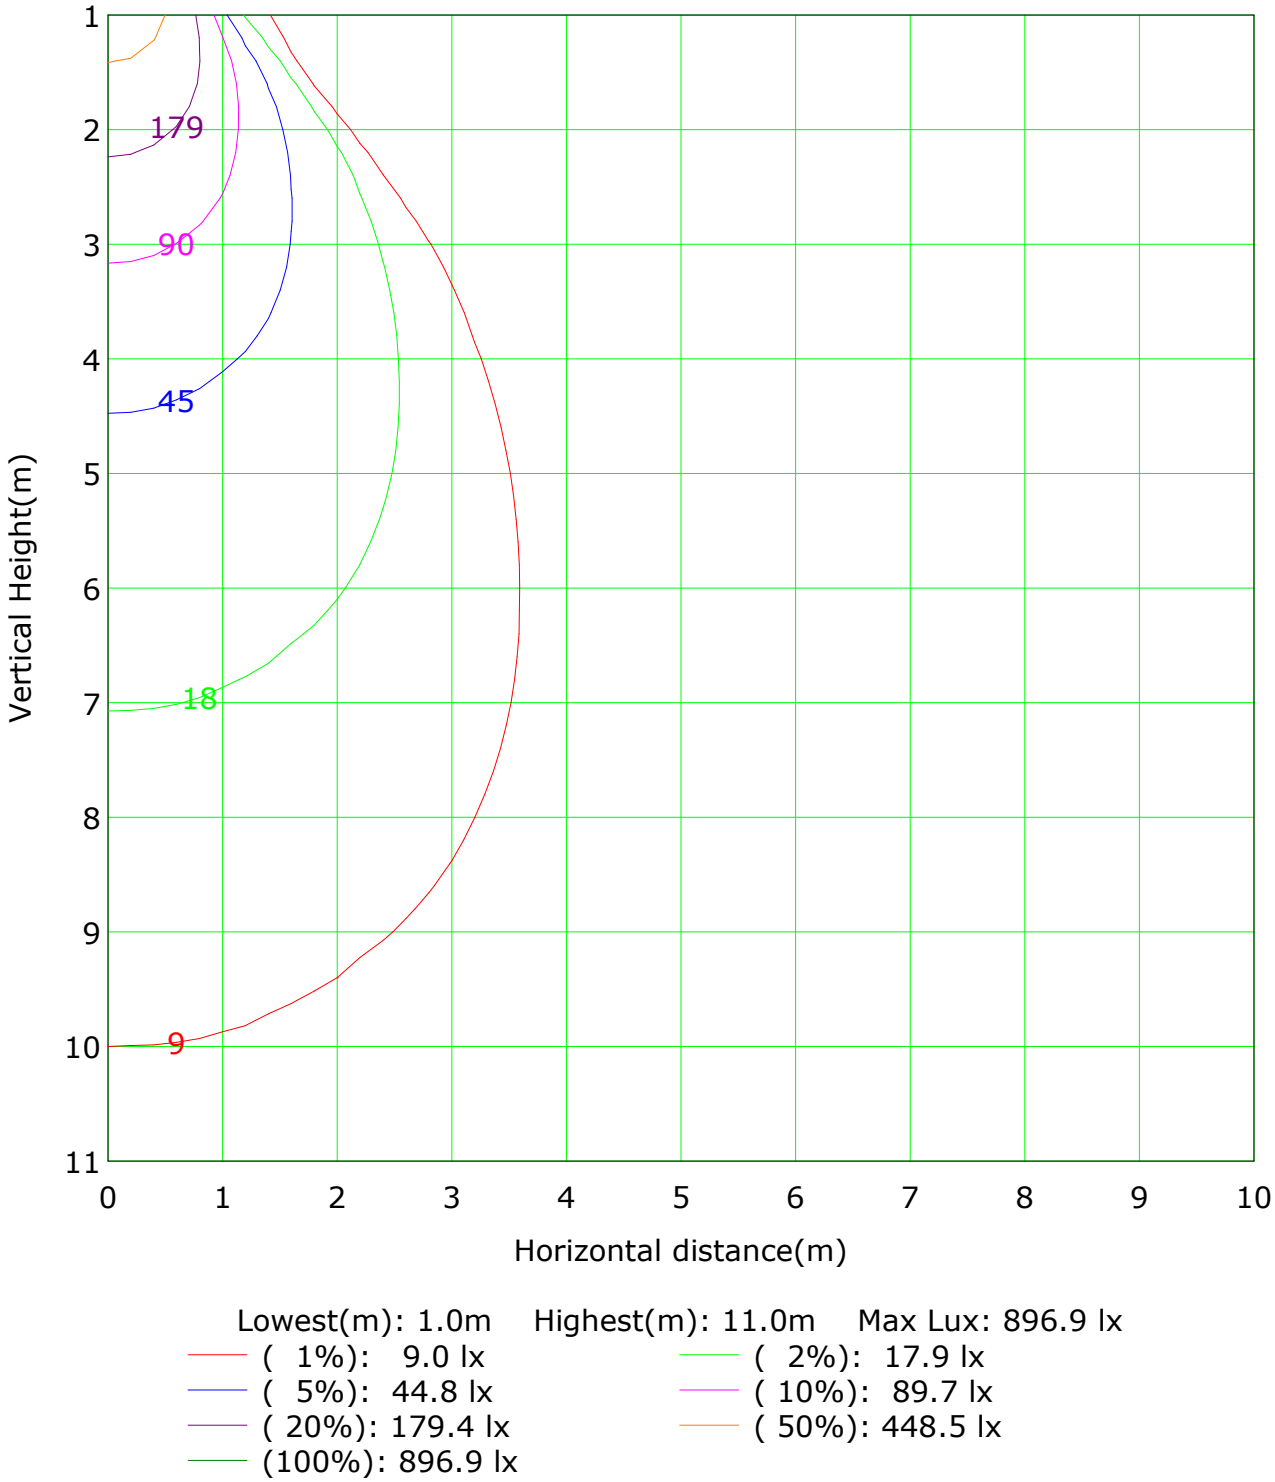

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 896.9 lx

(1%): 9.0 lx
(2%): 17.9 lx
(5%): 44.8 lx
(10%): 89.7 lx
(20%): 179.4 lx
(50%): 448.5 lx
(100%): 896.9 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Area Flux Table

Unit: lm


Horizontal plane	Vertical plane																							
	Flux(E)	Flux(T)	90	80	70	60	50	40	30	20	10	0	-10	-20	-30	-40	-50	-60	-70	-80	-90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
-80	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
-70	0.0	1.2	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0		
-60	0.0	3.3	0.0	0.0	0.0	0.0	0.1	0.2	0.2	0.3	0.4	0.4	0.4	0.4	0.3	0.2	0.2	0.1	0.0	0.0	0.0		
-50	3.7	10.7	0.0	0.0	0.1	0.2	0.3	0.5	0.8	1.4	1.9	1.9	1.4	0.8	0.5	0.3	0.2	0.1	0.0	0.0	0.0		
-40	33.6	38.8	0.0	0.0	0.2	0.3	0.6	1.4	3.7	6.0	7.2	7.2	6.0	3.7	1.4	0.6	0.3	0.2	0.0	0.0	0.0		
-30	78.7	83.1	0.0	0.1	0.2	0.5	1.1	4.1	8.5	12.4	14.7	14.7	12.4	8.5	4.1	1.1	0.5	0.2	0.1	0.0	0.0		
-20	125.2	129.3	0.0	0.1	0.3	0.6	2.0	7.3	13.4	19.0	22.0	22.0	19.0	13.4	7.3	2.0	0.6	0.3	0.1	0.0	0.0		
-10	153.2	157.4	0.0	0.1	0.3	0.7	2.9	9.2	16.6	22.9	25.9	25.9	22.9	16.6	9.2	2.9	0.7	0.3	0.1	0.0	0.0		
0	154.8	158.9	0.0	0.1	0.3	0.8	3.0	9.3	16.8	23.0	26.1	26.1	23.0	16.8	9.3	3.0	0.8	0.3	0.1	0.0	0.0		
10	129.4	133.6	0.0	0.1	0.3	0.7	2.2	7.6	13.9	19.5	22.5	22.5	19.5	13.9	7.6	2.2	0.7	0.3	0.1	0.0	0.0		
20	85.1	89.5	0.0	0.1	0.3	0.5	1.2	4.5	9.1	13.3	15.8	15.8	13.3	9.1	4.5	1.2	0.5	0.3	0.1	0.0	0.0		
30	39.0	43.9	0.0	0.1	0.2	0.4	0.7	1.6	4.2	6.7	8.2	8.2	6.7	4.2	1.6	0.7	0.4	0.2	0.1	0.0	0.0		
40	5.9	12.8	0.0	0.0	0.1	0.2	0.4	0.6	0.9	1.7	2.4	2.4	1.7	0.9	0.6	0.4	0.2	0.1	0.0	0.0	0.0		
50	0.0	3.7	0.0	0.0	0.1	0.1	0.2	0.3	0.3	0.4	0.5	0.5	0.4	0.3	0.3	0.2	0.1	0.1	0.0	0.0	0.0		
60	0.0	1.3	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0		
70	0.0	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
90		868	0.1	0.8	2.5	5.3	14.8	46.8	88.9	127.0	147.9	147.9	127.0	88.9	46.8	14.8	5.3	2.5	0.8	0.1	0.0		
Flux(T)	809		0.0	0.0	0.0	0.0	6.4	42.4	85.7	124.3	145.5	145.5	124.3	85.7	42.4	6.4	0.0	0.0	0.0	0.0	0.0		
Flux(E)																							

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

Flux Out: 548.27lm

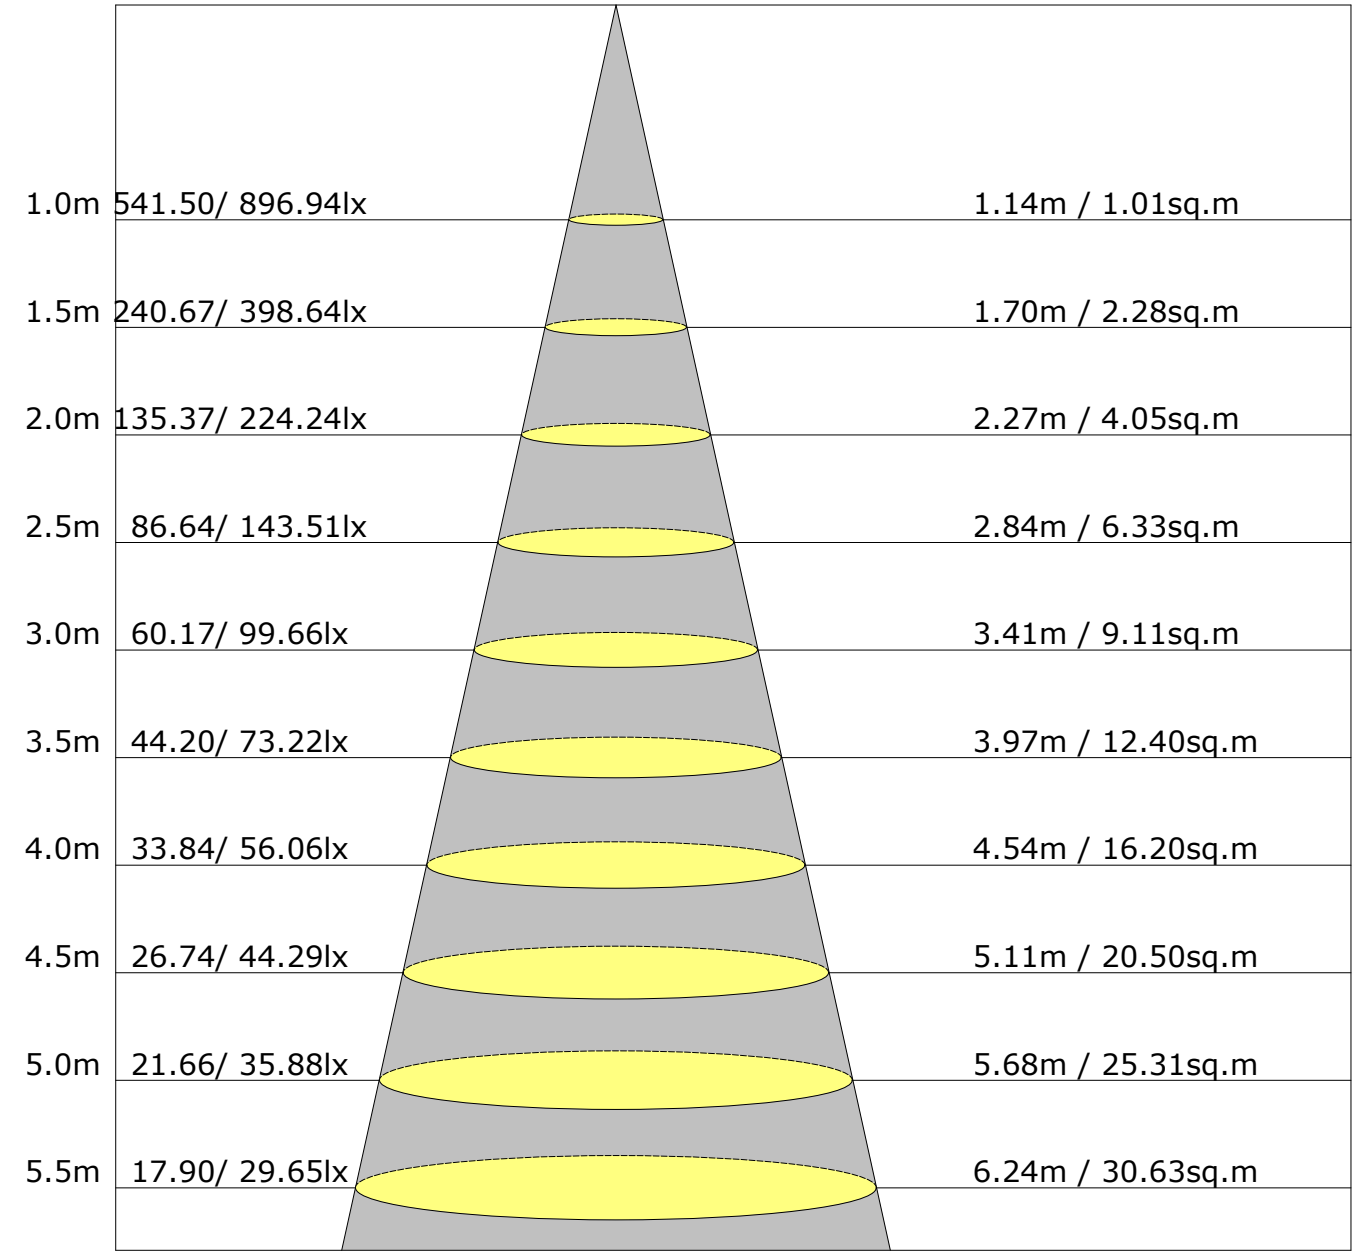

Height Avg./Nadir. E Beam Angle:59.2° Diameter / Area

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	22.8	23.7	23.1	23.9	24.2	22.5	23.4	22.8	23.6	23.9
3H	22.8	23.6	23.1	23.9	24.1	22.5	23.3	22.8	23.6	23.8
4H	22.8	23.6	23.1	23.8	24.1	22.5	23.2	22.8	23.5	23.8
6H	22.7	23.4	23.1	23.7	24.0	22.4	23.1	22.7	23.4	23.7
8H	22.7	23.4	23.0	23.7	24.0	22.4	23.1	22.7	23.4	23.7
12H	22.6	23.3	23.0	23.6	23.9	22.3	23.0	22.7	23.3	23.6
X=4H Y=2H	22.7	23.5	23.0	23.7	24.0	22.4	23.2	22.7	23.4	23.7
3H	22.7	23.4	23.1	23.7	24.0	22.4	23.1	22.8	23.4	23.7
4H	22.7	23.3	23.1	23.6	24.0	22.4	23.0	22.8	23.3	23.7
6H	22.7	23.2	23.1	23.5	23.9	22.3	22.9	22.8	23.2	23.6
8H	22.6	23.1	23.0	23.5	23.9	22.3	22.8	22.7	23.2	23.6
12H	22.6	23.0	23.0	23.4	23.8	22.3	22.7	22.7	23.1	23.5
X=8H Y=4H	22.6	23.1	23.0	23.5	23.9	22.3	22.8	22.7	23.2	23.6
6H	22.6	22.9	23.0	23.4	23.8	22.3	22.6	22.7	23.1	23.5
8H	22.5	22.9	23.0	23.3	23.8	22.2	22.6	22.7	23.0	23.5
12H	22.5	22.8	23.0	23.2	23.7	22.2	22.5	22.7	22.9	23.4
X=12H Y=4H	22.6	23.0	23.0	23.4	23.8	22.3	22.7	22.7	23.1	23.5
6H	22.5	22.9	23.0	23.3	23.8	22.2	22.6	22.7	23.0	23.5
8H	22.5	22.8	23.0	23.2	23.7	22.2	22.5	22.7	22.9	23.4
Variations with the observer position at spacings:										
S=1.0H	+3.0/-5.1					+3.0/-5.1				
S=1.5H	+5.6/-6.5					+5.6/-6.5				
S=2.0H	+7.5/-7.0					+7.5/-7.0				

Calculate in accordance with CIE Pub.117. The table is revised with 868lm (8log(F/F0) = -0.5).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

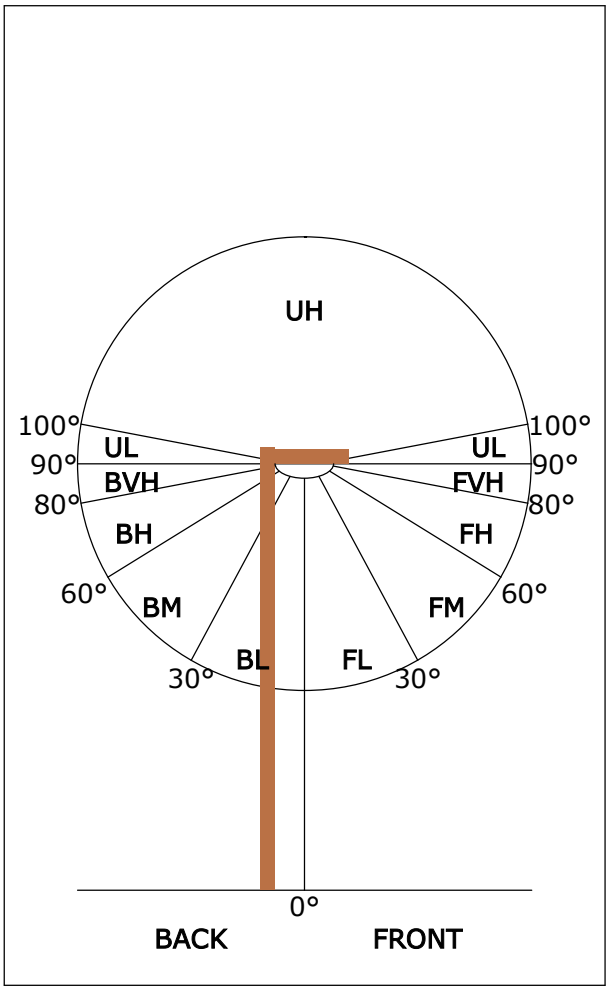

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	444	51.2
FL (0°-30°)	283	32.6
FM (30°-60°)	153	17.7
FH (60°-80°)	8	0.9
FVH (80°-90°)	0	0.0
BACK LIGHT	424	48.8
BL (0°-30°)	275	31.7
BM (30°-60°)	141	16.3
BH (60°-80°)	7	0.8
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(**B**acklight,**U**plight,**G**lare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	896.1	0.9	0.9	0.10	0.10
1.0-2.0	895.1	2.6	3.4	0.30	0.39
2.0-3.0	893.9	4.3	7.7	0.49	0.89
3.0-4.0	889.8	6.0	13.7	0.69	1.57
4.0-5.0	884.3	7.6	21.3	0.88	2.45
5.0-6.0	877.4	9.2	30.5	1.06	3.51
6.0-7.0	870.0	10.8	41.3	1.24	4.76
7.0-8.0	861.4	12.3	53.6	1.42	6.18
8.0-9.0	852.1	13.8	67.4	1.59	7.77
9.0-10.0	844.1	15.3	82.7	1.76	9.53
10.0-11.0	835.3	16.7	99.4	1.92	11.45
11.0-12.0	825.0	18.0	117.4	2.08	13.53
12.0-13.0	811.8	19.3	136.7	2.22	15.75
13.0-14.0	797.2	20.4	157.1	2.35	18.10
14.0-15.0	784.2	21.5	178.6	2.48	20.58
15.0-16.0	770.1	22.6	201.2	2.60	23.17
16.0-17.0	754.2	23.5	224.7	2.71	25.88
17.0-18.0	737.0	24.3	249.0	2.80	28.68
18.0-19.0	718.2	25.0	274.0	2.88	31.56
19.0-20.0	698.5	25.6	299.6	2.94	34.50
20.0-21.0	677.3	26.0	325.6	3.00	37.50
21.0-22.0	654.3	26.3	351.9	3.03	40.53
22.0-23.0	630.5	26.5	378.3	3.05	43.57
23.0-24.0	606.5	26.5	404.9	3.05	46.63
24.0-25.0	581.3	26.4	431.3	3.04	49.67
25.0-26.0	556.0	26.2	457.5	3.02	52.70
26.0-27.0	530.1	25.9	483.5	2.99	55.68
27.0-28.0	503.5	25.5	509.0	2.94	58.62
28.0-29.0	477.4	25.0	534.0	2.88	61.50
29.0-30.0	451.3	24.4	558.3	2.81	64.31
30.0-31.0	424.8	23.6	582.0	2.72	67.03
31.0-32.0	399.2	22.9	604.8	2.63	69.66
32.0-33.0	374.3	22.1	626.9	2.54	72.20
33.0-34.0	349.5	21.2	648.0	2.44	74.64
34.0-35.0	325.4	20.2	668.3	2.33	76.97
35.0-36.0	302.3	19.3	687.5	2.22	79.18

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	280.0	18.3	705.8	2.10	81.29
37.0-38.0	257.3	17.2	723.0	1.98	83.27
38.0-39.0	234.5	16.0	739.0	1.84	85.11
39.0-40.0	212.6	14.8	753.8	1.71	86.82
40.0-41.0	192.7	13.7	767.5	1.58	88.40
41.0-42.0	173.4	12.6	780.1	1.45	89.85
42.0-43.0	151.4	11.2	791.3	1.29	91.14
43.0-44.0	126.5	9.5	800.9	1.10	92.24
44.0-45.0	101.8	7.8	808.7	0.90	93.14
45.0-46.0	80.3	6.3	815.0	0.72	93.87
46.0-47.0	63.3	5.0	820.0	0.58	94.45
47.0-48.0	50.9	4.1	824.1	0.47	94.92
48.0-49.0	42.7	3.5	827.6	0.40	95.32
49.0-50.0	37.6	3.1	830.8	0.36	95.68
50.0-51.0	34.2	2.9	833.7	0.33	96.02
51.0-52.0	31.7	2.7	836.4	0.31	96.33
52.0-53.0	29.5	2.6	839.0	0.30	96.63
53.0-54.0	27.6	2.4	841.4	0.28	96.91
54.0-55.0	25.8	2.3	843.7	0.27	97.17
55.0-56.0	24.1	2.2	845.9	0.25	97.42
56.0-57.0	22.2	2.0	847.9	0.23	97.66
57.0-58.0	20.4	1.9	849.8	0.22	97.87
58.0-59.0	18.6	1.7	851.5	0.20	98.08
59.0-60.0	16.6	1.6	853.1	0.18	98.26
60.0-61.0	14.9	1.4	854.5	0.16	98.42
61.0-62.0	13.6	1.3	855.8	0.15	98.57
62.0-63.0	12.7	1.2	857.1	0.14	98.71
63.0-64.0	11.9	1.2	858.2	0.13	98.85
64.0-65.0	11.2	1.1	859.3	0.13	98.97
65.0-66.0	10.6	1.1	860.4	0.12	99.10
66.0-67.0	10.1	1.0	861.4	0.12	99.21
67.0-68.0	9.3	0.9	862.3	0.11	99.32
68.0-69.0	8.5	0.9	863.2	0.10	99.42
69.0-70.0	7.7	0.8	864.0	0.09	99.51
70.0-71.0	6.9	0.7	864.7	0.08	99.59
71.0-72.0	6.2	0.6	865.4	0.07	99.67

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	5.5	0.6	865.9	0.07	99.74
73.0-74.0	4.8	0.5	866.4	0.06	99.79
74.0-75.0	4.0	0.4	866.9	0.05	99.84
75.0-76.0	3.3	0.4	867.2	0.04	99.88
76.0-77.0	2.8	0.3	867.5	0.03	99.92
77.0-78.0	2.2	0.2	867.8	0.03	99.94
78.0-79.0	1.5	0.2	867.9	0.02	99.96
79.0-80.0	0.9	0.1	868.0	0.01	99.97
80.0-81.0	0.6	0.1	868.1	0.01	99.98
81.0-82.0	0.4	0.0	868.1	0.00	99.99
82.0-83.0	0.3	0.0	868.1	0.00	99.99
83.0-84.0	0.2	0.0	868.2	0.00	99.99
84.0-85.0	0.2	0.0	868.2	0.00	99.99
85.0-86.0	0.1	0.0	868.2	0.00	100.00
86.0-87.0	0.1	0.0	868.2	0.00	100.00
87.0-88.0	0.1	0.0	868.2	0.00	100.00
88.0-89.0	0.1	0.0	868.2	0.00	100.00
89.0-90.0	0.0	0.0	868.2	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	896.9	896.9								
G1.0	895.9	894.7								
G2.0	896.5	893.2								
G3.0	894.7	891.1								
G4.0	892.6	881.0								
G5.0	888.7	874.9								
G6.0	881.2	865.0								
G7.0	877.4	856.4								
G8.0	865.4	846.2								
G9.0	857.9	838.8								
G10.0	849.5	830.3								
G11.0	838.1	823.4								
G12.0	828.8	809.7								
G13.0	813.0	795.6								
G14.0	797.7	782.4								
G15.0	789.0	767.7								
G16.0	773.8	750.1								
G17.0	758.1	734.8								
G18.0	741.7	713.6								
G19.0	724.7	692.9								
G20.0	704.5	671.9								
G21.0	685.2	647.5								
G22.0	662.0	622.5								
G23.0	639.5	598.0								
G24.0	616.6	571.7								
G25.0	592.2	544.9								
G26.0	569.0	518.0								
G27.0	541.4	492.2								
G28.0	515.9	464.7								
G29.0	490.4	438.9								
G30.0	462.7	413.3								
G31.0	436.3	386.8								
G32.0	411.5	362.3								
G33.0	385.6	337.7								
G34.0	360.6	313.9								
G35.0	335.4	291.6								
G36.0	312.3	270.1								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	288.6	248.9								
G38.0	265.6	226.3								
G39.0	241.4	204.6								
G40.0	218.0	186.2								
G41.0	198.5	168.2								
G42.0	179.6	147.4								
G43.0	157.2	121.5								
G44.0	130.9	96.4								
G45.0	104.7	75.1								
G46.0	82.4	58.8								
G47.0	64.3	47.6								
G48.0	50.9	40.8								
G49.0	43.1	36.0								
G50.0	38.1	33.2								
G51.0	34.8	30.8								
G52.0	32.4	28.8								
G53.0	30.2	26.7								
G54.0	28.2	25.2								
G55.0	26.4	23.4								
G56.0	24.9	21.5								
G57.0	23.1	19.4								
G58.0	21.5	17.7								
G59.0	19.2	15.9								
G60.0	16.8	14.4								
G61.0	14.7	13.5								
G62.0	13.5	12.8								
G63.0	12.5	12.0								
G64.0	11.9	11.3								
G65.0	11.0	10.7								
G66.0	10.7	10.1								
G67.0	10.1	9.5								
G68.0	9.5	8.4								
G69.0	8.6	7.5								
G70.0	8.0	6.6								
G71.0	7.4	5.9								
G72.0	6.6	5.1								
G73.0	5.9	4.5								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	5.1	3.6								
G75.0	4.3	3.0								
G76.0	3.6	2.4								
G77.0	3.3	1.8								
G78.0	2.4	1.2								
G79.0	1.6	0.8								
G80.0	1.2	0.2								
G81.0	0.8	0.2								
G82.0	0.4	0.2								
G83.0	0.4	0.2								
G84.0	0.2	0.2								
G85.0	0.4	0.0								
G86.0	0.2	0.0								
G87.0	0.2	0.0								
G88.0	0.3	0.0								
G89.0	0.0	0.0								
G90.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: