中山雅大光电有限公司
www.artdon.cn
0760-22211886
0760-22211890

Report No.:

Test Time: 2026-09-11 16:08

Luminaire Property

Luminaire Manufacturer:
Luminaire Description: ADJ 84 36D
Luminous Width (mm): -80
Current: 0.075 A
Power Factor: 0.967

Luminous Length (mm): -80
Voltage: 226.5 V
Power: 16.40 W

Photometric Results


CIE Class: Direct
Measurement Flux: 1228.9 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(50%): H31.1
Vertical Diffuse Angle(50%): V31.1
Luminaire Efficacy Rating (LER): 74.98
Max. Intensity: 3543.31 cd
S/MH(C0/C180): 0.53

Total Rated Lamp Lumens: 1228.9 lm
Efficiency: 100%
Upward Ratio: 0%

Central Intensity: 3478.44 cd
Pos of Max. Intensity: H0 V2
S/MH(C90/C270): 0.53

Picture Of Luminaire


Luminous Intensity Distribution Curve

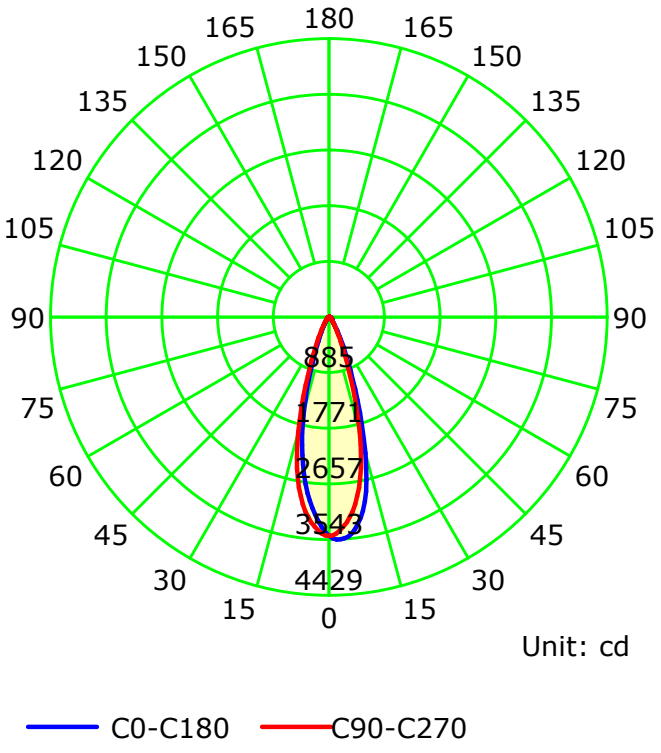


C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve

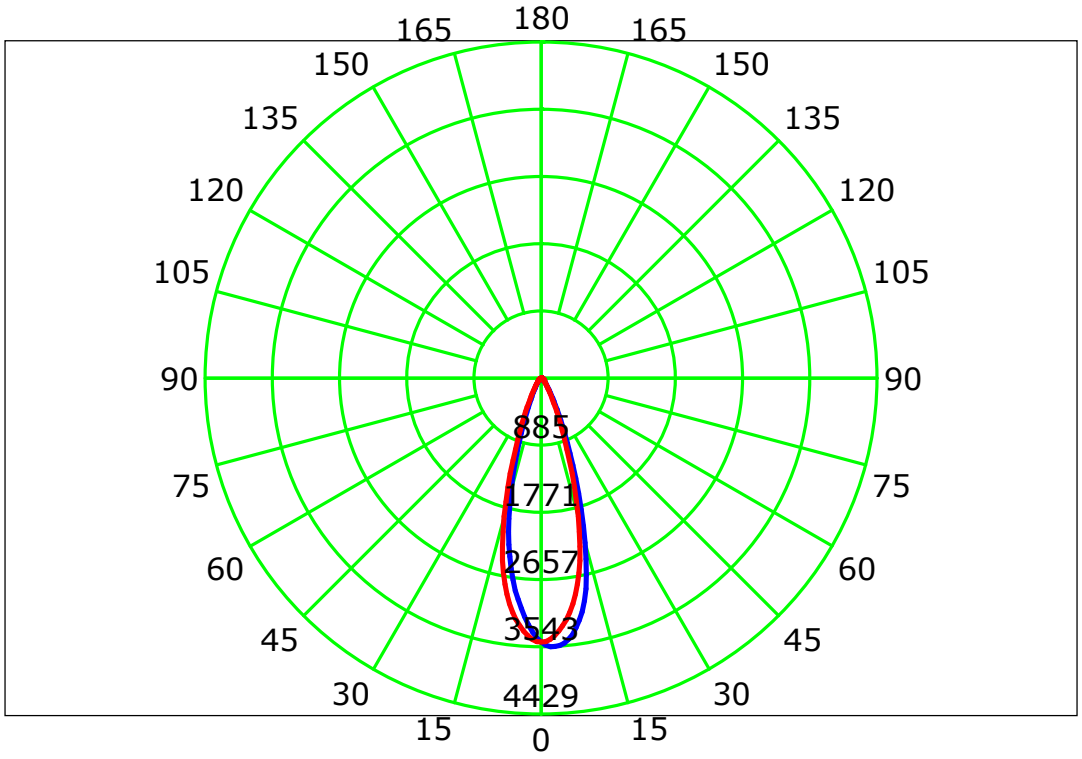


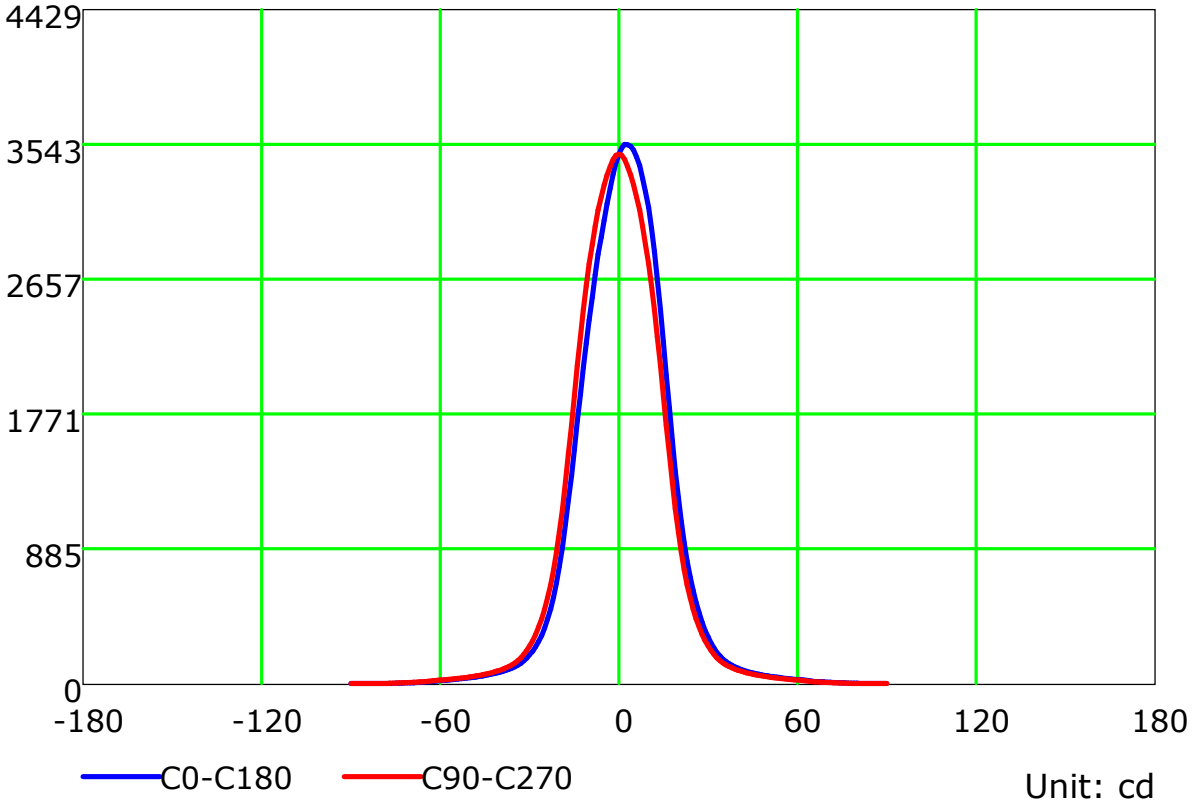

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

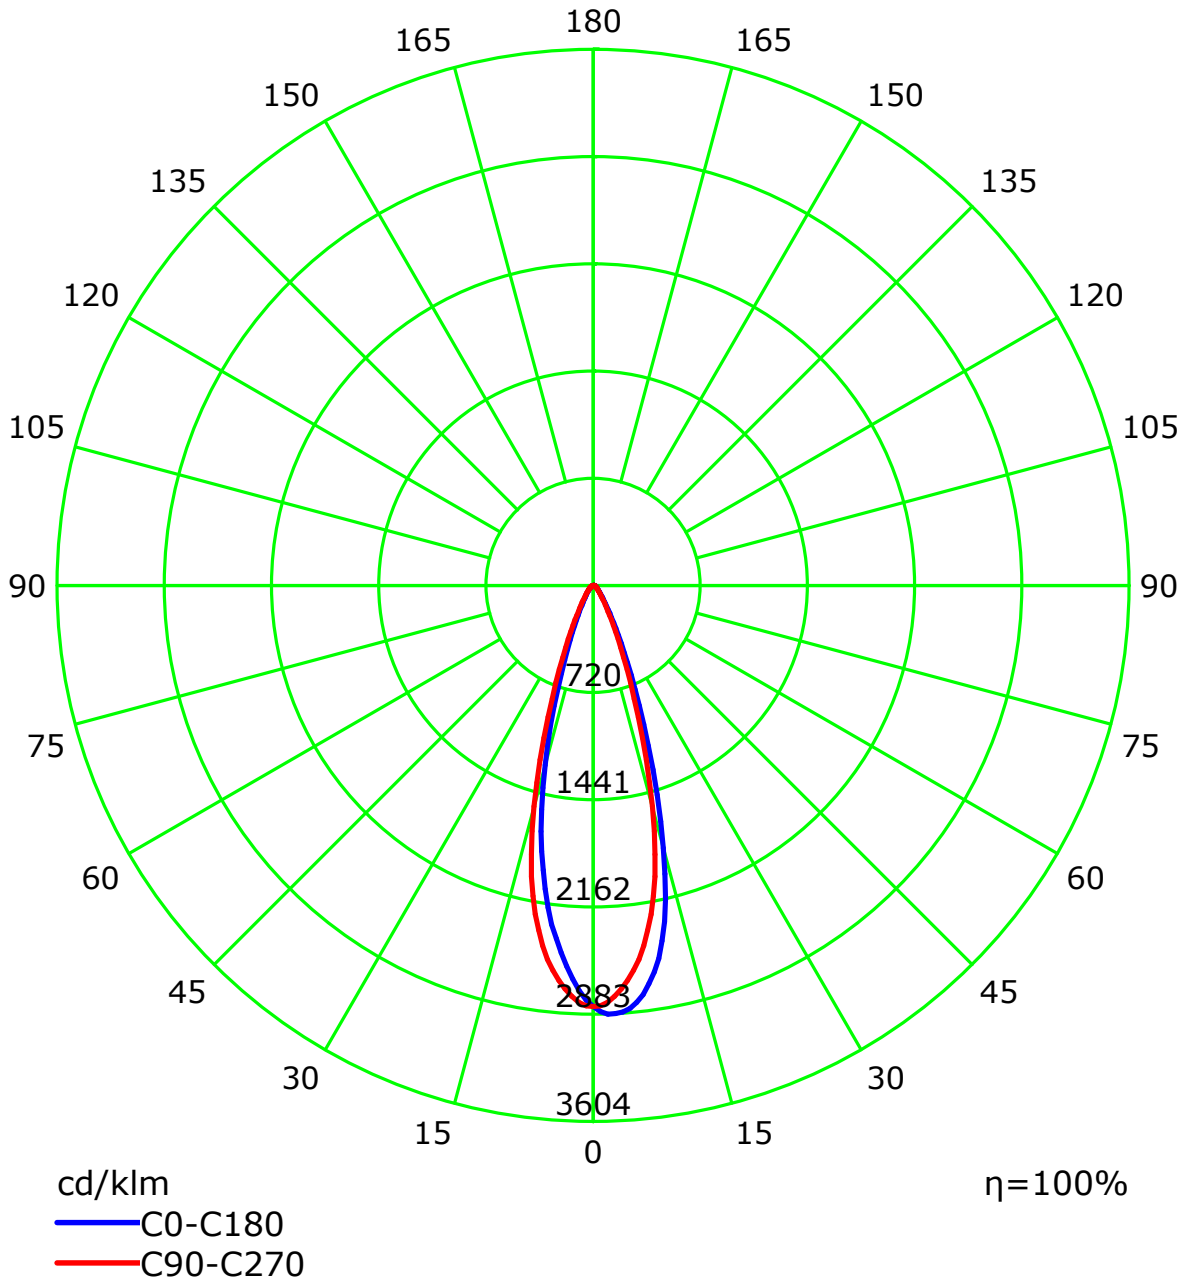

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

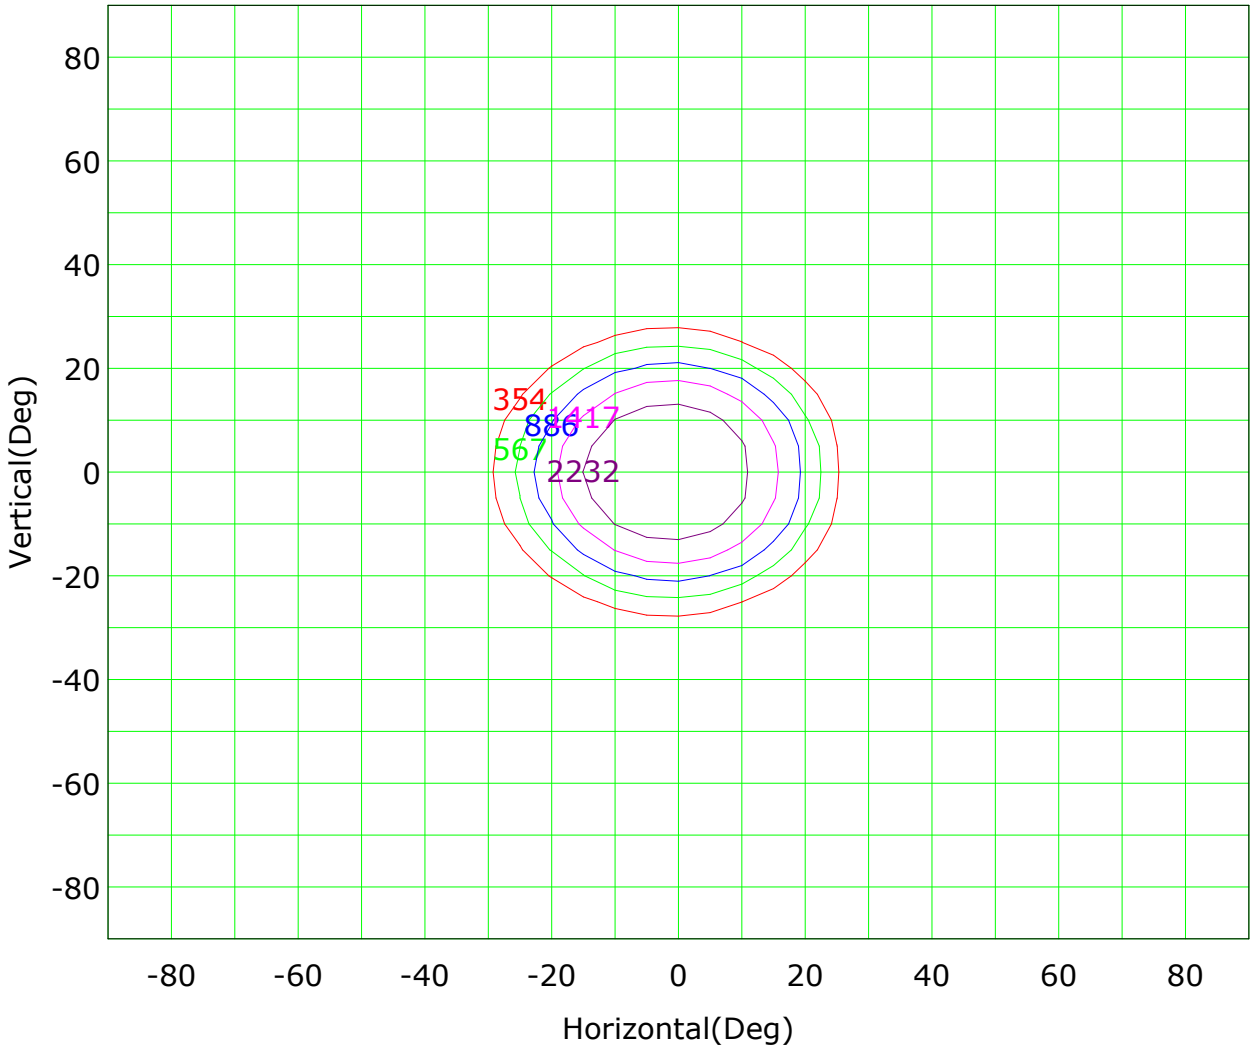


Imax (100%): 3543 cd

(10%): 354 cd
(16%): 567 cd
(25%): 886 cd
(40%): 1417 cd
(63%): 2232 cd
(100%): 3543 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

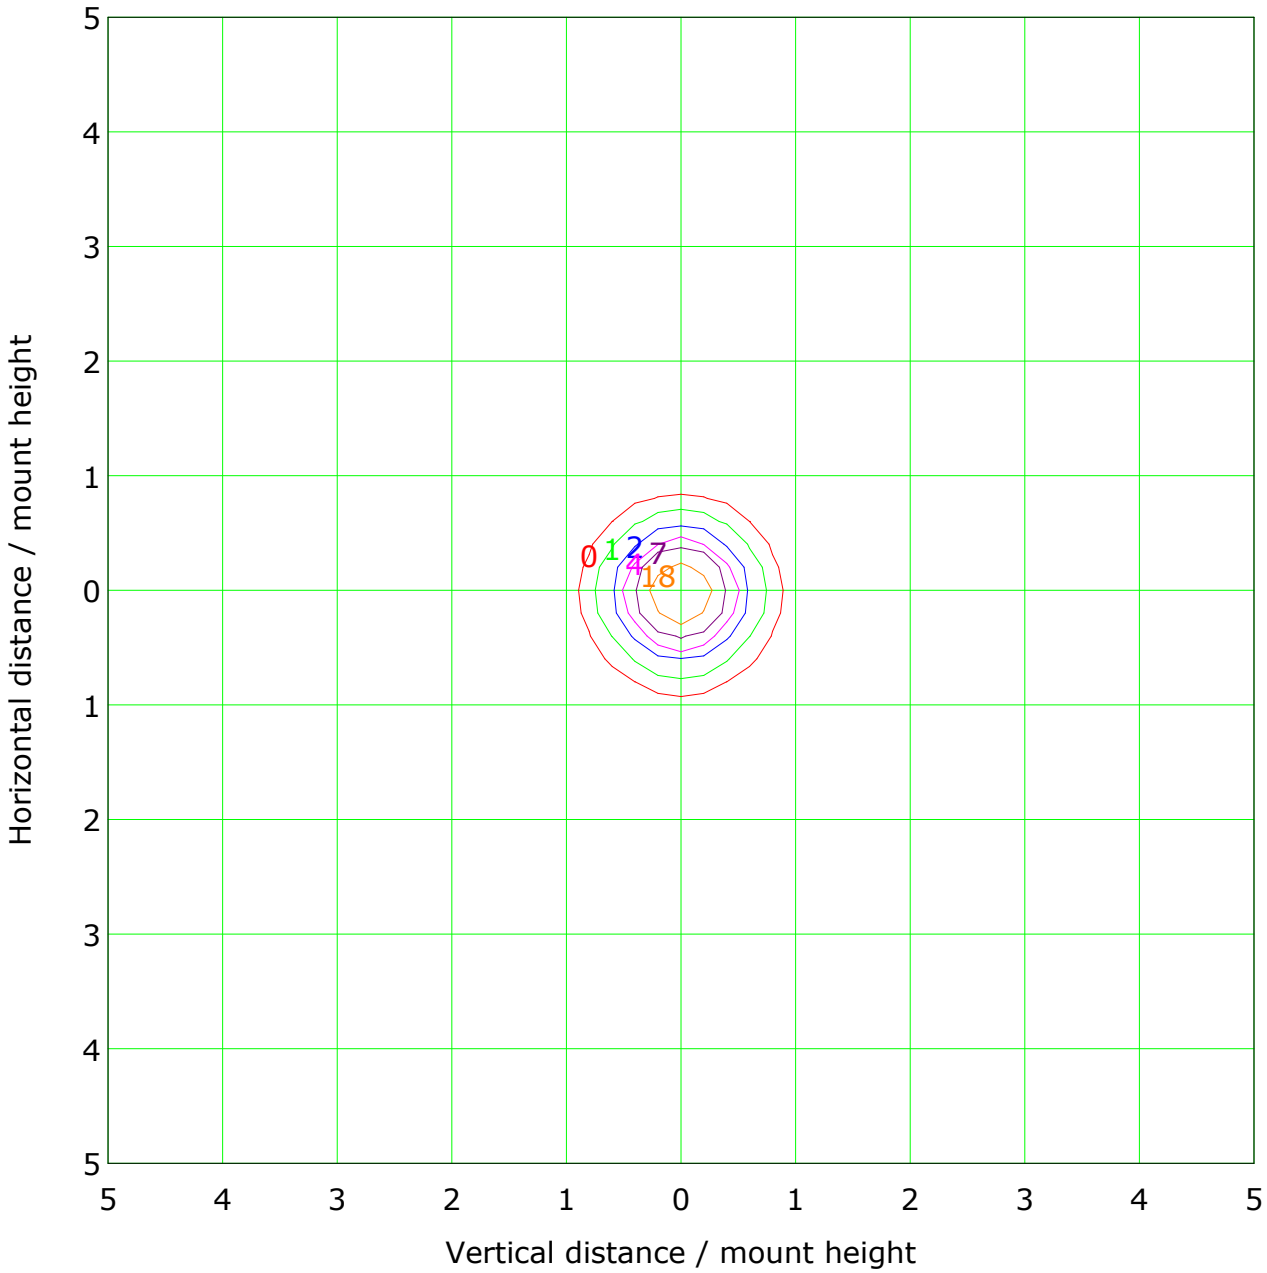


Mounting Height: 10.0m Max Lux(100%): 35.4 lx

(1%): 0.4 lx
(2%): 0.7 lx
(5%): 1.8 lx
(10%): 3.5 lx
(20%): 7.1 lx
(50%): 17.7 lx
(100%): 35.4 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Illuminance at a Distance

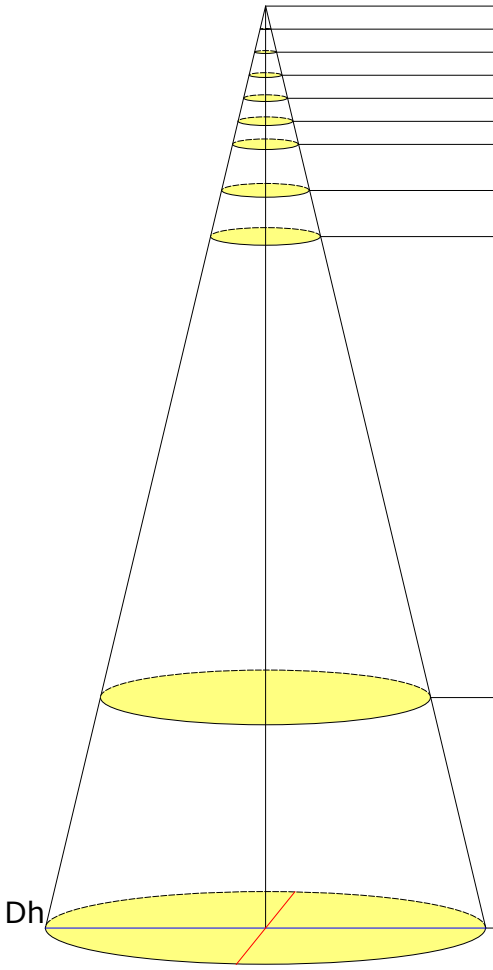


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	13913.76	0.28/0.28	0.1	6667.11
1.0	3478.44	0.55/0.57	0.2	1666.78
1.5	1545.97	0.83/0.85	0.5	740.79
2.0	869.61	1.11/1.13	1.0	416.69
2.5	556.55	1.38/1.41	1.5	266.68
3.0	386.49	1.66/1.70	2.2	185.20
4.0	217.40	2.21/2.26	3.9	104.17
5.0	139.14	2.77/2.83	6.1	66.67
15.0	15.46	8.30/8.48	54.8	7.41
20.0	8.70	11.06/11.30	97.5	4.17

Beam Angle(B): H30.9 V31.6 Field Angle(F): H54.2 V55.0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

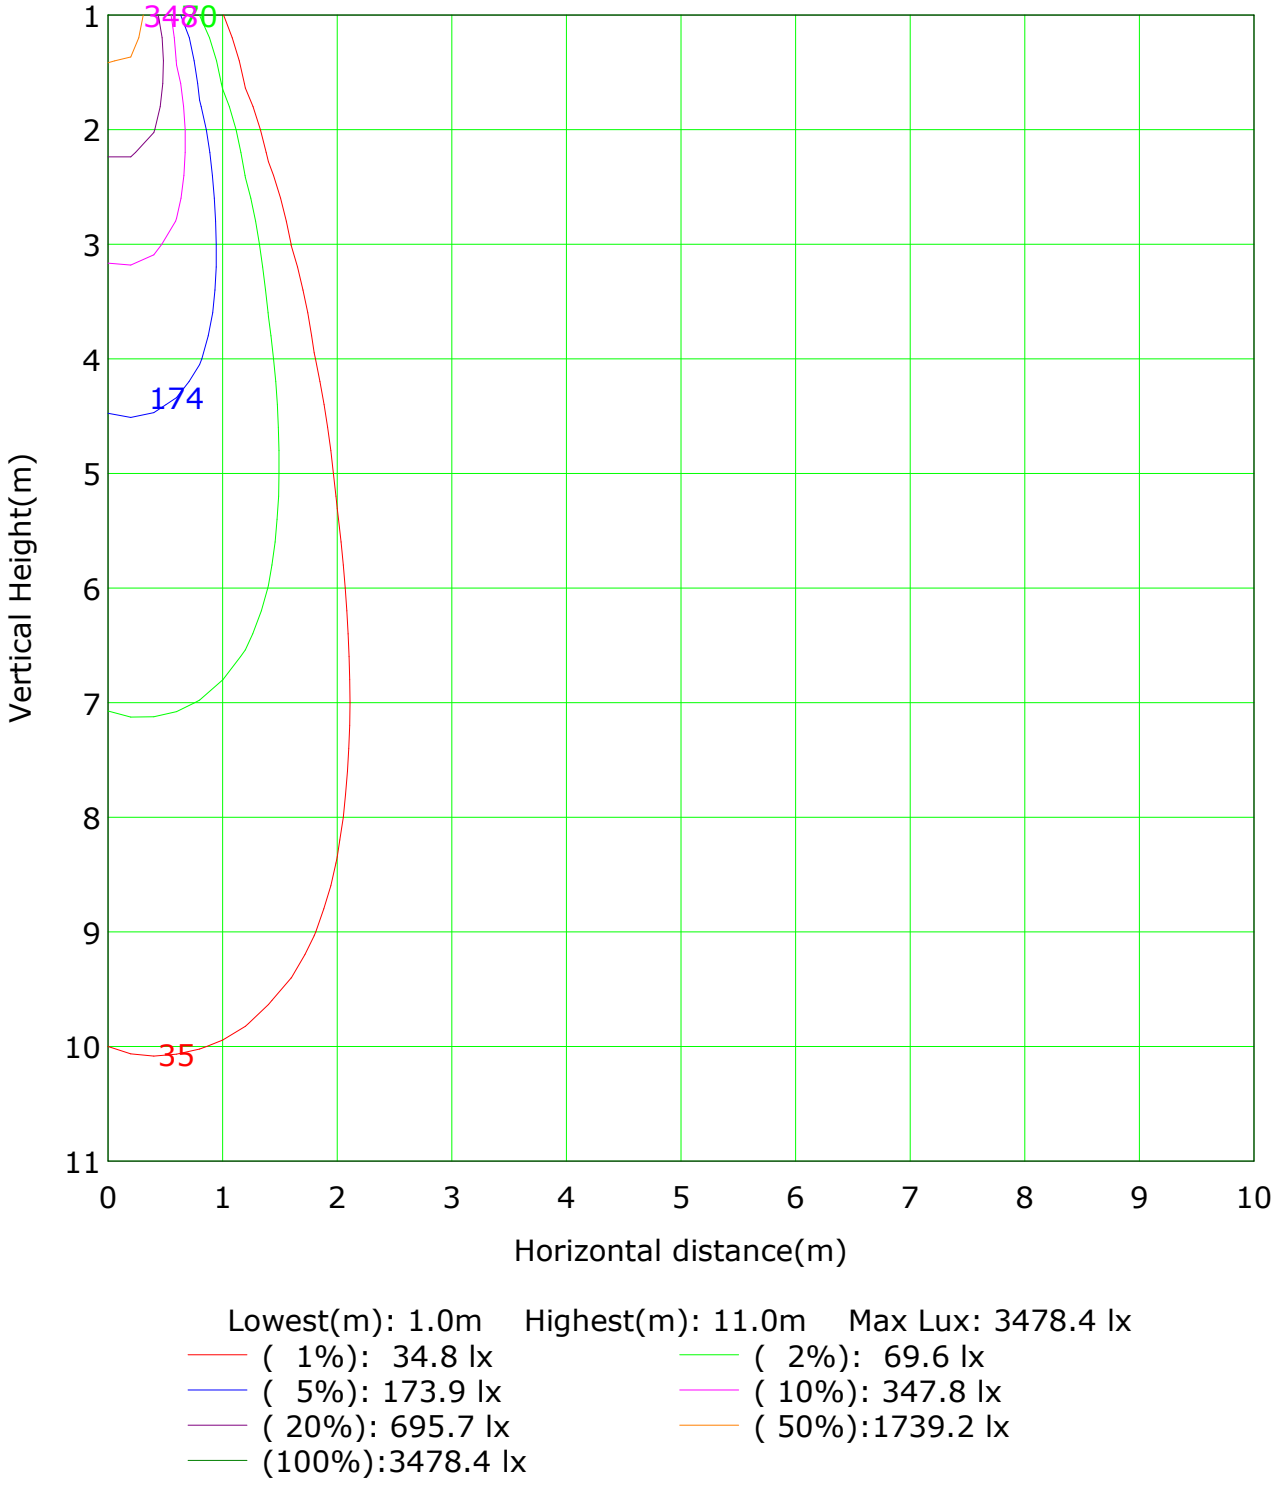

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3478.4 lx

(1%): 34.8 lx
(2%): 69.6 lx
(5%): 173.9 lx
(10%): 347.8 lx
(20%): 695.7 lx
(50%):1739.2 lx
(100%):3478.4 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Area Flux Table

Unit: lm


Horizontal plane	Vertical plane																									
	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0
-70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	1.2	0.0
-60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.5	0.5	0.4	0.3	0.2	0.1	0.0	0.0	0.0	0.0	4.0	0.0
-50	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.5	1.2	1.2	1.1	0.9	0.7	0.5	0.2	0.1	0.0	0.0	0.0	9.2	0.0
-40	0.0	0.0	0.0	0.0	0.2	0.4	0.8	1.2	2.4	2.9	2.4	1.8	1.2	0.8	0.4	0.2	0.0	0.0	0.0	19.5	0.0
-30	0.0	0.0	0.1	0.3	0.7	1.2	2.0	3.7	7.1	10.7	7.1	3.7	2.0	1.2	0.7	0.3	0.1	0.0	0.0	51.4	17.9
-20	0.0	0.0	0.1	0.4	0.9	1.6	3.1	8.2	23.4	42.8	23.4	8.2	3.1	1.6	0.9	0.4	0.1	0.0	0.0	160.9	137.6
-10	0.0	0.0	0.1	0.4	1.0	1.9	4.2	14.4	49.6	86.1	49.6	14.4	4.2	1.9	1.0	0.4	0.1	0.0	0.0	315.4	294.1
0	0.0	0.0	0.1	0.4	1.0	1.9	4.3	15.3	53.6	95.1	53.6	15.3	4.3	1.9	1.0	0.4	0.1	0.0	0.0	343.5	322.1
10	0.0	0.0	0.1	0.4	0.9	1.7	3.4	9.8	29.5	57.6	29.5	9.8	3.4	1.7	0.9	0.4	0.1	0.0	0.0	206.8	184.6
20	0.0	0.0	0.1	0.3	0.7	1.3	2.3	4.5	9.9	16.5	9.9	4.5	2.3	1.3	0.7	0.3	0.1	0.0	0.0	71.4	42.0
30	0.0	0.0	0.1	0.2	0.5	0.9	1.4	2.1	3.2	4.2	3.2	2.1	1.4	0.9	0.5	0.2	0.1	0.0	0.0	25.3	0.0
40	0.0	0.0	0.0	0.1	0.3	0.6	0.8	1.1	1.3	1.5	1.3	1.1	0.8	0.6	0.3	0.1	0.0	0.0	0.0	11.7	0.0
50	0.0	0.0	0.0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.6	0.5	0.4	0.3	0.2	0.1	0.0	0.0	0.0	5.4	0.0
60	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.1	0.0	0.0	0.0	0.0	1.9	0.0
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	Flux(T)	Flux(E)
	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1228	998

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

Flux Out: 596.83lm

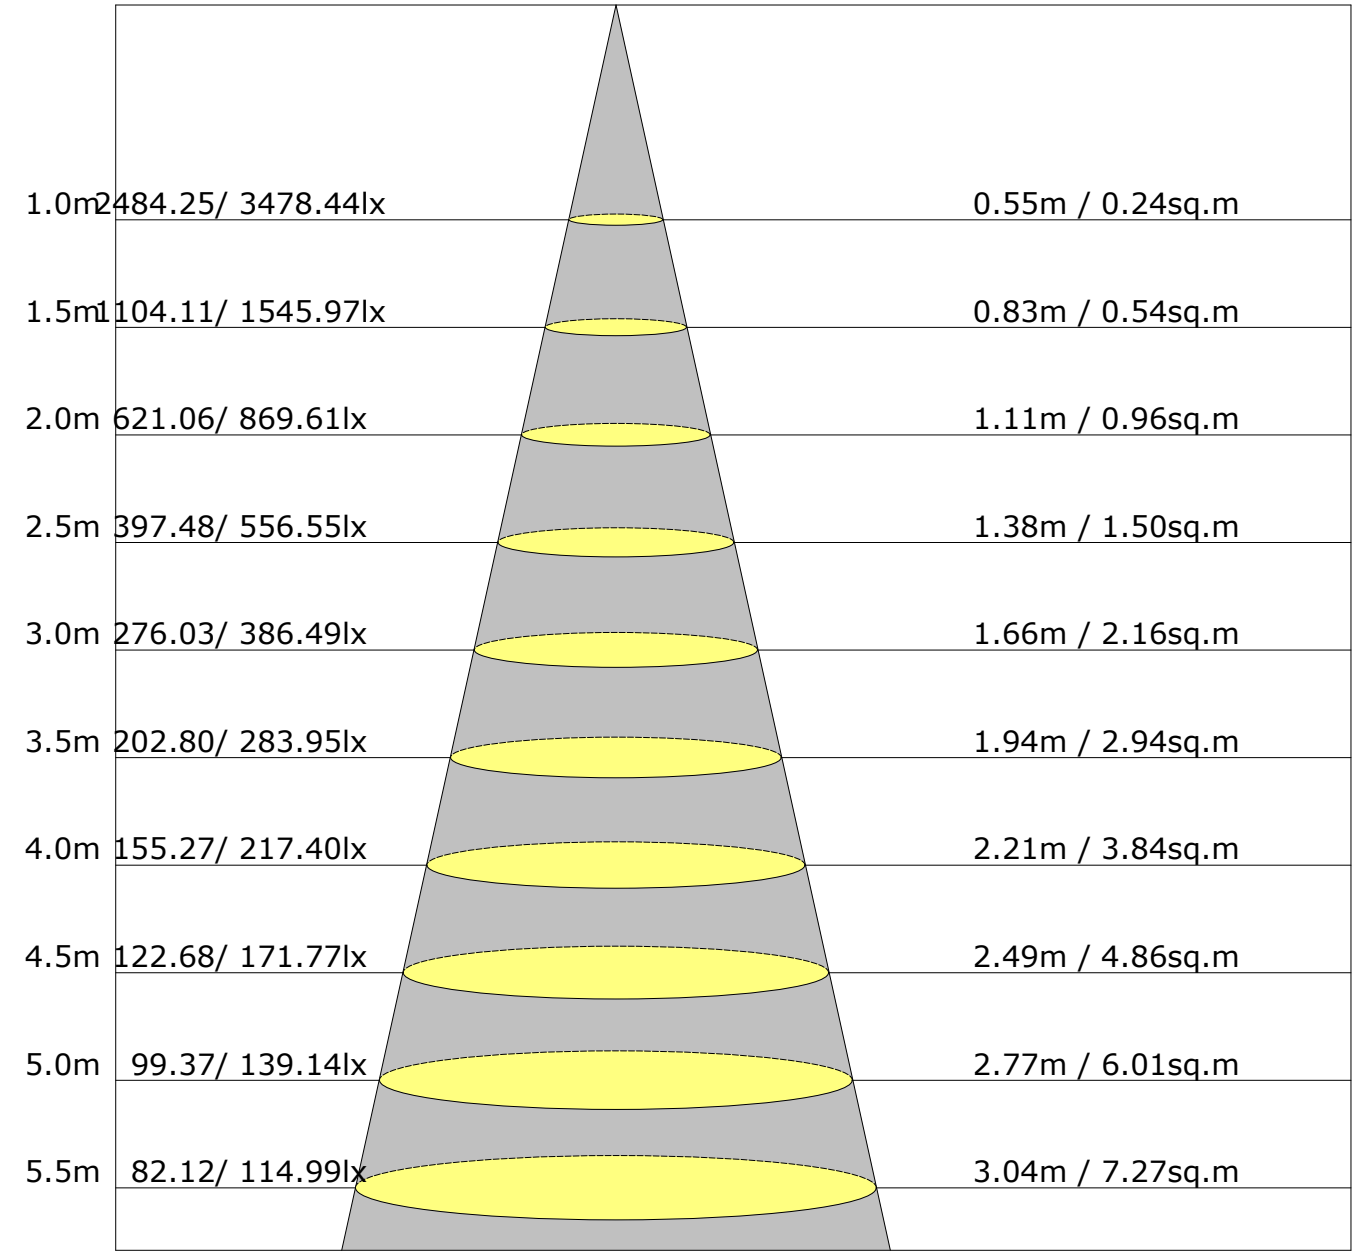

Height Avg./Nadir. E Beam Angle:30.9° Diameter / Area

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	16.7	17.4	16.9	17.6	17.8	16.0	16.8	16.3	17.0	17.2
3H	17.0	17.6	17.3	17.9	18.1	16.3	17.0	16.6	17.2	17.4
4H	17.0	17.7	17.3	17.9	18.2	16.3	16.9	16.6	17.2	17.5
6H	17.0	17.6	17.4	17.9	18.2	16.3	16.9	16.6	17.1	17.4
8H	17.0	17.6	17.3	17.9	18.2	16.2	16.8	16.6	17.1	17.4
12H	17.0	17.5	17.3	17.8	18.1	16.2	16.7	16.6	17.1	17.4
X=4H Y=2H	16.8	17.4	17.1	17.7	17.9	16.2	16.9	16.5	17.1	17.4
3H	17.2	17.7	17.5	18.0	18.4	16.6	17.1	16.9	17.4	17.7
4H	17.3	17.8	17.7	18.1	18.5	16.6	17.1	17.0	17.4	17.8
6H	17.3	17.7	17.7	18.1	18.5	16.6	17.0	17.0	17.4	17.8
8H	17.3	17.7	17.7	18.1	18.5	16.6	17.0	17.0	17.3	17.7
12H	17.3	17.6	17.7	18.0	18.5	16.5	16.9	17.0	17.3	17.7
X=8H Y=4H	17.2	17.6	17.7	18.0	18.4	16.6	17.0	17.0	17.4	17.8
6H	17.3	17.6	17.7	18.0	18.5	16.6	16.9	17.0	17.3	17.8
8H	17.2	17.5	17.7	18.0	18.4	16.5	16.8	17.0	17.3	17.7
12H	17.2	17.5	17.7	18.0	18.5	16.5	16.8	17.0	17.2	17.7
X=12H Y=4H	17.2	17.5	17.6	18.0	18.4	16.6	16.9	17.0	17.3	17.7
6H	17.2	17.5	17.7	17.9	18.4	16.5	16.8	17.0	17.3	17.7
8H	17.2	17.4	17.7	17.9	18.4	16.5	16.7	17.0	17.2	17.7
Variations with the observer position at spacings:										
S=1.0H	+1.7/-1.3					+1.6/-1.4				
S=1.5H	+3.4/-2.1					+3.1/-2.5				
S=2.0H	+5.0/-3.8					+4.7/-4.2				

Calculate in accordance with CIE Pub.117. The table is revised with 1229lm (8log(F/F0) = 0.7).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

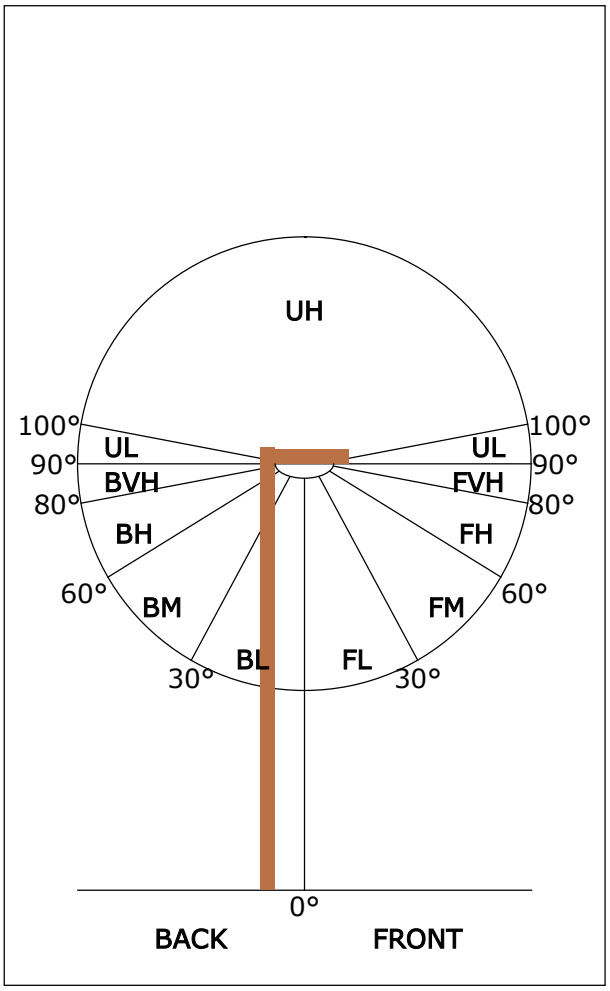

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	667	54.3
FL (0°-30°)	564	45.9
FM (30°-60°)	92	7.5
FH (60°-80°)	11	0.9
FVH (80°-90°)	1	0.0
BACK LIGHT	562	45.7
BL (0°-30°)	476	38.8
BM (30°-60°)	77	6.3
BH (60°-80°)	8	0.7
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3475.7	3.3	3.3	0.27	0.27
1.0-2.0	3459.7	9.9	13.3	0.81	1.08
2.0-3.0	3422.7	16.4	29.6	1.33	2.41
3.0-4.0	3370.3	22.6	52.2	1.84	4.25
4.0-5.0	3309.1	28.5	80.7	2.32	6.56
5.0-6.0	3237.5	34.0	114.7	2.77	9.33
6.0-7.0	3156.2	39.2	153.9	3.19	12.52
7.0-8.0	3059.3	43.8	197.7	3.56	16.08
8.0-9.0	2945.3	47.7	245.4	3.88	19.97
9.0-10.0	2822.3	51.1	296.5	4.16	24.13
10.0-11.0	2686.4	53.7	350.2	4.37	28.49
11.0-12.0	2536.5	55.5	405.6	4.51	33.01
12.0-13.0	2369.7	56.2	461.9	4.58	37.58
13.0-14.0	2185.3	55.9	517.8	4.55	42.14
14.0-15.0	1990.6	54.7	572.5	4.45	46.58
15.0-16.0	1793.2	52.6	625.0	4.28	50.86
16.0-17.0	1601.0	49.9	674.9	4.06	54.92
17.0-18.0	1415.4	46.7	721.6	3.80	58.72
18.0-19.0	1237.1	43.0	764.6	3.50	62.22
19.0-20.0	1073.6	39.3	803.9	3.20	65.42
20.0-21.0	930.4	35.7	839.6	2.91	68.32
21.0-22.0	806.2	32.4	872.0	2.64	70.96
22.0-23.0	698.7	29.3	901.4	2.39	73.35
23.0-24.0	605.3	26.5	927.8	2.15	75.50
24.0-25.0	525.6	23.9	951.7	1.94	77.45
25.0-26.0	457.7	21.6	973.3	1.76	79.20
26.0-27.0	398.4	19.5	992.8	1.59	80.79
27.0-28.0	346.9	17.6	1010.4	1.43	82.22
28.0-29.0	303.0	15.9	1026.2	1.29	83.51
29.0-30.0	265.1	14.3	1040.6	1.17	84.68
30.0-31.0	232.6	12.9	1053.5	1.05	85.73
31.0-32.0	204.8	11.7	1065.2	0.95	86.68
32.0-33.0	181.0	10.7	1075.9	0.87	87.55
33.0-34.0	160.7	9.7	1085.6	0.79	88.34
34.0-35.0	143.8	8.9	1094.6	0.73	89.07
35.0-36.0	129.8	8.3	1102.8	0.67	89.74

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	118.0	7.7	1110.5	0.63	90.37
37.0-38.0	108.0	7.2	1117.7	0.59	90.95
38.0-39.0	99.2	6.8	1124.5	0.55	91.51
39.0-40.0	91.7	6.4	1130.9	0.52	92.03
40.0-41.0	85.2	6.1	1137.0	0.49	92.52
41.0-42.0	79.2	5.8	1142.7	0.47	92.99
42.0-43.0	73.7	5.5	1148.2	0.44	93.43
43.0-44.0	68.8	5.2	1153.4	0.42	93.86
44.0-45.0	64.3	4.9	1158.3	0.40	94.26
45.0-46.0	60.3	4.7	1163.0	0.38	94.64
46.0-47.0	56.5	4.5	1167.5	0.37	95.01
47.0-48.0	52.8	4.3	1171.8	0.35	95.35
48.0-49.0	49.5	4.1	1175.9	0.33	95.68
49.0-50.0	46.3	3.9	1179.7	0.31	96.00
50.0-51.0	43.4	3.7	1183.4	0.30	96.30
51.0-52.0	40.7	3.5	1186.9	0.28	96.58
52.0-53.0	38.4	3.3	1190.2	0.27	96.85
53.0-54.0	36.3	3.2	1193.4	0.26	97.12
54.0-55.0	34.1	3.0	1196.5	0.25	97.36
55.0-56.0	31.8	2.9	1199.4	0.23	97.60
56.0-57.0	29.8	2.7	1202.1	0.22	97.82
57.0-58.0	27.9	2.6	1204.7	0.21	98.03
58.0-59.0	26.1	2.4	1207.1	0.20	98.23
59.0-60.0	24.3	2.3	1209.4	0.19	98.41
60.0-61.0	22.3	2.1	1211.5	0.17	98.59
61.0-62.0	20.4	2.0	1213.5	0.16	98.75
62.0-63.0	18.9	1.8	1215.3	0.15	98.90
63.0-64.0	17.2	1.7	1217.0	0.14	99.03
64.0-65.0	15.1	1.5	1218.5	0.12	99.15
65.0-66.0	13.2	1.3	1219.8	0.11	99.26
66.0-67.0	11.6	1.2	1221.0	0.09	99.36
67.0-68.0	10.5	1.1	1222.0	0.09	99.44
68.0-69.0	9.5	1.0	1223.0	0.08	99.52
69.0-70.0	8.3	0.9	1223.9	0.07	99.59
70.0-71.0	7.4	0.8	1224.6	0.06	99.65
71.0-72.0	6.6	0.7	1225.3	0.06	99.71

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	5.7	0.6	1225.9	0.05	99.76
73.0-74.0	4.9	0.5	1226.4	0.04	99.80
74.0-75.0	4.3	0.5	1226.9	0.04	99.84
75.0-76.0	3.6	0.4	1227.3	0.03	99.87
76.0-77.0	2.9	0.3	1227.6	0.03	99.89
77.0-78.0	2.3	0.2	1227.8	0.02	99.91
78.0-79.0	1.7	0.2	1228.0	0.02	99.93
79.0-80.0	1.4	0.1	1228.1	0.01	99.94
80.0-81.0	1.0	0.1	1228.3	0.01	99.95
81.0-82.0	0.8	0.1	1228.3	0.01	99.96
82.0-83.0	0.7	0.1	1228.4	0.01	99.96
83.0-84.0	0.8	0.1	1228.5	0.01	99.97
84.0-85.0	0.7	0.1	1228.6	0.01	99.97
85.0-86.0	0.6	0.1	1228.6	0.01	99.98
86.0-87.0	0.6	0.1	1228.7	0.01	99.98
87.0-88.0	0.6	0.1	1228.8	0.01	99.99
88.0-89.0	0.6	0.1	1228.8	0.01	100.00
89.0-90.0	0.5	0.1	1228.9	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3478.4	3478.4								
G1.0	3521.1	3425.0								
G2.0	3543.3	3349.5								
G3.0	3542.3	3255.8								
G4.0	3531.0	3152.2								
G5.0	3506.7	3046.5								
G6.0	3463.0	2934.0								
G7.0	3405.0	2822.6								
G8.0	3322.0	2687.5								
G9.0	3232.1	2539.6								
G10.0	3129.2	2388.3								
G11.0	2992.1	2235.9								
G12.0	2840.9	2077.2								
G13.0	2659.1	1901.4								
G14.0	2456.4	1724.4								
G15.0	2245.2	1536.5								
G16.0	2027.8	1363.3								
G17.0	1809.9	1203.1								
G18.0	1600.9	1047.5								
G19.0	1399.3	900.5								
G20.0	1222.9	771.6								
G21.0	1064.9	662.3								
G22.0	927.9	569.9								
G23.0	806.4	490.7								
G24.0	700.4	423.5								
G25.0	613.0	365.3								
G26.0	535.1	317.3								
G27.0	464.7	276.4								
G28.0	403.9	242.8								
G29.0	350.9	214.6								
G30.0	305.4	189.8								
G31.0	267.1	168.2								
G32.0	233.8	150.1								
G33.0	205.4	134.5								
G34.0	181.4	121.5								
G35.0	161.6	110.7								
G36.0	145.5	101.3								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	132.1	93.2								
G38.0	120.3	86.5								
G39.0	109.9	80.2								
G40.0	101.6	74.9								
G41.0	94.1	70.1								
G42.0	87.1	65.5								
G43.0	81.2	61.1								
G44.0	75.7	57.0								
G45.0	70.9	53.6								
G46.0	66.7	50.2								
G47.0	62.2	46.8								
G48.0	58.4	43.8								
G49.0	54.7	41.0								
G50.0	51.2	38.4								
G51.0	48.0	35.9								
G52.0	45.0	33.9								
G53.0	42.5	32.3								
G54.0	40.1	30.5								
G55.0	37.4	28.5								
G56.0	34.8	26.6								
G57.0	32.9	24.8								
G58.0	30.8	23.1								
G59.0	28.8	21.6								
G60.0	27.0	19.7								
G61.0	25.5	17.0								
G62.0	24.0	15.2								
G63.0	22.7	13.7								
G64.0	19.8	12.5								
G65.0	16.7	11.3								
G66.0	14.7	10.1								
G67.0	13.1	8.6								
G68.0	12.8	7.5								
G69.0	11.3	6.3								
G70.0	10.1	5.7								
G71.0	9.2	4.8								
G72.0	8.0	4.5								
G73.0	6.9	3.6								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	6.3	2.8								
G75.0	5.7	2.3								
G76.0	4.8	1.5								
G77.0	4.2	1.0								
G78.0	3.5	0.4								
G79.0	2.7	0.3								
G80.0	2.3	0.2								
G81.0	1.6	0.0								
G82.0	1.4	0.0								
G83.0	1.5	0.0								
G84.0	1.5	0.0								
G85.0	1.2	0.0								
G86.0	1.2	0.0								
G87.0	1.2	0.0								
G88.0	1.2	0.0								
G89.0	1.0	0.0								
G90.0	1.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: