

Report No.:

Test Time: 2026-09-28 17:37

Luminaire Property

Luminaire Category:

Luminaire Description: 91.27811

Voltage: 228.2 V

Power: 29.70 W

Lamp Description: BLX 3030 3000K

Current: 0.138 A

Power Factor: 0.941

Photometric Results

CIE Class: Direct

Measurement Flux: 2342.6 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(50%): H38.5

Vertical Diffuse Angle(50%): V38.5

Luminaire Efficacy Rating (LER): 79

Max. Intensity: 4175.09 cd

Total Rated Lamp Lumens: 2342.6 lm


Efficiency: 100%

Upward Ratio: 0%


Central Intensity: 3943.27 cd

Pos of Max. Intensity: H0 V6

Picture Of Luminaire



Luminous Intensity Distribution Curve

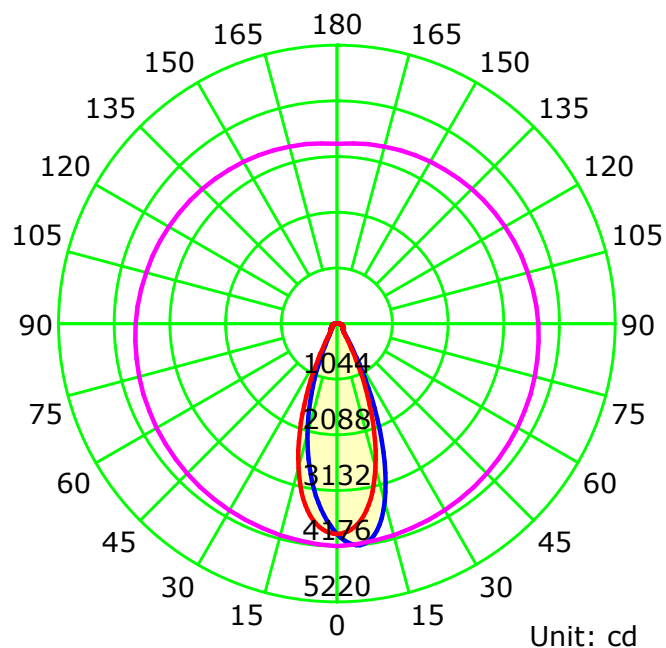

— C0-C180 — C90-C270 — G6

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

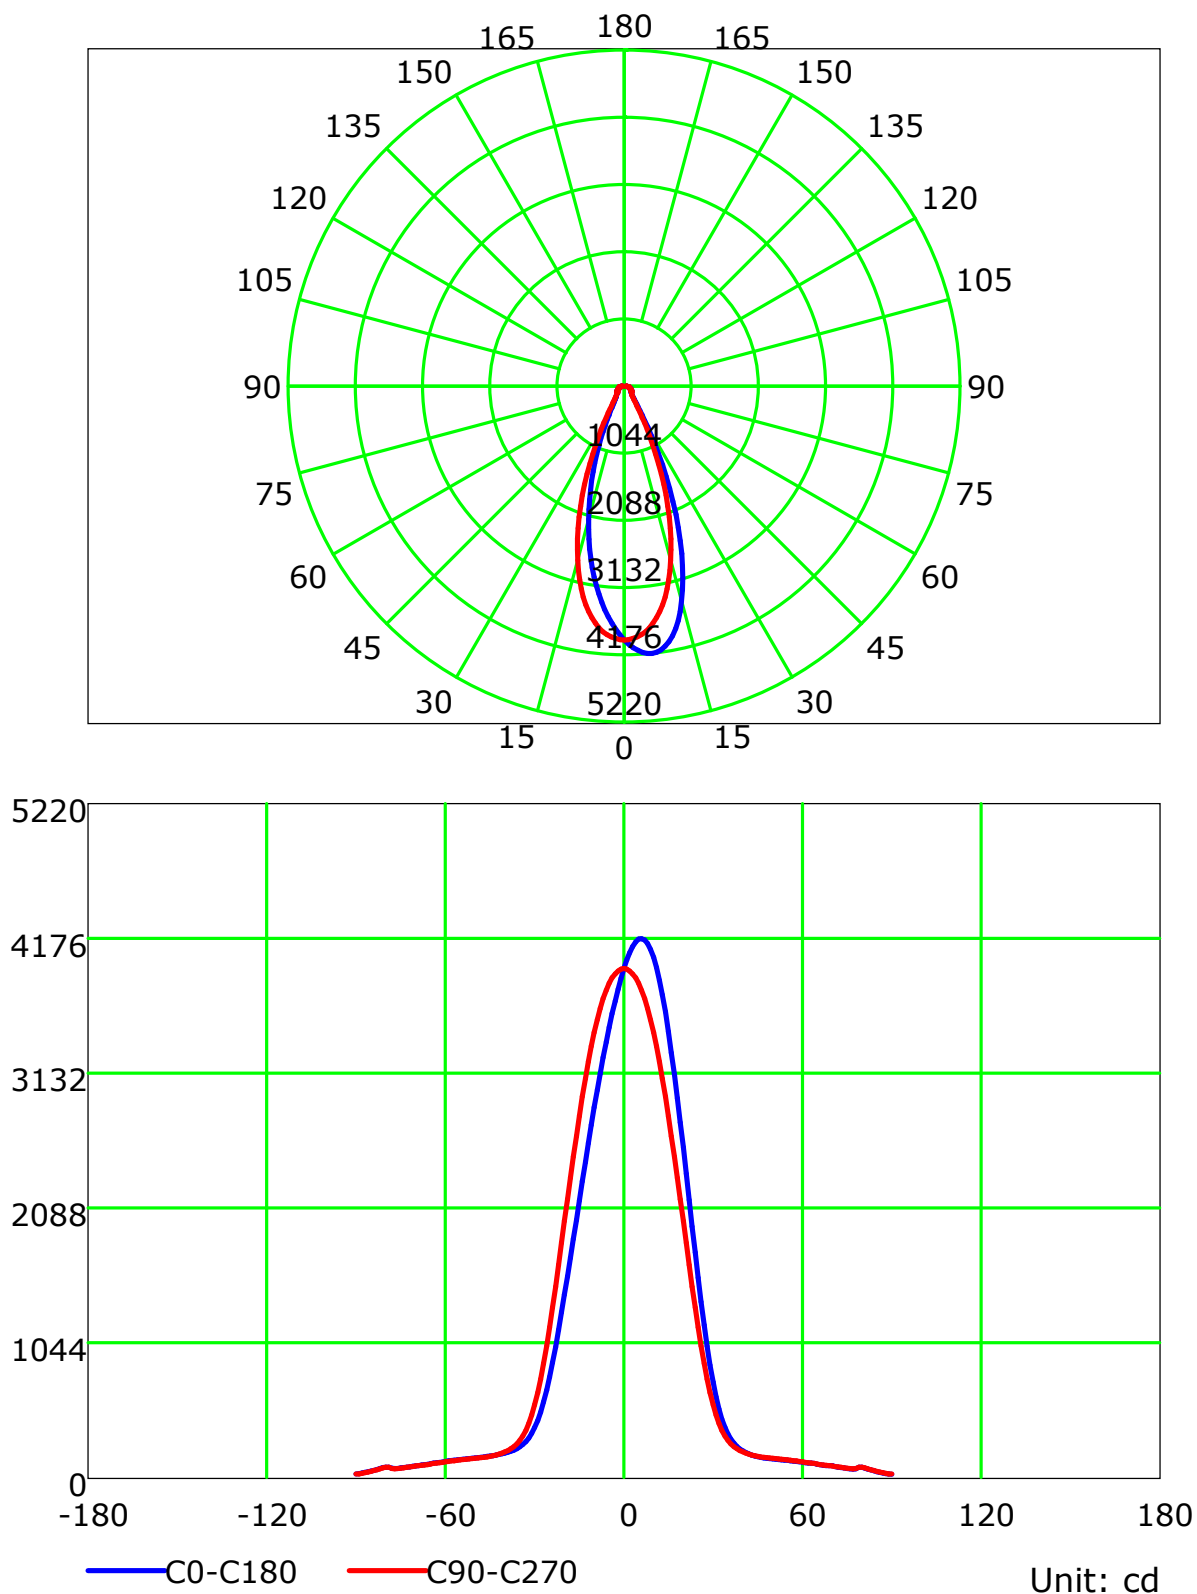

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

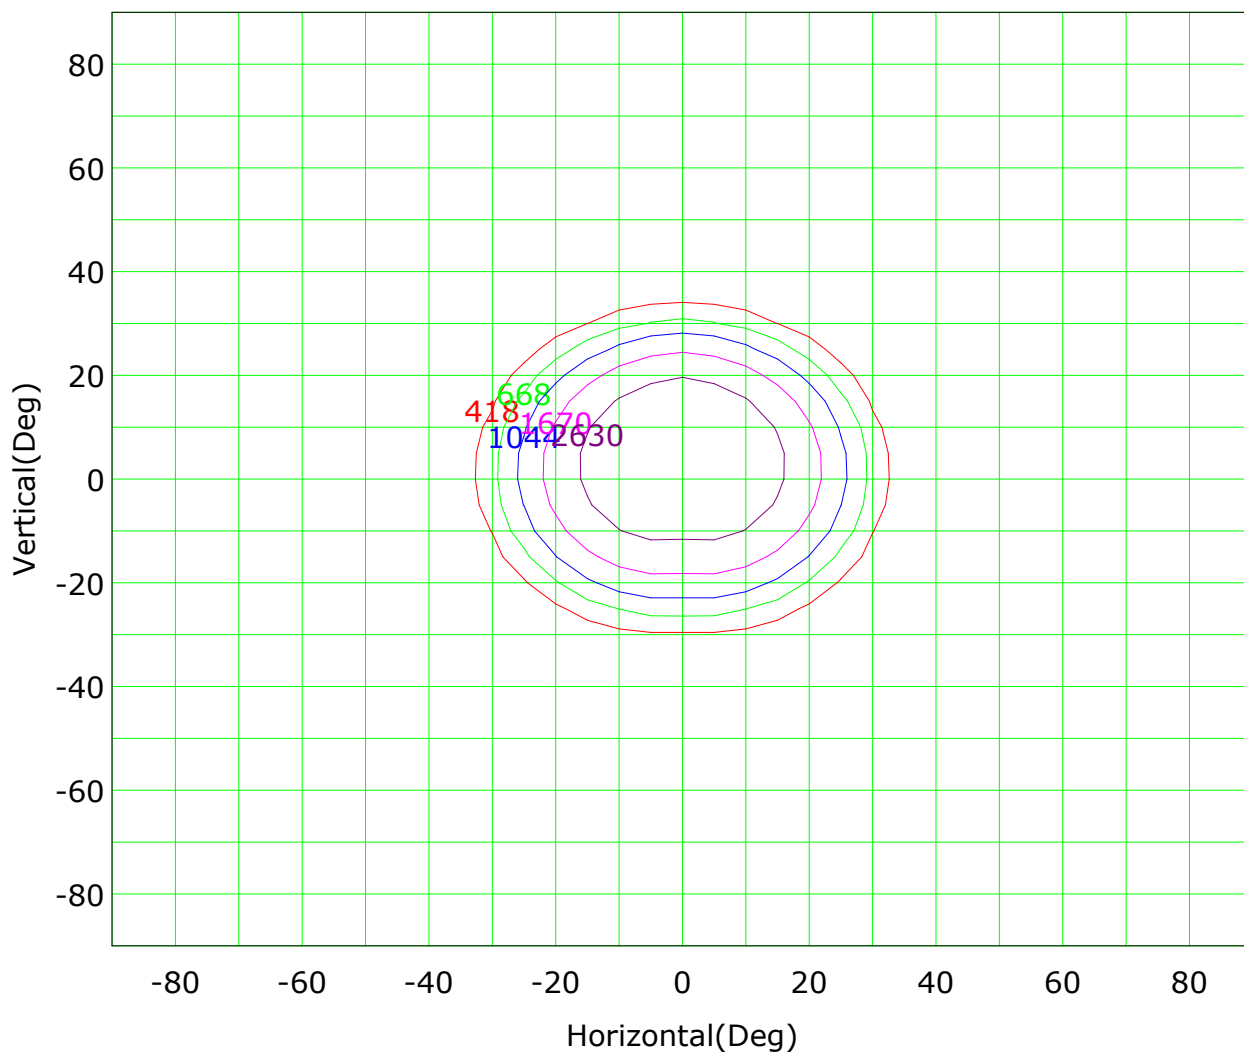

Imax (100%): 4175 cd

(10%): 418 cd	(16%): 668 cd
(25%): 1044 cd	(40%): 1670 cd
(63%): 2630 cd	(100%): 4175 cd

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.010 m

Humidity:

Inspector:

IsoLux Plot

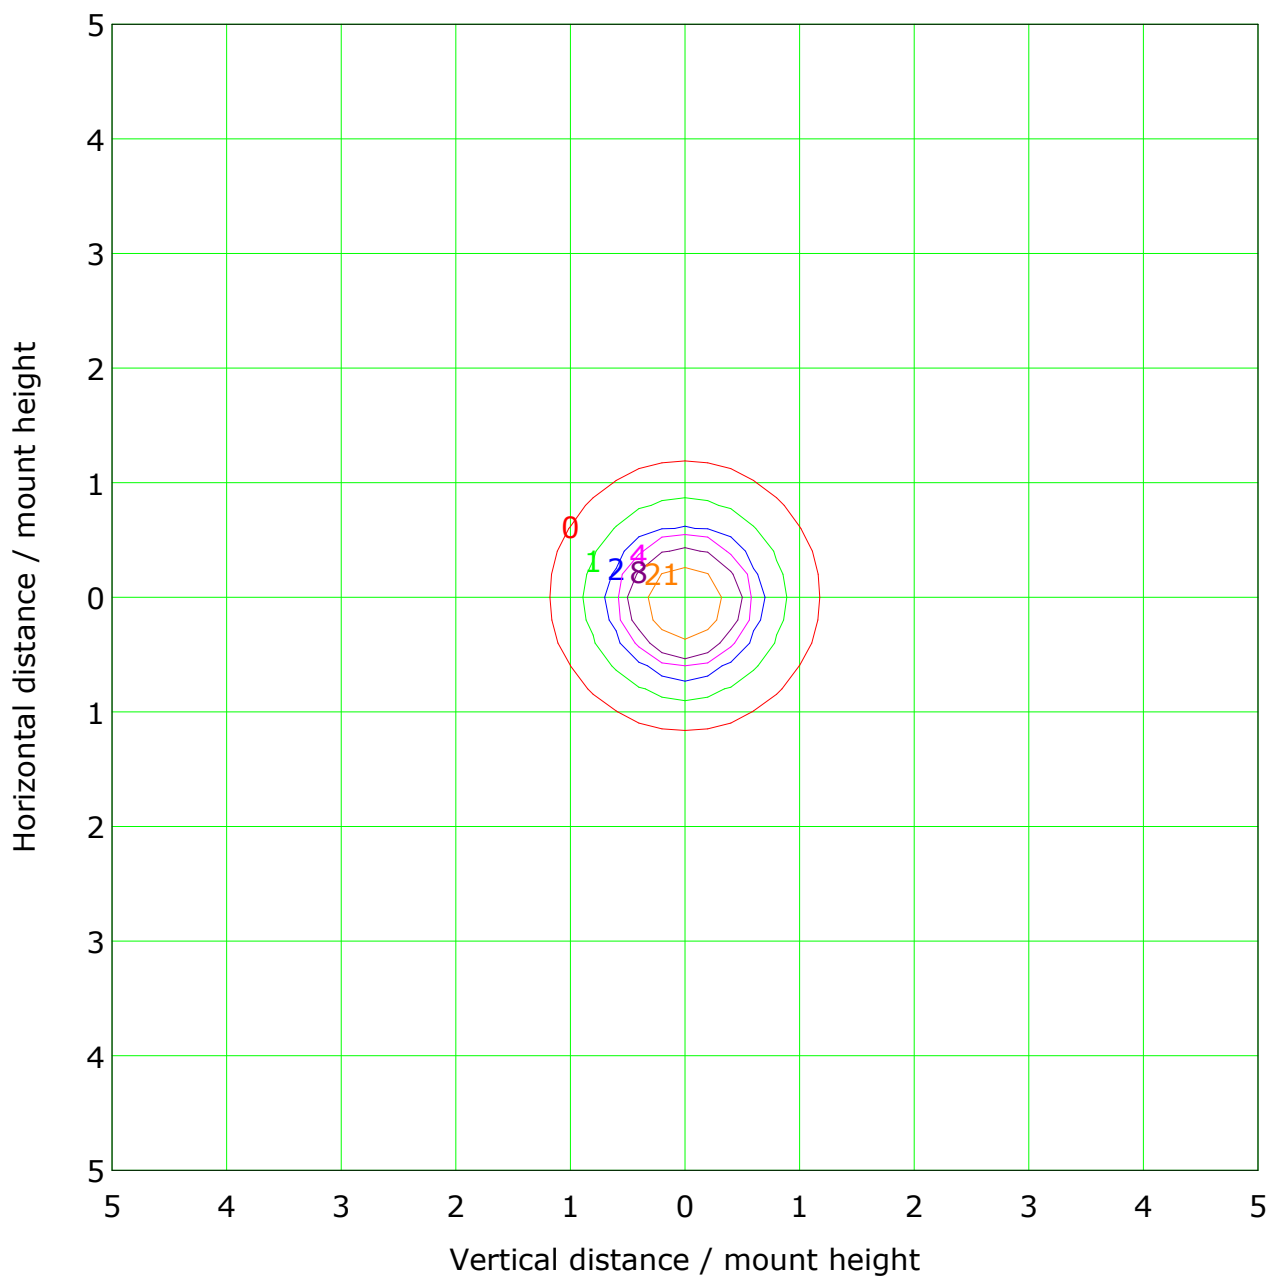

Mounting Height: 10m		Max Lux(100%): 41 lx	
— (1%):	0 lx	— (2%):	1 lx
— (5%):	2 lx	— (10%):	4 lx
— (20%):	8 lx	— (50%):	21 lx
— (100%):	41 lx		

C Plane (°):0.0-180.0: 180.0

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-90.0:1.0


Test Device: CHL-6E

Distance: 3.010 m


Humidity:

Inspector:

Illuminance at a Distance

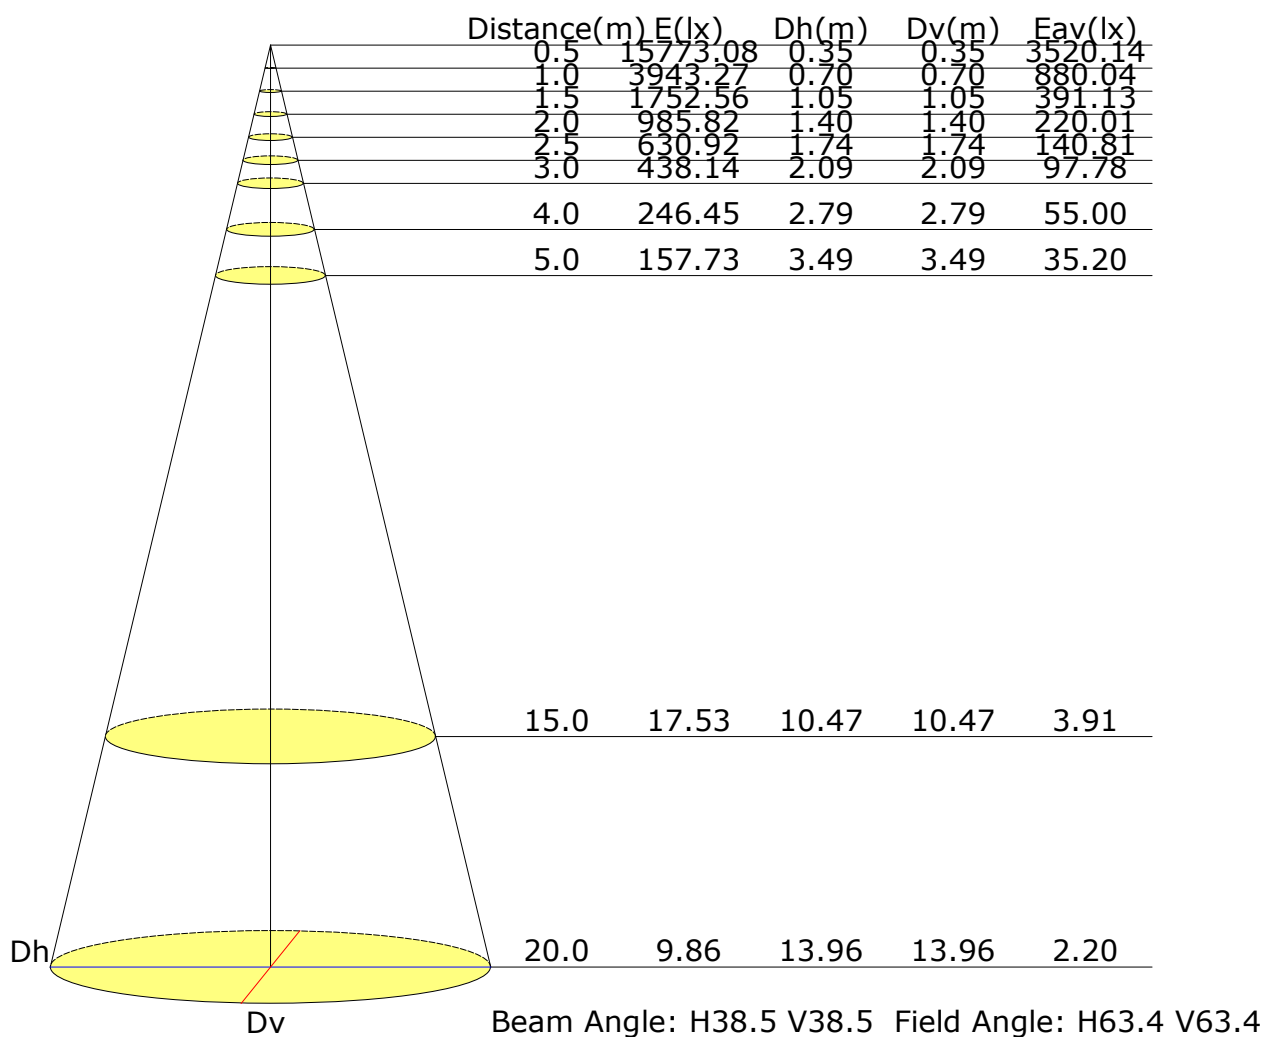

Vertical IsoLux Plot

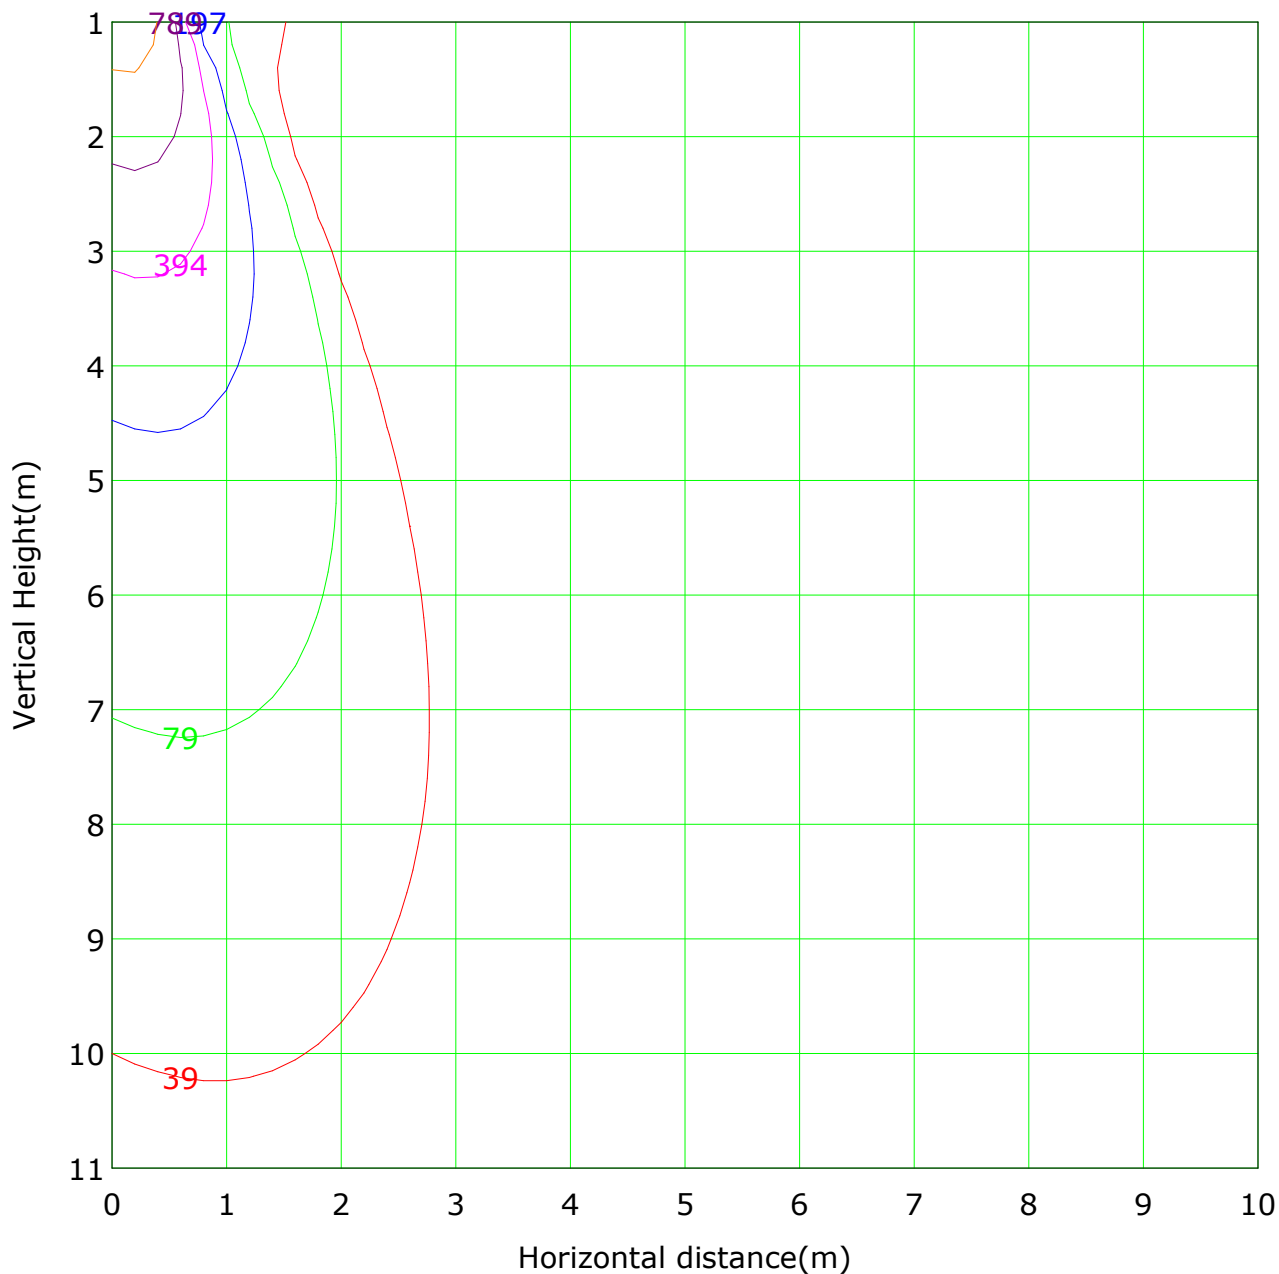


Lowest(m): 1m Highest(m): 11 Max Lux: 3943	
(1%): 39 lx	(2%): 79 lx
(5%): 197 lx	(10%): 394 lx
(20%): 789 lx	(50%): 1972 lx
(100%): 3943 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The average illuminance effective figure

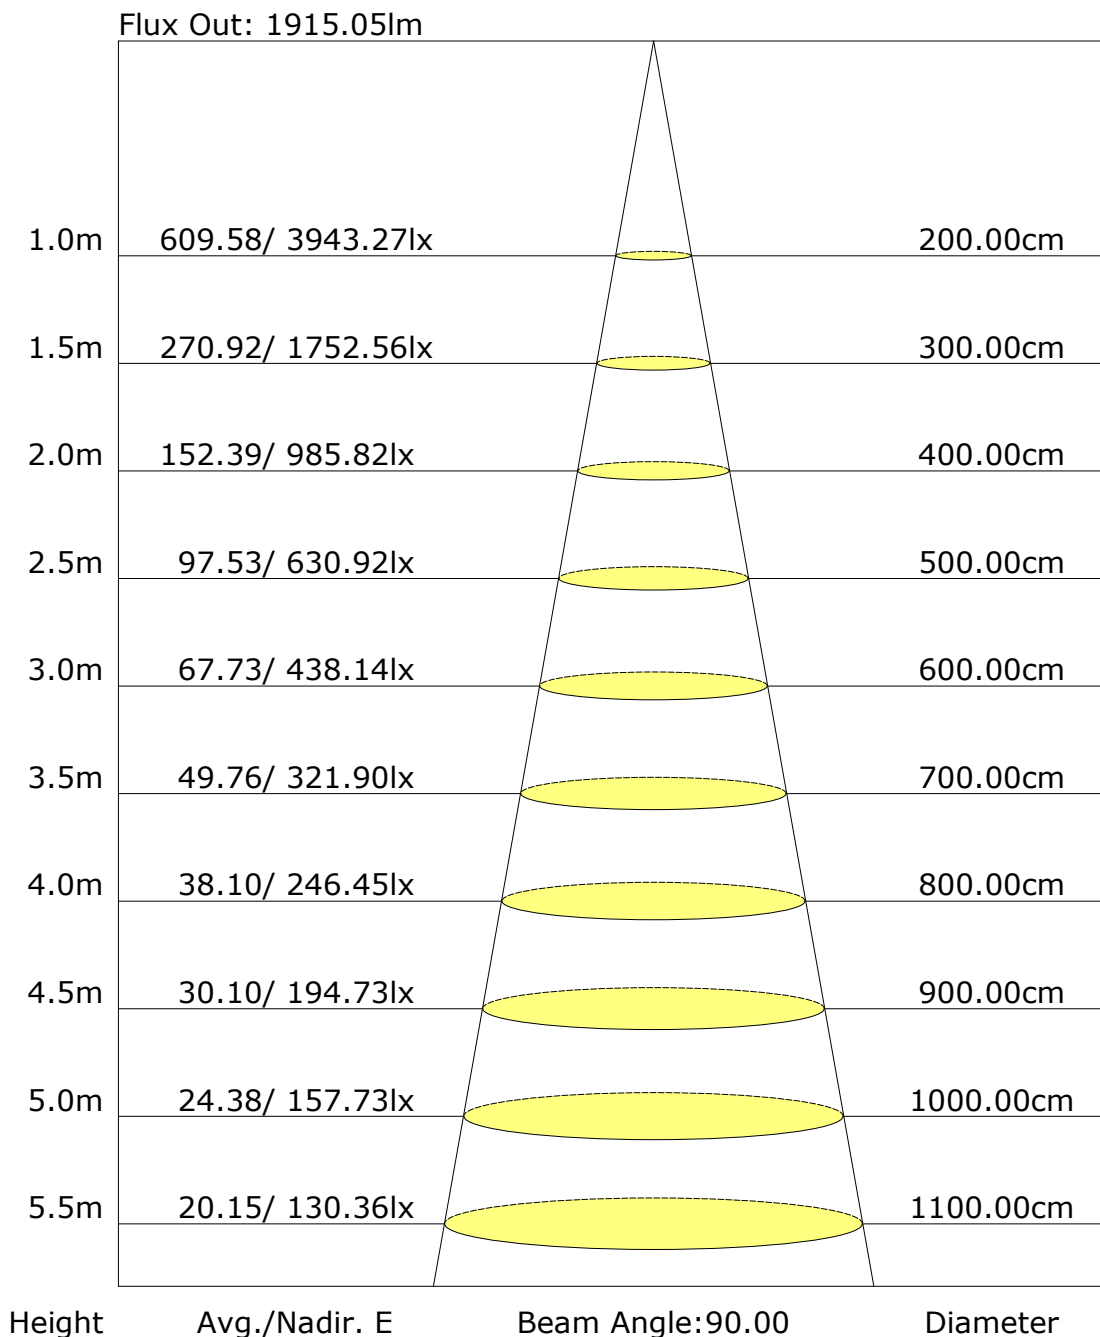

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR table

Reflectance:										
Ceiling cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	viewed crosswise					viewed endwise				
x = 2H y = 2H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
3H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
4H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
6H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
8H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
12H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
x = 4H y = 2H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
3H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
4H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
6H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
8H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
12H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
x = 8H y = 4H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
6H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
8H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
12H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
x = 12H y = 4H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
6H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$
8H	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$	1.\$

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3941.0	3.8	3.8	0.16	0.16
1.0-2.0	3931.3	11.3	15.1	0.48	0.64
2.0-3.0	3912.5	18.7	33.8	0.80	1.44
3.0-4.0	3885.8	26.0	59.8	1.11	2.55
4.0-5.0	3849.6	33.1	92.9	1.41	3.97
5.0-6.0	3801.7	40.0	132.9	1.71	5.67
6.0-7.0	3742.1	46.5	179.3	1.98	7.65
7.0-8.0	3671.2	52.5	231.9	2.24	9.90
8.0-9.0	3589.3	58.2	290.0	2.48	12.38
9.0-10.0	3497.2	63.3	353.3	2.70	15.08
10.0-11.0	3394.4	67.8	421.2	2.90	17.98
11.0-12.0	3280.4	71.7	492.9	3.06	21.04
12.0-13.0	3155.8	74.9	567.8	3.20	24.24
13.0-14.0	3020.7	77.3	645.1	3.30	27.54
14.0-15.0	2875.2	78.9	724.1	3.37	30.91
15.0-16.0	2721.6	79.8	803.8	3.40	34.31
16.0-17.0	2564.1	79.9	883.7	3.41	37.72
17.0-18.0	2403.1	79.2	962.9	3.38	41.11
18.0-19.0	2238.2	77.9	1040.8	3.32	44.43
19.0-20.0	2071.2	75.8	1116.6	3.24	47.67
20.0-21.0	1902.3	73.1	1189.7	3.12	50.79
21.0-22.0	1732.6	69.6	1259.3	2.97	53.76
22.0-23.0	1563.8	65.6	1325.0	2.80	56.56
23.0-24.0	1398.9	61.2	1386.1	2.61	59.17
24.0-25.0	1241.0	56.4	1442.6	2.41	61.58
25.0-26.0	1091.9	51.5	1494.1	2.20	63.78
26.0-27.0	951.8	46.6	1540.7	1.99	65.77
27.0-28.0	823.6	41.7	1582.4	1.78	67.55
28.0-29.0	710.1	37.2	1619.5	1.59	69.13
29.0-30.0	610.3	33.0	1652.5	1.41	70.54
30.0-31.0	524.1	29.2	1681.7	1.25	71.79
31.0-32.0	452.0	25.9	1707.6	1.11	72.89
32.0-33.0	392.1	23.1	1730.7	0.99	73.88
33.0-34.0	343.6	20.8	1751.5	0.89	74.77
34.0-35.0	305.3	19.0	1770.4	0.81	75.58
35.0-36.0	275.0	17.5	1787.9	0.75	76.32

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	250.9	16.4	1804.3	0.70	77.02
37.0-38.0	231.7	15.5	1819.8	0.66	77.68
38.0-39.0	216.5	14.8	1834.6	0.63	78.31
39.0-40.0	204.1	14.2	1848.8	0.61	78.92
40.0-41.0	193.8	13.8	1862.6	0.59	79.51
41.0-42.0	185.2	13.5	1876.1	0.57	80.08
42.0-43.0	178.0	13.2	1889.2	0.56	80.65
43.0-44.0	171.9	13.0	1902.2	0.55	81.20
44.0-45.0	166.9	12.8	1915.1	0.55	81.75
45.0-46.0	162.7	12.7	1927.8	0.54	82.29
46.0-47.0	158.9	12.6	1940.4	0.54	82.83
47.0-48.0	155.6	12.6	1953.0	0.54	83.37
48.0-49.0	152.8	12.5	1965.5	0.54	83.90
49.0-50.0	150.1	12.5	1978.1	0.53	84.44
50.0-51.0	147.5	12.5	1990.5	0.53	84.97
51.0-52.0	145.1	12.5	2003.0	0.53	85.50
52.0-53.0	142.9	12.4	2015.4	0.53	86.03
53.0-54.0	140.7	12.4	2027.8	0.53	86.56
54.0-55.0	138.4	12.4	2040.2	0.53	87.09
55.0-56.0	135.7	12.3	2052.5	0.52	87.61
56.0-57.0	132.7	12.1	2064.6	0.52	88.13
57.0-58.0	130.1	12.0	2076.6	0.51	88.65
58.0-59.0	127.5	11.9	2088.5	0.51	89.16
59.0-60.0	124.2	11.7	2100.3	0.50	89.66
60.0-61.0	120.7	11.5	2111.8	0.49	90.15
61.0-62.0	117.3	11.3	2123.1	0.48	90.63
62.0-63.0	114.9	11.2	2134.3	0.48	91.11
63.0-64.0	112.6	11.1	2145.3	0.47	91.58
64.0-65.0	108.4	10.7	2156.1	0.46	92.04
65.0-66.0	103.6	10.3	2166.4	0.44	92.48
66.0-67.0	100.0	10.1	2176.5	0.43	92.91
67.0-68.0	96.7	9.8	2186.3	0.42	93.33
68.0-69.0	93.9	9.6	2195.8	0.41	93.74
69.0-70.0	92.0	9.4	2205.3	0.40	94.14
70.0-71.0	88.7	9.2	2214.5	0.39	94.53
71.0-72.0	84.3	8.8	2223.2	0.37	94.90

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3943.3	3943.3								
G1.0	4009.9	3867.6								
G2.0	4065.9	3781.6								
G3.0	4111.1	3691.2								
G4.0	4148.5	3592.6								
G5.0	4170.1	3487.3								
G6.0	4175.1	3374.2								
G7.0	4164.4	3254.7								
G8.0	4137.0	3128.6								
G9.0	4091.6	2999.9								
G10.0	4030.1	2867.2								
G11.0	3950.5	2730.0								
G12.0	3852.4	2588.9								
G13.0	3739.2	2442.5								
G14.0	3607.7	2293.4								
G15.0	3454.9	2144.9								
G16.0	3291.8	1994.9								
G17.0	3121.4	1848.4								
G18.0	2940.3	1702.1								
G19.0	2751.9	1558.4								
G20.0	2557.9	1416.6								
G21.0	2354.8	1280.1								
G22.0	2150.8	1144.7								
G23.0	1946.1	1013.7								
G24.0	1743.3	892.3								
G25.0	1548.7	779.7								
G26.0	1361.8	677.3								
G27.0	1182.3	585.8								
G28.0	1018.4	507.9								
G29.0	871.1	443.1								
G30.0	739.7	387.2								
G31.0	627.1	342.5								
G32.0	532.3	306.1								
G33.0	452.2	277.8								
G34.0	388.7	255.8								
G35.0	338.6	238.3								
G36.0	298.6	224.6								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	267.4	213.1								
G38.0	242.6	203.9								
G39.0	223.0	196.4								
G40.0	207.2	189.8								
G41.0	194.4	183.8								
G42.0	184.2	178.5								
G43.0	175.5	173.9								
G44.0	168.2	170.3								
G45.0	162.4	166.8								
G46.0	157.6	163.8								
G47.0	153.3	160.9								
G48.0	150.1	158.1								
G49.0	147.1	155.7								
G50.0	144.3	153.3								
G51.0	141.9	150.7								
G52.0	139.9	148.0								
G53.0	138.1	145.3								
G54.0	136.3	142.9								
G55.0	134.1	140.4								
G56.0	131.1	137.2								
G57.0	128.2	134.4								
G58.0	125.1	132.9								
G59.0	122.2	129.7								
G60.0	120.1	124.9								
G61.0	116.5	121.2								
G62.0	113.4	118.3								
G63.0	112.8	115.2								
G64.0	109.4	113.1								
G65.0	103.2	108.1								
G66.0	99.4	103.8								
G67.0	96.2	100.4								
G68.0	93.2	97.0								
G69.0	91.7	93.7								
G70.0	92.3	90.2								
G71.0	85.1	87.1								
G72.0	80.9	83.9								
G73.0	77.8	80.9								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

