Report No.:

Test Time: 2026-09-10 17:19

Luminaire Property

Luminaire Manufacturer:
Luminaire Description: 52.05553 15D
Luminous Width (mm): -45
Current: 0.066 A
Power Factor: 0.961

Luminous Length (mm): -45
Voltage: 228.5 V
Power: 14.50 W

Photometric Results

CIE Class: Direct
Measurement Flux: 1201.9 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(50%): H25.3
Vertical Diffuse Angle(50%): V25.3
Luminaire Efficacy Rating (LER): 82.94
Max. Intensity: 5031.05 cd
S/MH(C0/C180): 0.44

Total Rated Lamp Lumens: 1201.9 lm
Efficiency: 100%
Upward Ratio: 0%

Central Intensity: 4862.18 cd
Pos of Max. Intensity: H0 V3
S/MH(C90/C270): 0.44

Picture Of Luminaire

Luminous Intensity Distribution Curve

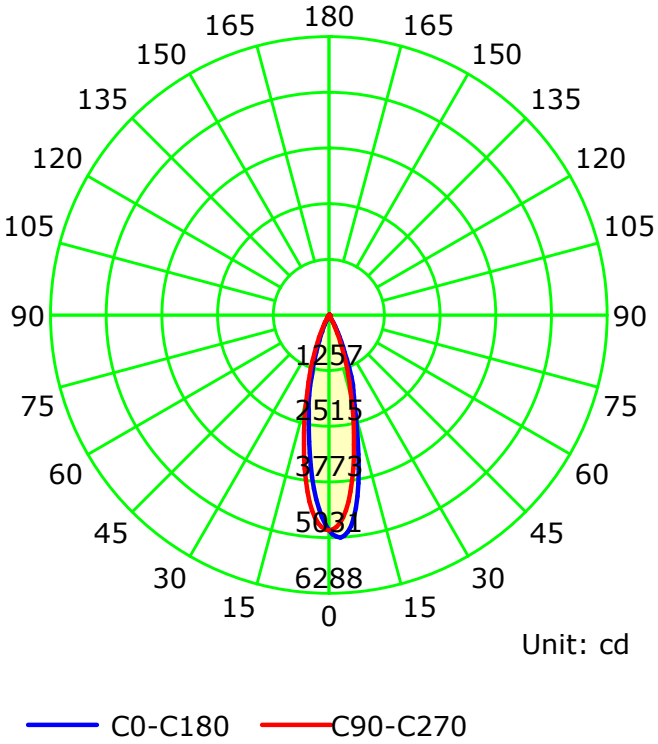

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve

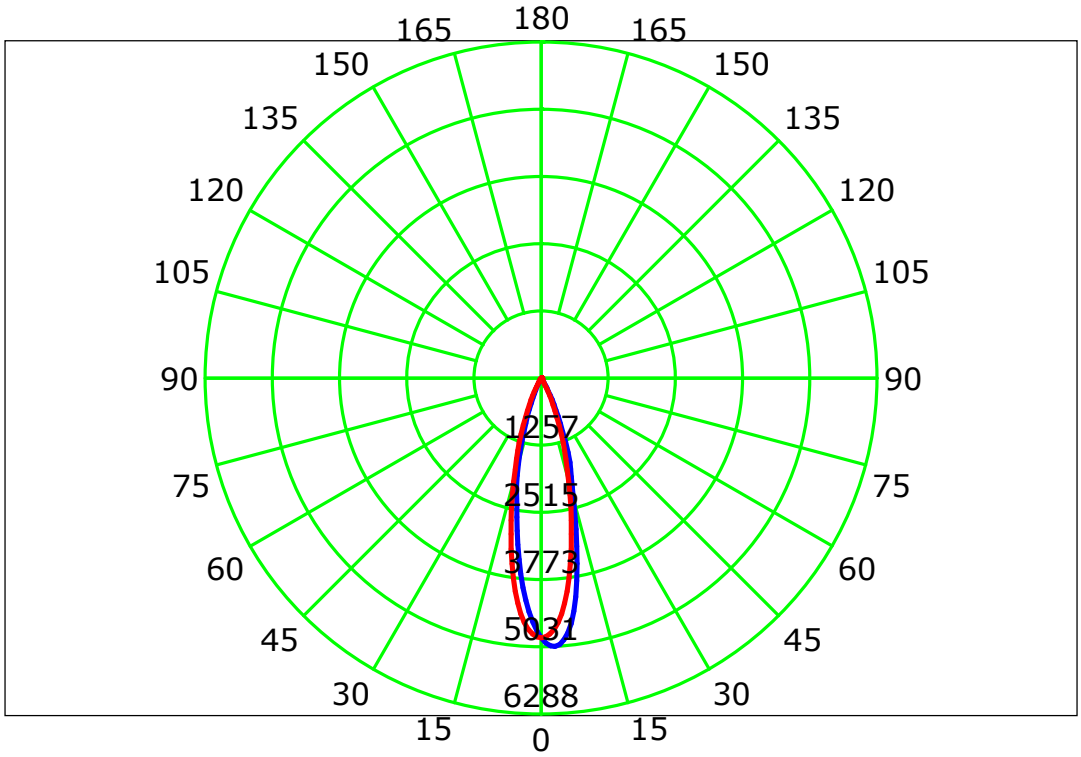

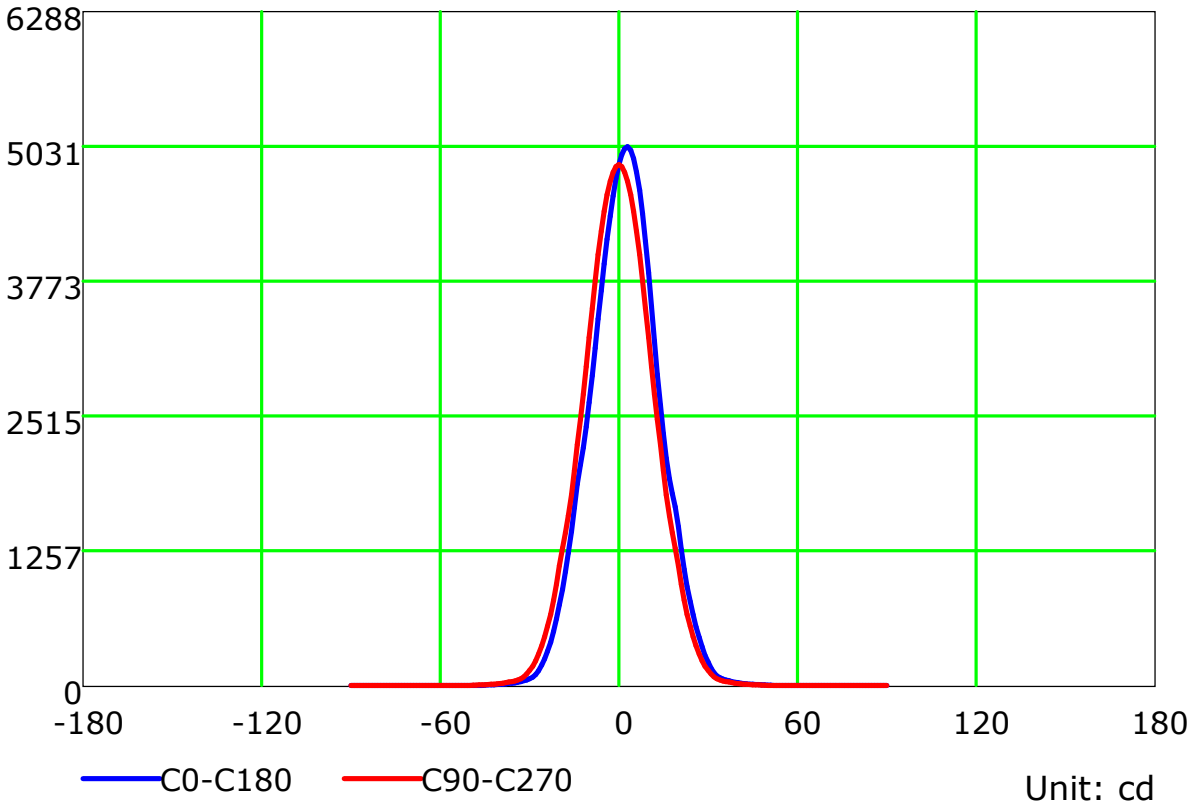

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

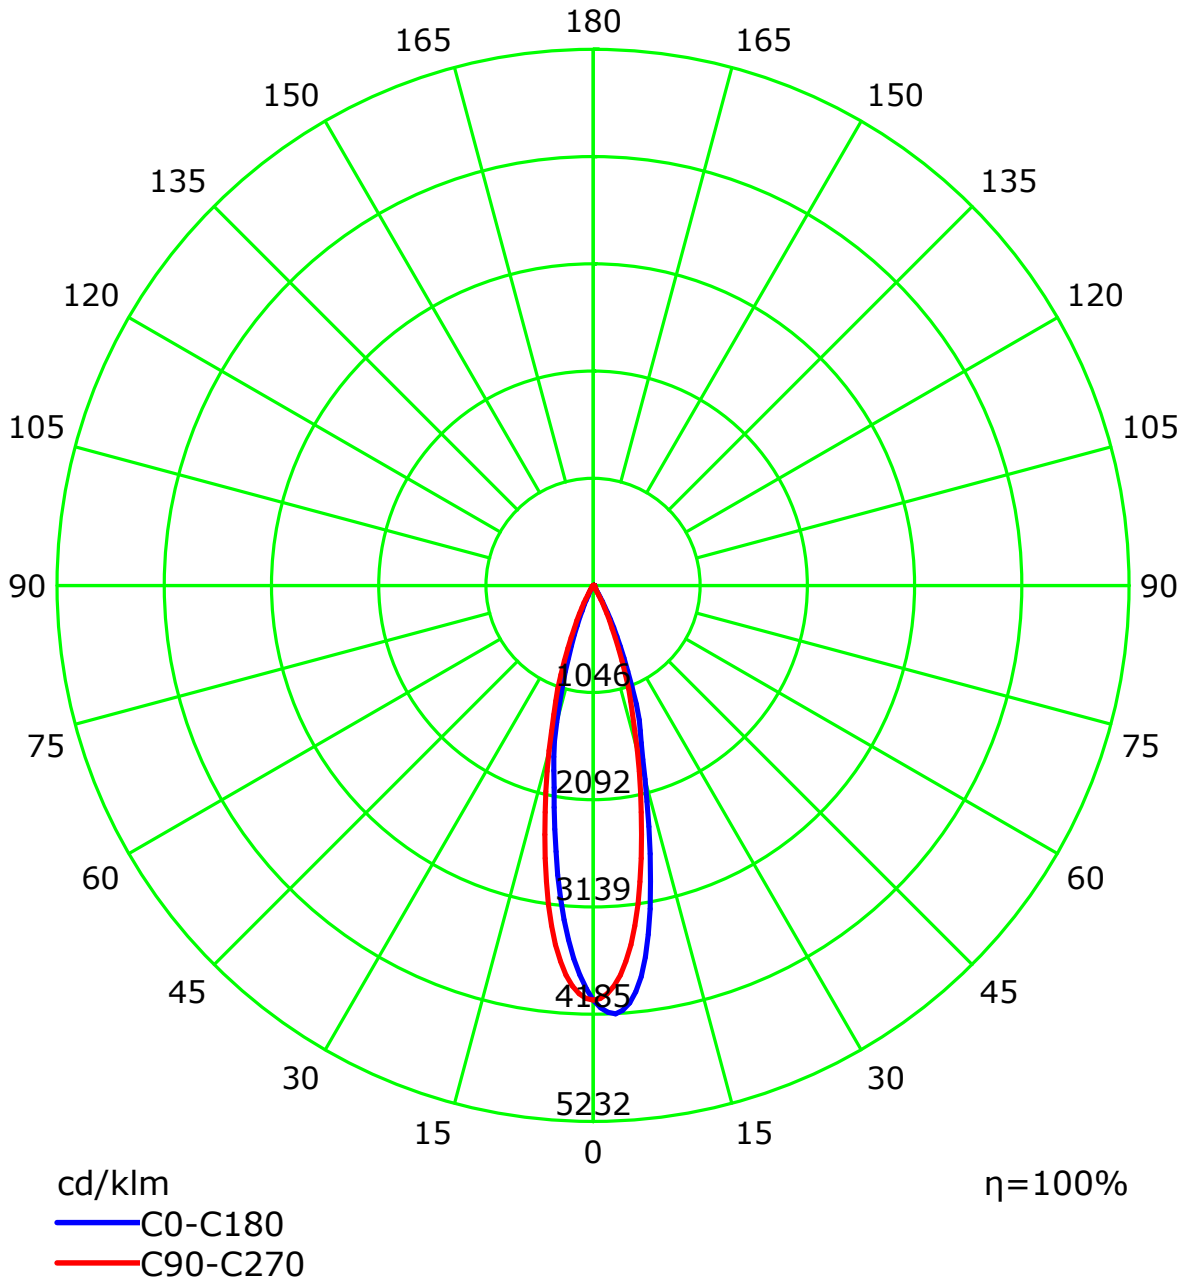

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

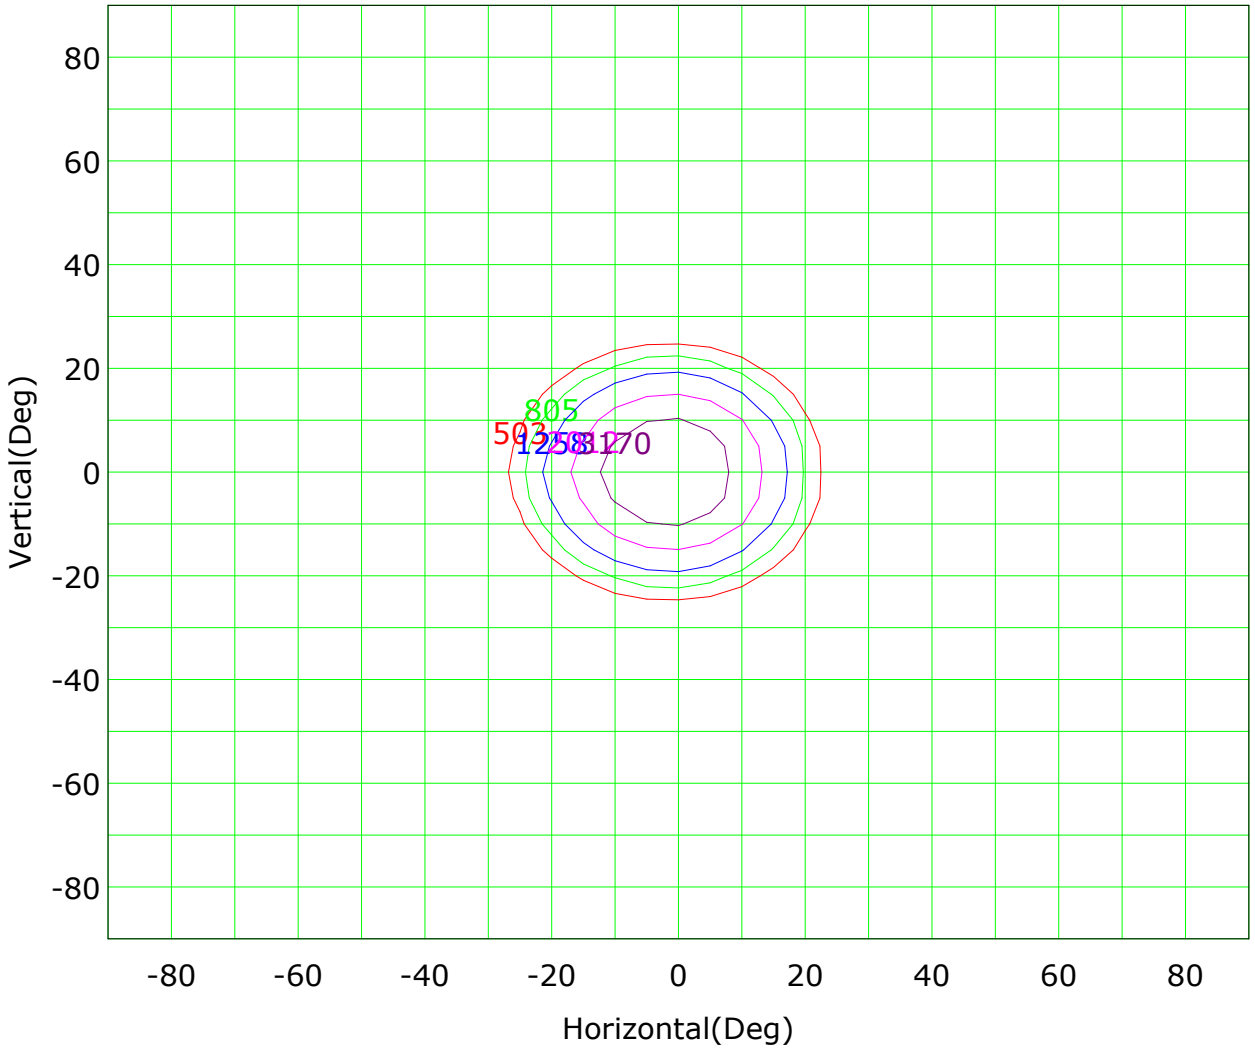

Imax (100%): 5031 cd

(10%): 503 cd
(16%): 805 cd
(25%): 1258 cd
(40%): 2012 cd
(63%): 3170 cd
(100%): 5031 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

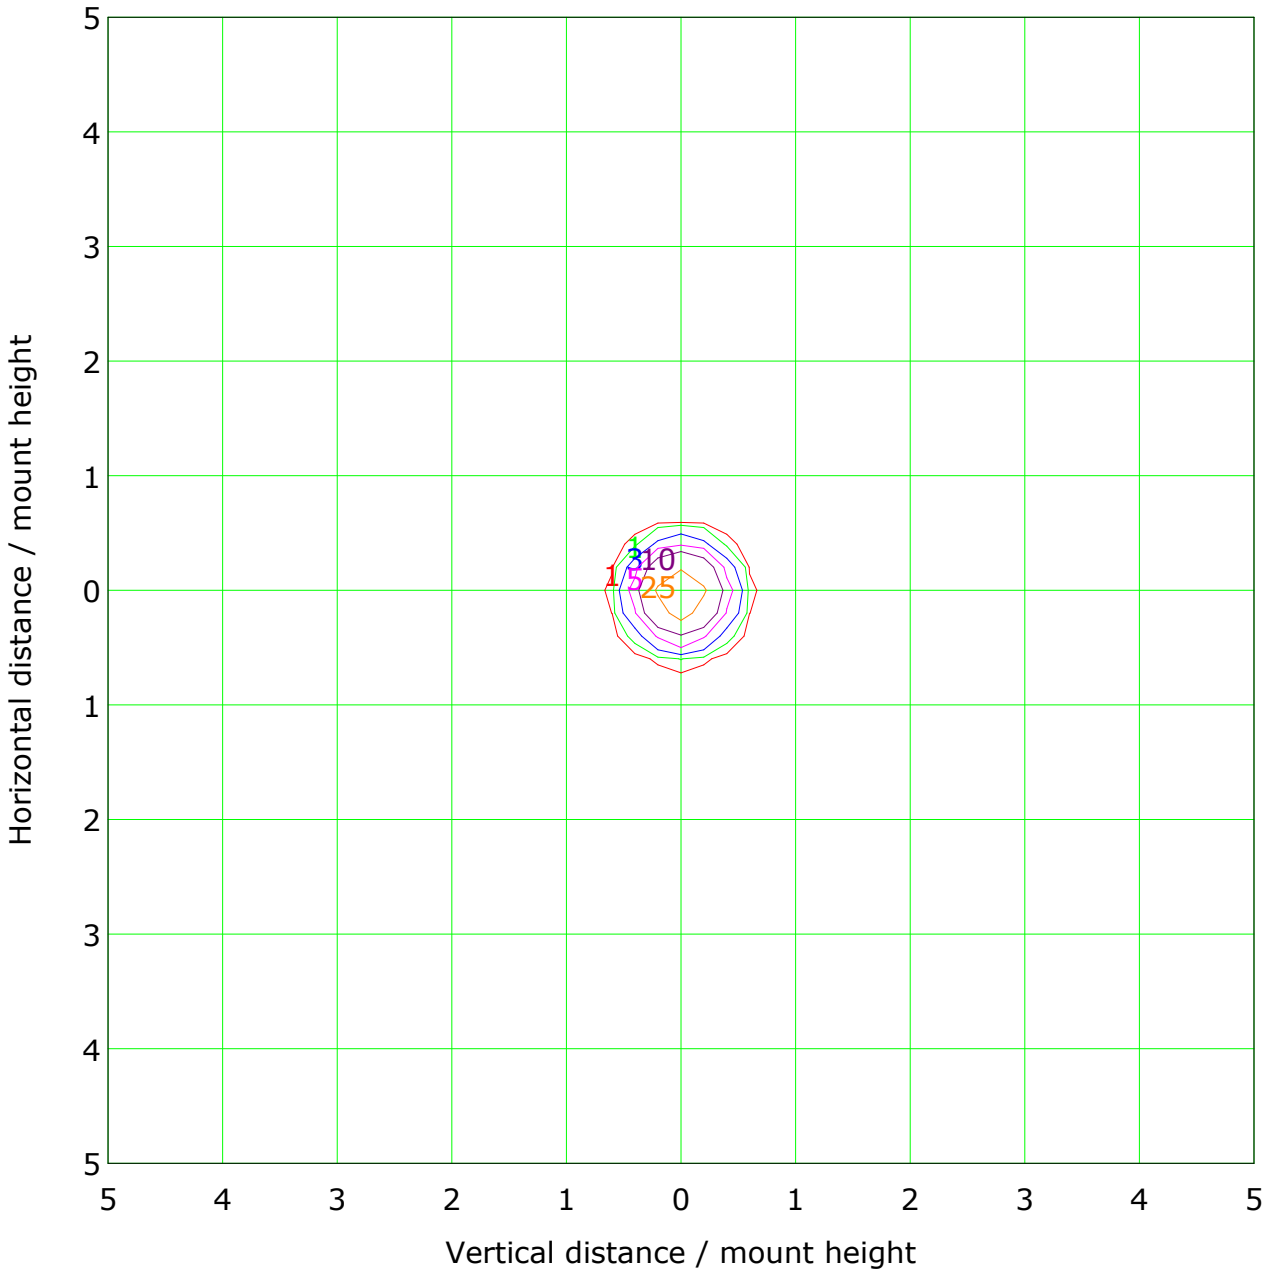

Mounting Height: 10.0m Max Lux(100%): 50.1 lx

(1%): 0.5 lx	(2%): 1.0 lx
(5%): 2.5 lx	(10%): 5.0 lx
(20%): 10.0 lx	(50%): 25.1 lx
(100%): 50.1 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Illuminance at a Distance

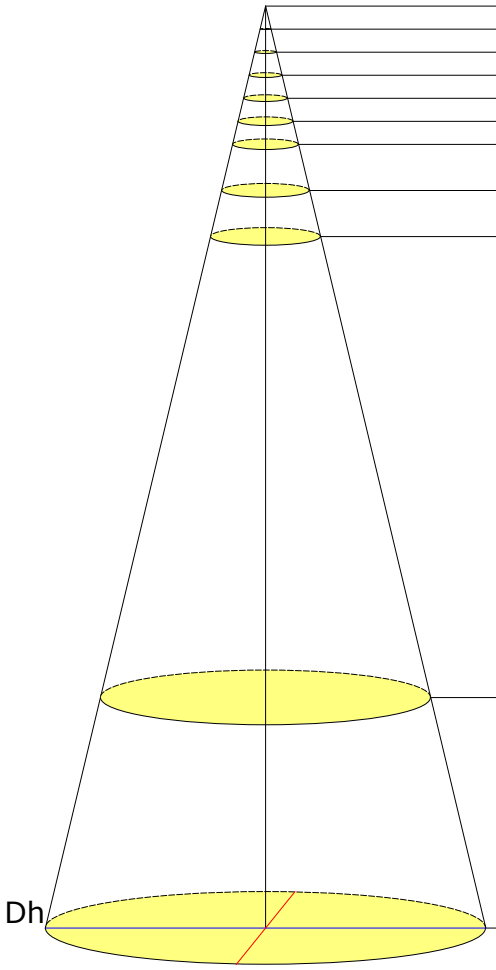

Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	19448.72	0.22/0.24	0.0	9689.82
1.0	4862.18	0.44/0.47	0.2	2422.45
1.5	2160.97	0.66/0.71	0.4	1076.65
2.0	1215.55	0.88/0.94	0.6	605.61
2.5	777.95	1.11/1.18	1.0	387.59
3.0	540.24	1.33/1.41	1.4	269.16
4.0	303.89	1.77/1.88	2.5	151.40
5.0	194.49	2.21/2.35	4.0	96.90
15.0	21.61	6.63/7.05	35.7	10.77
20.0	12.16	8.85/9.40	63.5	6.06

Beam Angle(B): H24.9 V26.5 Field Angle(F): H48.5 V49.4

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

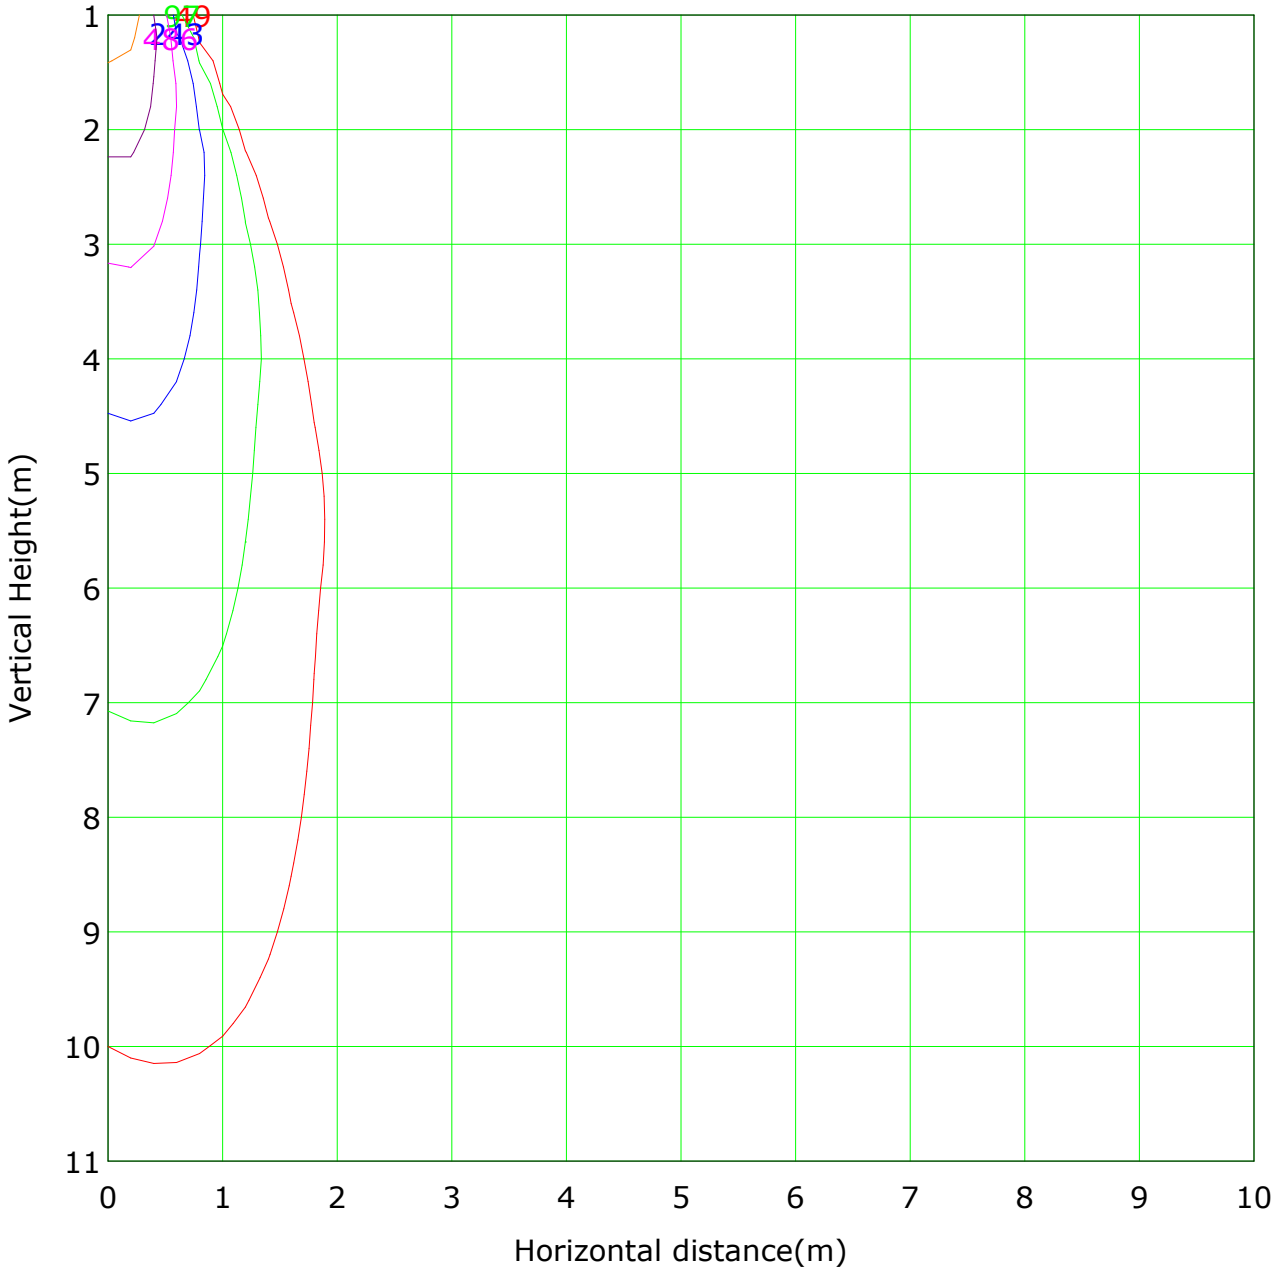

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 4862.2 lx

(1%): 48.6 lx
(2%): 97.2 lx
(5%): 243.1 lx
(10%): 486.2 lx
(20%): 972.4 lx
(50%):2431.1 lx
(100%):4862.2 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

中山雅大光电有限公司
www.artdon.cn
0760-22211886
0760-22211890

Area Flux Table

Unit: lm

Vertical plane	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.3	0.3	0.2	0.1	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	
-40	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.8	1.5	1.6	1.0	0.5	0.2	0.0	0.0	0.0	0.0	0.0	6.0	0.0	
-30	0.0	0.0	0.0	0.0	0.0	0.3	1.2	5.4	13.0	14.5	7.6	1.9	0.5	0.1	0.0	0.0	0.0	0.0	44.5	19.6	
-20	0.0	0.0	0.0	0.0	0.1	0.5	4.1	23.5	53.7	58.4	32.5	8.2	1.0	0.2	0.0	0.0	0.0	0.0	182.2	167.4	
-10	0.0	0.0	0.0	0.0	0.1	0.8	8.0	45.4	106.5	122.8	63.6	17.4	1.8	0.3	0.0	0.0	0.0	0.0	366.7	354.6	
0	0.0	0.0	0.0	0.0	0.1	0.8	8.0	45.4	106.5	122.8	63.6	17.4	1.8	0.3	0.0	0.0	0.0	0.0	366.7	354.6	
10	0.0	0.0	0.0	0.0	0.1	0.5	4.1	23.5	53.7	58.4	32.5	8.2	1.0	0.2	0.0	0.0	0.0	0.0	182.2	167.4	
20	0.0	0.0	0.0	0.0	0.0	0.3	1.2	5.4	13.0	14.5	7.6	1.9	0.5	0.1	0.0	0.0	0.0	0.0	44.5	19.6	
30	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.8	1.5	1.6	1.0	0.5	0.2	0.0	0.0	0.0	0.0	0.0	6.0	0.0	
40	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.3	0.3	0.2	0.1	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	
50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Flux(T)	0.0	0.0	0.0	0.0	0.4	3.3	27.3	150.6	349.9	395.2	210.0	56.2	7.0	1.2	0.0	0.0	0.0	0.0	1201		
Flux(E)	0.0	0.0	0.0	0.0	0.0	0.0	5.9	133.5	335.6	381.4	194.7	32.2	0.0	0.0	0.0	0.0	0.0	0.0		1083	

Horizontal plane

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

Flux Out: 537.58lm

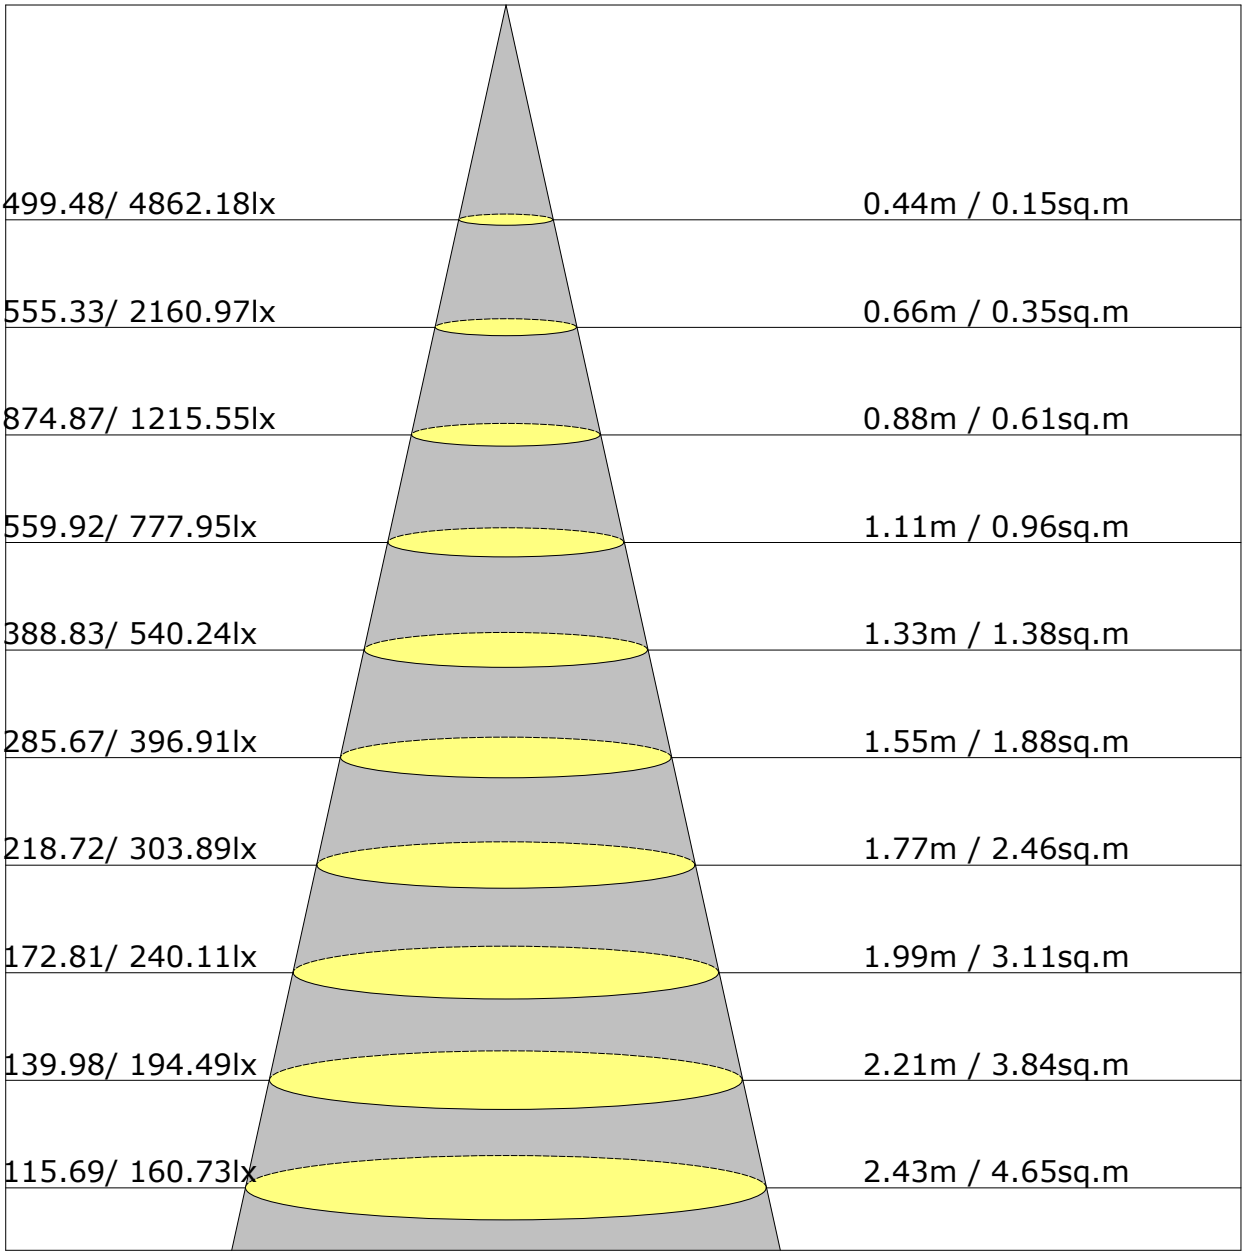

Height	Avg./Nadir. E	Beam Angle:24.9°	Diameter / Area
1.0m	3499.48/ 4862.18lx		0.44m / 0.15sq.m
1.5m	1555.33/ 2160.97lx		0.66m / 0.35sq.m
2.0m	874.87/ 1215.55lx		0.88m / 0.61sq.m
2.5m	559.92/ 777.95lx		1.11m / 0.96sq.m
3.0m	388.83/ 540.24lx		1.33m / 1.38sq.m
3.5m	285.67/ 396.91lx		1.55m / 1.88sq.m
4.0m	218.72/ 303.89lx		1.77m / 2.46sq.m
4.5m	172.81/ 240.11lx		1.99m / 3.11sq.m
5.0m	139.98/ 194.49lx		2.21m / 3.84sq.m
5.5m	115.69/ 160.73lx		2.43m / 4.65sq.m

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	11.0	11.6	11.2	11.8	12.0	9.4	10.0	9.6	10.2	10.4
3H	10.8	11.4	11.1	11.6	11.8	9.2	9.8	9.5	10.0	10.3
4H	10.8	11.3	11.1	11.5	11.8	9.2	9.7	9.5	9.9	10.2
6H	10.7	11.2	11.0	11.4	11.7	9.1	9.6	9.4	9.9	10.1
8H	10.6	11.1	11.0	11.4	11.7	9.1	9.5	9.4	9.8	10.1
12H	10.6	11.1	10.9	11.4	11.7	9.0	9.5	9.4	9.8	10.1
X=4H Y=2H	10.8	11.3	11.1	11.5	11.8	9.2	9.7	9.5	9.9	10.2
3H	10.6	11.1	10.9	11.4	11.7	9.0	9.5	9.4	9.8	10.1
4H	10.5	10.9	10.9	11.3	11.6	8.9	9.3	9.3	9.7	10.0
6H	10.4	10.8	10.8	11.2	11.5	8.8	9.2	9.2	9.6	9.9
8H	10.4	10.7	10.8	11.1	11.5	8.8	9.1	9.2	9.5	9.9
12H	10.3	10.6	10.8	11.0	11.5	8.7	9.0	9.2	9.4	9.9
X=8H Y=4H	10.4	10.7	10.8	11.1	11.5	8.8	9.1	9.2	9.5	9.9
6H	10.3	10.5	10.7	11.0	11.4	8.7	9.0	9.1	9.4	9.8
8H	10.2	10.5	10.7	10.9	11.4	8.6	8.9	9.1	9.3	9.8
12H	10.2	10.4	10.7	10.8	11.3	8.6	8.8	9.1	9.3	9.8
X=12H Y=4H	10.3	10.6	10.8	11.0	11.5	8.7	9.0	9.2	9.4	9.9
6H	10.2	10.5	10.7	10.9	11.4	8.6	8.9	9.1	9.3	9.8
8H	10.2	10.4	10.7	10.8	11.3	8.6	8.8	9.1	9.3	9.8
Variations with the observer position at spacings:										
S=1.0H	+5.9/-1.$					+5.6/-1.$				
S=1.5H	+8.7/-1.$					+8.4/-1.$				
S=2.0H	+10.7/-1.$					+10.4/-1.$				

Calculate in accordance with CIE Pub.117. The table is revised with 1202lm (8log(F/F0) = 0.6).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

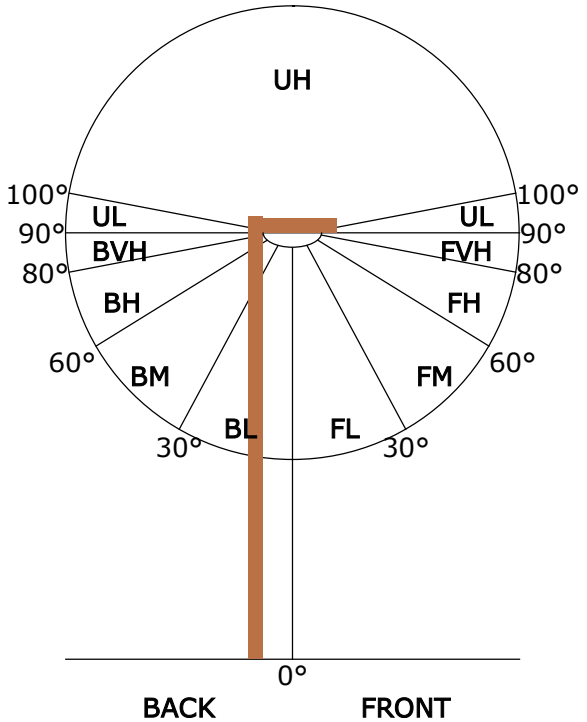

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	670	55.7
FL (0°-30°)	645	53.7
FM (30°-60°)	25	2.1
FH (60°-80°)	0	0.0
FVH (80°-90°)	0	0.0
BACK LIGHT	532	44.3
BL (0°-30°)	516	43.0
BM (30°-60°)	16	1.3
BH (60°-80°)	0	0.0
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	4853.1	4.6	4.6	0.39	0.39
1.0-2.0	4817.3	13.8	18.5	1.15	1.54
2.0-3.0	4748.4	22.7	41.2	1.89	3.43
3.0-4.0	4644.0	31.1	72.3	2.59	6.01
4.0-5.0	4504.1	38.8	111.0	3.22	9.24
5.0-6.0	4333.0	45.5	156.6	3.79	13.03
6.0-7.0	4130.6	51.3	207.8	4.27	17.29
7.0-8.0	3899.9	55.8	263.7	4.64	21.94
8.0-9.0	3648.9	59.1	322.8	4.92	26.86
9.0-10.0	3383.9	61.2	384.1	5.10	31.95
10.0-11.0	3112.2	62.2	446.3	5.17	37.13
11.0-12.0	2848.3	62.3	508.5	5.18	42.31
12.0-13.0	2602.6	61.8	570.3	5.14	47.45
13.0-14.0	2366.3	60.6	630.9	5.04	52.49
14.0-15.0	2127.3	58.4	689.3	4.86	57.35
15.0-16.0	1893.6	55.5	744.8	4.62	61.97
16.0-17.0	1682.2	52.4	797.2	4.36	66.33
17.0-18.0	1505.0	49.6	846.8	4.13	70.45
18.0-19.0	1355.0	47.1	893.9	3.92	74.38
19.0-20.0	1201.2	44.0	937.9	3.66	78.04
20.0-21.0	1032.7	39.7	977.6	3.30	81.34
21.0-22.0	871.4	35.0	1012.6	2.91	84.25
22.0-23.0	730.5	30.7	1043.3	2.55	86.80
23.0-24.0	609.1	26.6	1069.9	2.22	89.02
24.0-25.0	504.3	22.9	1092.8	1.91	90.92
25.0-26.0	413.1	19.5	1112.3	1.62	92.55
26.0-27.0	332.8	16.3	1128.6	1.35	93.90
27.0-28.0	263.8	13.4	1142.0	1.11	95.01
28.0-29.0	206.9	10.8	1152.8	0.90	95.91
29.0-30.0	161.7	8.7	1161.5	0.73	96.64
30.0-31.0	125.1	7.0	1168.5	0.58	97.22
31.0-32.0	95.4	5.5	1174.0	0.45	97.67
32.0-33.0	73.9	4.4	1178.3	0.36	98.04
33.0-34.0	58.4	3.5	1181.8	0.29	98.33
34.0-35.0	47.5	2.9	1184.8	0.25	98.58
35.0-36.0	40.0	2.5	1187.3	0.21	98.79

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	35.1	2.3	1189.6	0.19	98.98
37.0-38.0	30.2	2.0	1191.6	0.17	99.15
38.0-39.0	24.1	1.6	1193.3	0.14	99.28
39.0-40.0	20.4	1.4	1194.7	0.12	99.40
40.0-41.0	18.1	1.3	1196.0	0.11	99.51
41.0-42.0	15.1	1.1	1197.1	0.09	99.60
42.0-43.0	12.8	0.9	1198.0	0.08	99.68
43.0-44.0	11.3	0.9	1198.9	0.07	99.75
44.0-45.0	9.4	0.7	1199.6	0.06	99.81
45.0-46.0	7.2	0.6	1200.2	0.05	99.86
46.0-47.0	6.0	0.5	1200.7	0.04	99.90
47.0-48.0	4.9	0.4	1201.1	0.03	99.93
48.0-49.0	3.8	0.3	1201.4	0.03	99.95
49.0-50.0	3.0	0.3	1201.6	0.02	99.98
50.0-51.0	1.9	0.2	1201.8	0.01	99.99
51.0-52.0	1.1	0.1	1201.9	0.01	100.00
52.0-53.0	0.4	0.0	1201.9	0.00	100.00
53.0-54.0	0.0	0.0	1201.9	0.00	100.00
54.0-55.0	0.0	0.0	1201.9	0.00	100.00
55.0-56.0	0.0	0.0	1201.9	0.00	100.00
56.0-57.0	0.0	0.0	1201.9	0.00	100.00
57.0-58.0	0.0	0.0	1201.9	0.00	100.00
58.0-59.0	0.0	0.0	1201.9	0.00	100.00
59.0-60.0	0.0	0.0	1201.9	0.00	100.00
60.0-61.0	0.0	0.0	1201.9	0.00	100.00
61.0-62.0	0.0	0.0	1201.9	0.00	100.00
62.0-63.0	0.0	0.0	1201.9	0.00	100.00
63.0-64.0	0.0	0.0	1201.9	0.00	100.00
64.0-65.0	0.0	0.0	1201.9	0.00	100.00
65.0-66.0	0.0	0.0	1201.9	0.00	100.00
66.0-67.0	0.0	0.0	1201.9	0.00	100.00
67.0-68.0	0.0	0.0	1201.9	0.00	100.00
68.0-69.0	0.0	0.0	1201.9	0.00	100.00
69.0-70.0	0.0	0.0	1201.9	0.00	100.00
70.0-71.0	0.0	0.0	1201.9	0.00	100.00
71.0-72.0	0.0	0.0	1201.9	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	0.0	0.0	1201.9	0.00	100.00
73.0-74.0	0.0	0.0	1201.9	0.00	100.00
74.0-75.0	0.0	0.0	1201.9	0.00	100.00
75.0-76.0	0.0	0.0	1201.9	0.00	100.00
76.0-77.0	0.0	0.0	1201.9	0.00	100.00
77.0-78.0	0.0	0.0	1201.9	0.00	100.00
78.0-79.0	0.0	0.0	1201.9	0.00	100.00
79.0-80.0	0.0	0.0	1201.9	0.00	100.00
80.0-81.0	0.0	0.0	1201.9	0.00	100.00
81.0-82.0	0.0	0.0	1201.9	0.00	100.00
82.0-83.0	0.0	0.0	1201.9	0.00	100.00
83.0-84.0	0.0	0.0	1201.9	0.00	100.00
84.0-85.0	0.0	0.0	1201.9	0.00	100.00
85.0-86.0	0.0	0.0	1201.9	0.00	100.00
86.0-87.0	0.0	0.0	1201.9	0.00	100.00
87.0-88.0	0.0	0.0	1201.9	0.00	100.00
88.0-89.0	0.0	0.0	1201.9	0.00	100.00
89.0-90.0	0.0	0.0	1201.9	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	4862.2	4862.2								
G1.0	4955.7	4732.5								
G2.0	5011.4	4569.7								
G3.0	5031.0	4381.2								
G4.0	4996.4	4167.2								
G5.0	4918.0	3935.0								
G6.0	4794.3	3684.7								
G7.0	4622.5	3420.9								
G8.0	4405.4	3151.0								
G9.0	4146.0	2893.2								
G10.0	3853.6	2642.9								
G11.0	3537.0	2415.3								
G12.0	3218.8	2222.3								
G13.0	2905.3	2064.0								
G14.0	2614.3	1881.6								
G15.0	2353.4	1659.9								
G16.0	2122.8	1438.3								
G17.0	1929.8	1237.8								
G18.0	1791.1	1061.4								
G19.0	1669.0	898.6								
G20.0	1483.5	753.8								
G21.0	1270.9	622.7								
G22.0	1085.5	506.6								
G23.0	924.2	405.6								
G24.0	785.5	321.1								
G25.0	661.9	248.8								
G26.0	548.8	193.0								
G27.0	449.3	140.2								
G28.0	361.8	104.0								
G29.0	283.4	78.4								
G30.0	220.1	64.8								
G31.0	162.8	52.8								
G32.0	120.6	45.2								
G33.0	92.0	37.7								
G34.0	72.4	31.7								
G35.0	60.3	25.6								
G36.0	51.3	22.6								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	45.2	21.1								
G38.0	37.7	16.6								
G39.0	30.1	12.1								
G40.0	27.1	12.1								
G41.0	22.6	10.6								
G42.0	19.6	7.5								
G43.0	16.6	7.5								
G44.0	13.6	7.5								
G45.0	12.1	4.5								
G46.0	10.6	1.5								
G47.0	10.6	1.5								
G48.0	7.5	0.0								
G49.0	7.5	0.0								
G50.0	4.5	0.0								
G51.0	3.0	0.0								
G52.0	1.5	0.0								
G53.0	0.0	0.0								
G54.0	0.0	0.0								
G55.0	0.0	0.0								
G56.0	0.0	0.0								
G57.0	0.0	0.0								
G58.0	0.0	0.0								
G59.0	0.0	0.0								
G60.0	0.0	0.0								
G61.0	0.0	0.0								
G62.0	0.0	0.0								
G63.0	0.0	0.0								
G64.0	0.0	0.0								
G65.0	0.0	0.0								
G66.0	0.0	0.0								
G67.0	0.0	0.0								
G68.0	0.0	0.0								
G69.0	0.0	0.0								
G70.0	0.0	0.0								
G71.0	0.0	0.0								
G72.0	0.0	0.0								
G73.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	0.0	0.0								
G75.0	0.0	0.0								
G76.0	0.0	0.0								
G77.0	0.0	0.0								
G78.0	0.0	0.0								
G79.0	0.0	0.0								
G80.0	0.0	0.0								
G81.0	0.0	0.0								
G82.0	0.0	0.0								
G83.0	0.0	0.0								
G84.0	0.0	0.0								
G85.0	0.0	0.0								
G86.0	0.0	0.0								
G87.0	0.0	0.0								
G88.0	0.0	0.0								
G89.0	0.0	0.0								
G90.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: