Report No.: Test Time: 2026-10-06 16:31

Luminaire Property


Luminaire Manufacturer:
Luminaire Description: LITE 45-250MA-24D
Lamp Description: BLX V6HD F90 3000K
Luminous Length (mm): -42
Luminous Width (mm): -42
Voltage: 230.5 V
Current: 0.085 A
Power: 9.90 W
Power Factor: 0.500

Photometric Results

CIE Class: Direct
Total Rated Lamp Lumens: 927.6 lm
Measurement Flux: 927.6 lm
Efficiency: 100%
Downward Ratio: 100%
Upward Ratio: 0%
Horizontal Diffuse Angle(50%): H29
Vertical Diffuse Angle(50%): V29
Luminaire Efficacy Rating (LER): 93.75
Central Intensity: 3571.83 cd
Max. Intensity: 3598.61 cd
Pos of Max. Intensity: H180 V2
S/MH(C0/C180): 0.49
S/MH(C90/C270): 0.49


Picture Of Luminaire


Luminous Intensity Distribution Curve

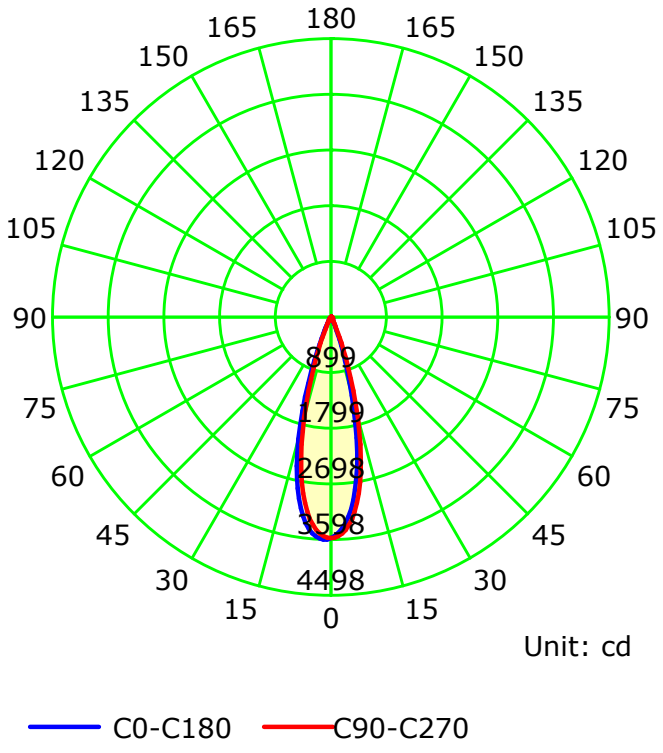

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.218 m
Temperature:
Humidity:
Operator:
Inspector:

Luminous Intensity Distribution Curve

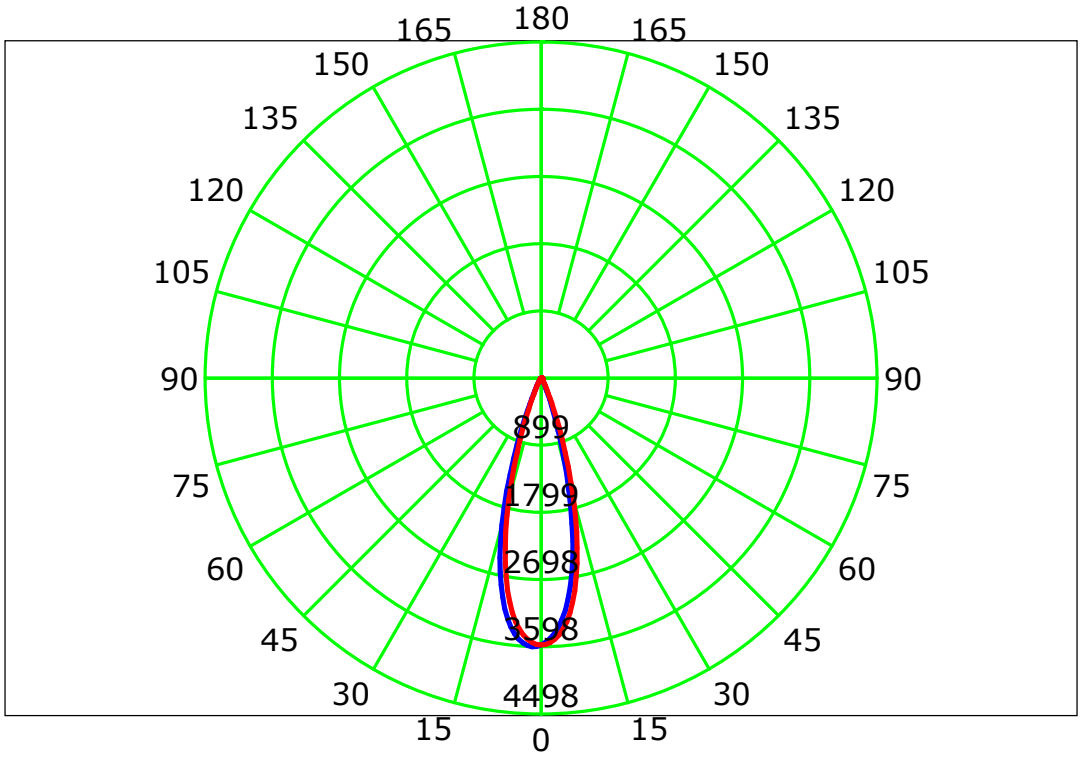


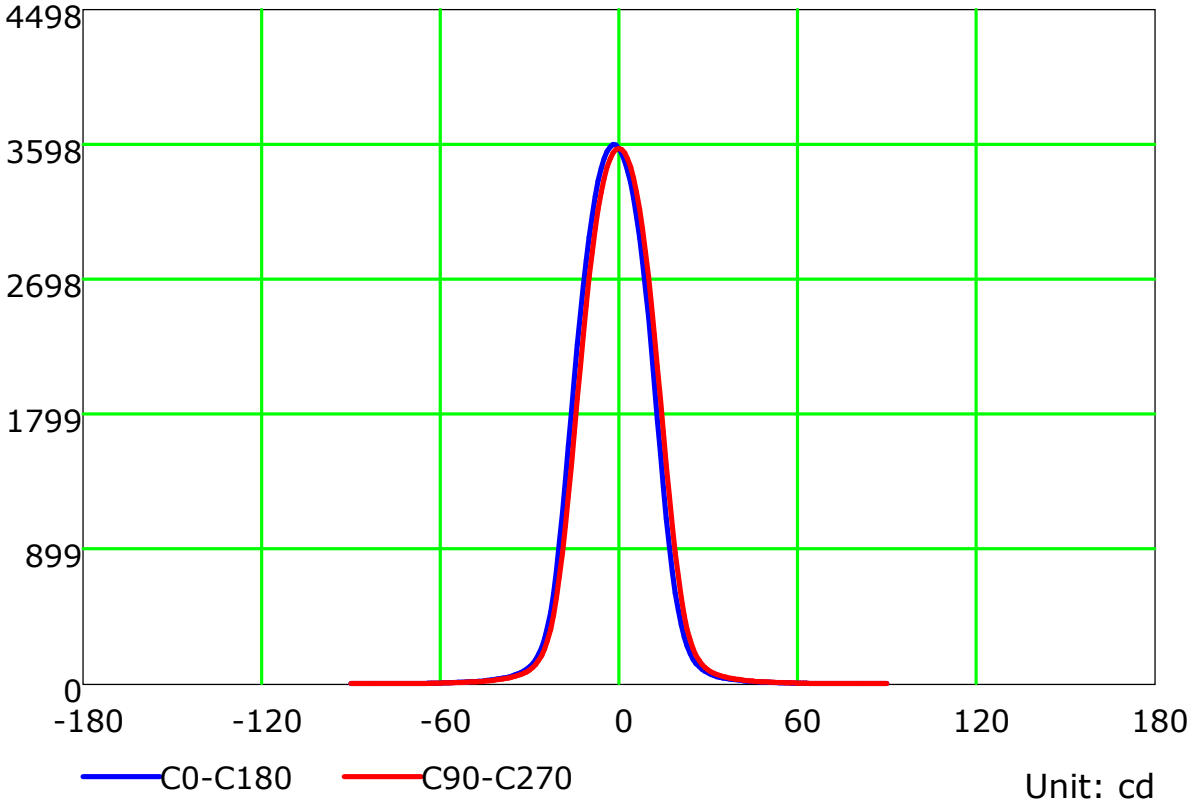

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

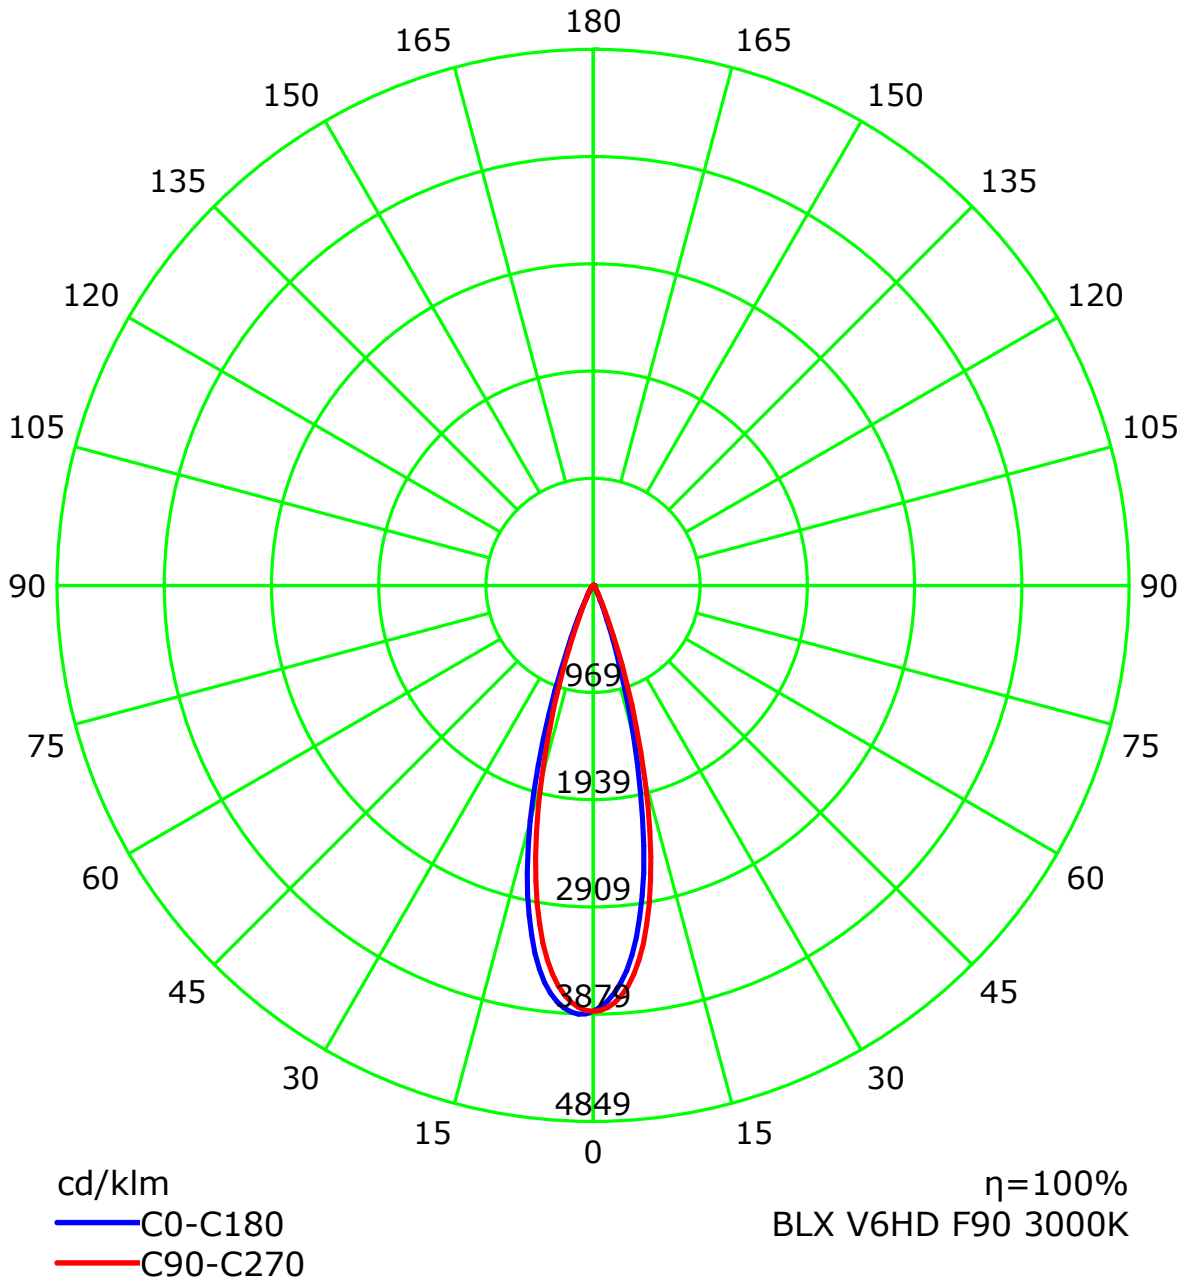

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Isocandela (rectangle)

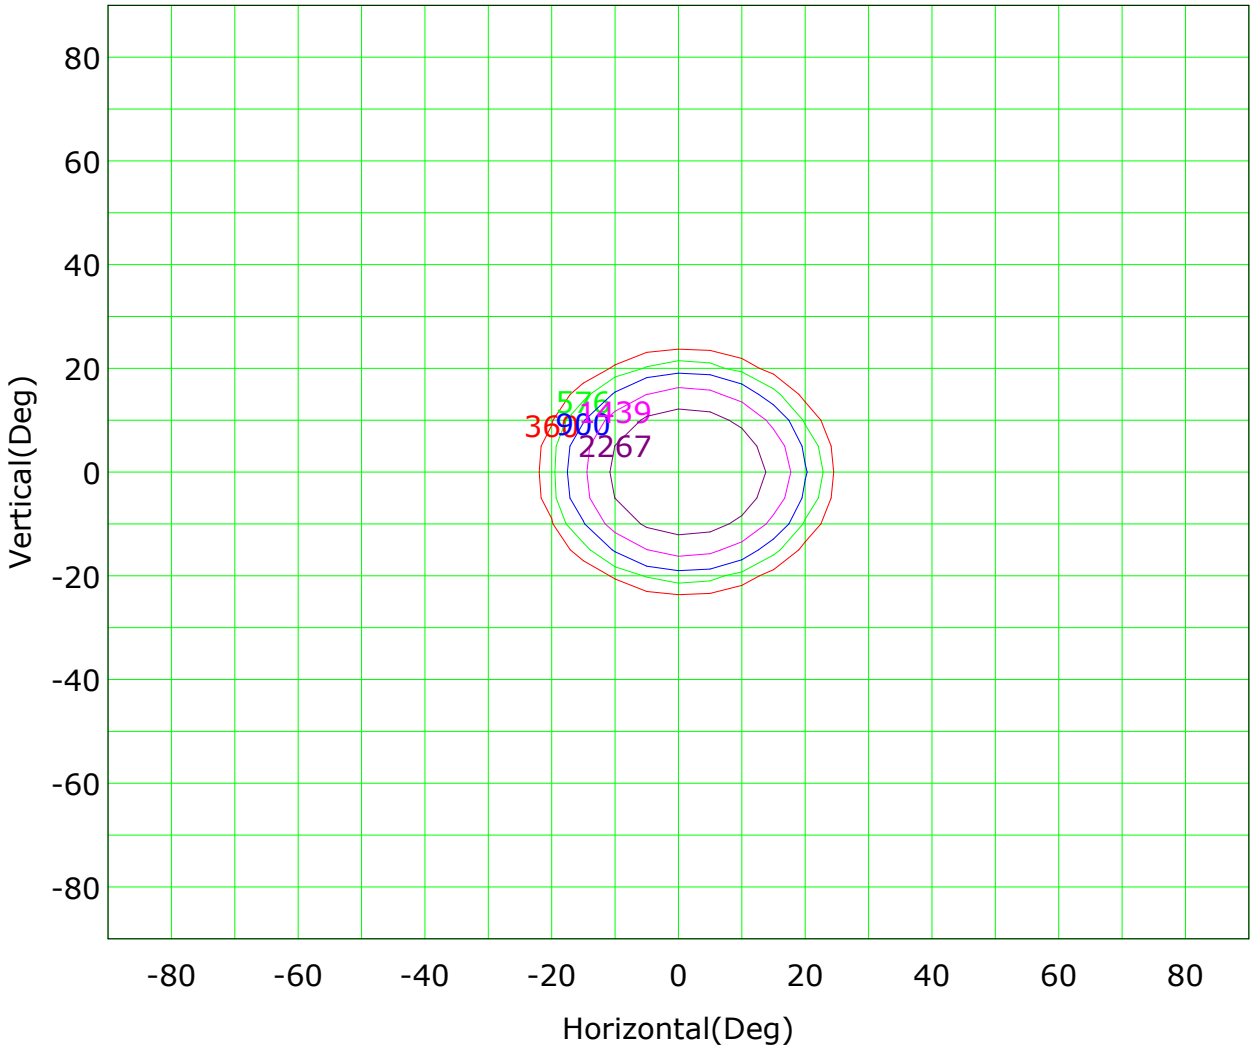


Imax (100%): 3599 cd

(10%): 360 cd
(16%): 576 cd
(25%): 900 cd
(40%): 1439 cd
(63%): 2267 cd
(100%): 3599 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.218 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

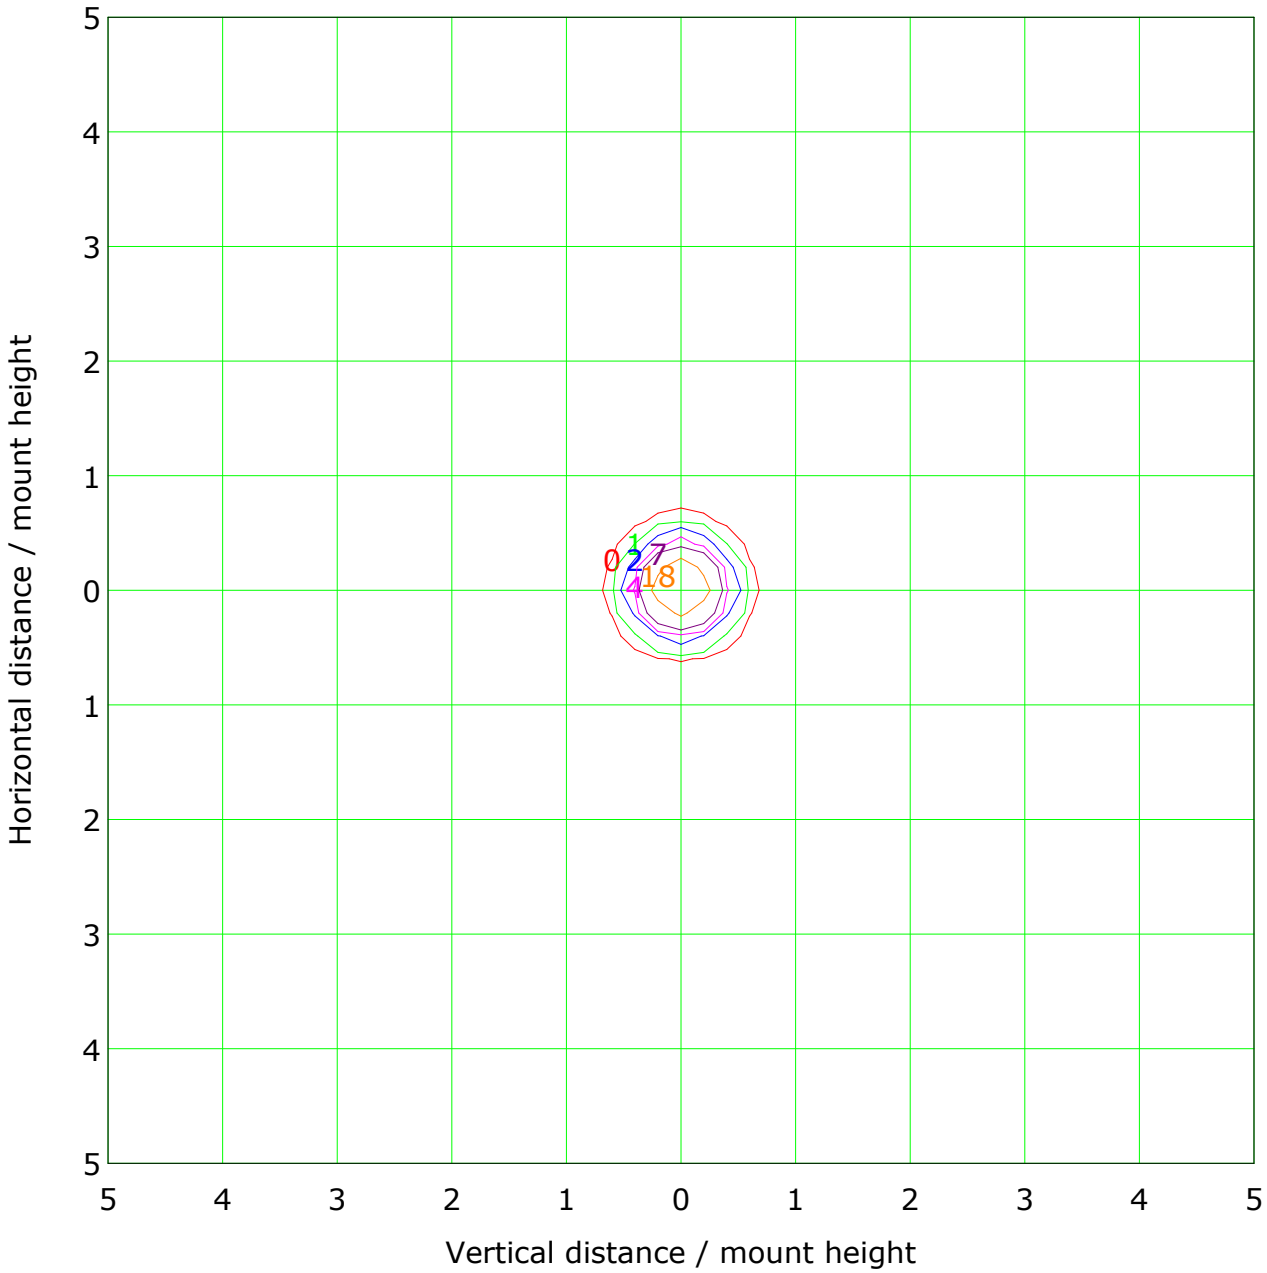


Mounting Height: 10.0m Max Lux(100%): 35.9 lx

(1%): 0.4 lx
(2%): 0.7 lx
(5%): 1.8 lx
(10%): 3.6 lx
(20%): 7.2 lx
(50%): 18.0 lx
(100%): 35.9 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.218 m
Temperature:
Humidity:
Operator:
Inspector:

Illuminance at a Distance

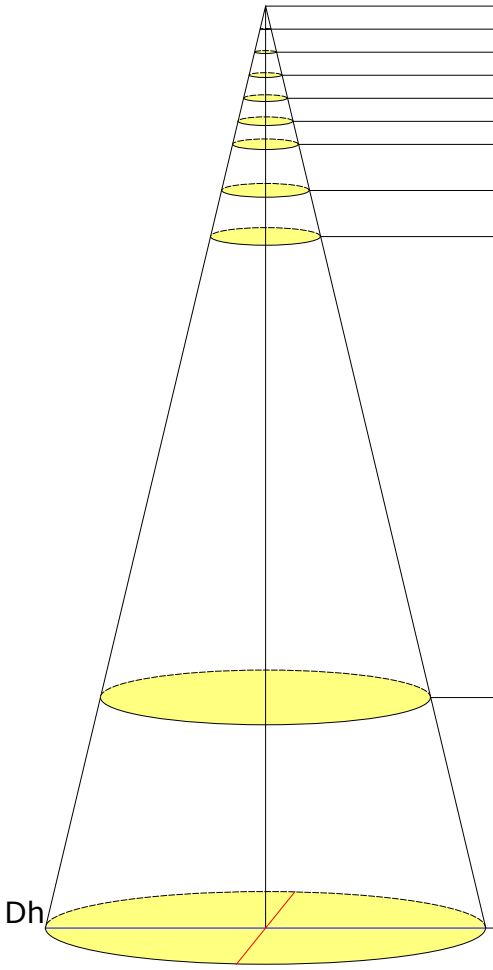


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	14287.32	0.26/0.26	0.1	6865.01
1.0	3571.83	0.52/0.52	0.2	1716.25
1.5	1587.48	0.77/0.78	0.5	762.78
2.0	892.96	1.03/1.04	0.8	429.06
2.5	571.49	1.29/1.29	1.3	274.60
3.0	396.87	1.55/1.55	1.9	190.69
4.0	223.24	2.06/2.07	3.4	107.27
5.0	142.87	2.58/2.59	5.3	68.65
15.0	15.87	7.73/7.77	47.3	7.63
20.0	8.93	10.31/10.35	84.0	4.29

Beam Angle(B): H28.9 V29.0 Field Angle(F): H45.7 V46.1

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Vertical IsoLux Plot

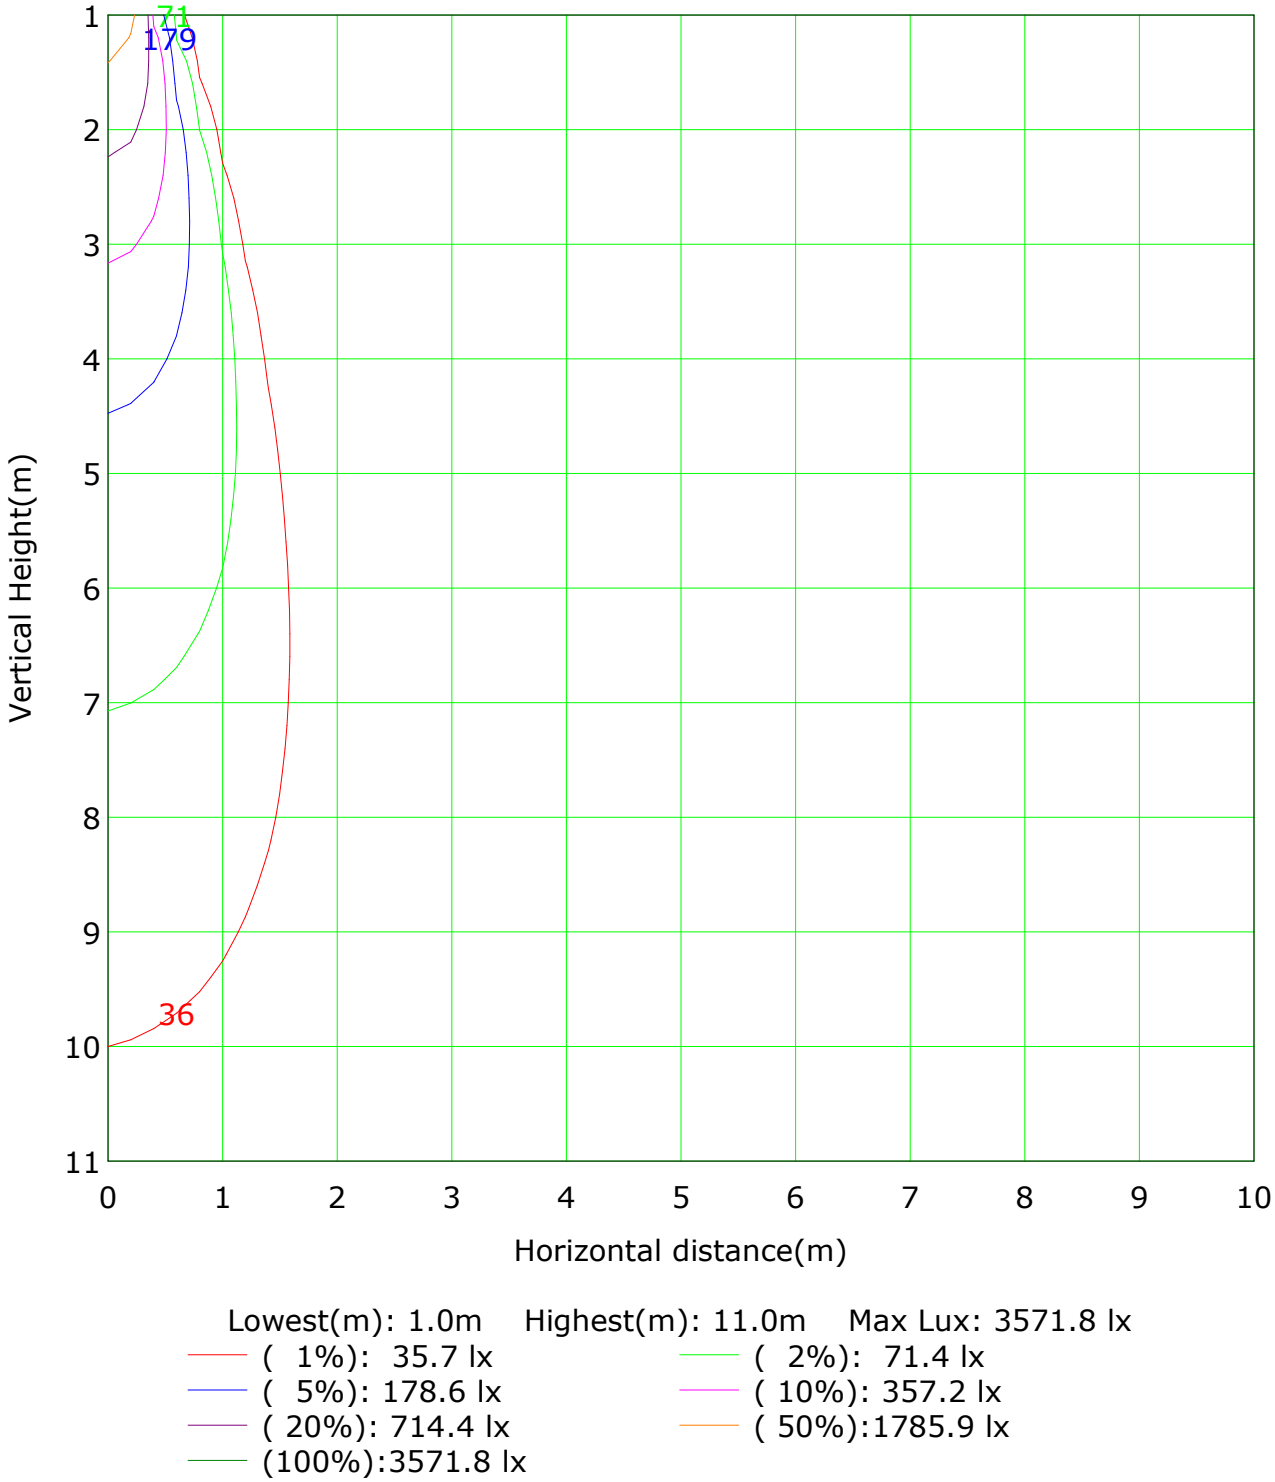

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3571.8 lx

(1%): 35.7 lx
(2%): 71.4 lx
(5%): 178.6 lx
(10%): 357.2 lx
(20%): 714.4 lx
(50%):1785.9 lx
(100%):3571.8 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.218 m
Temperature:
Humidity:
Operator:
Inspector:

Area Flux Table


Unit: lm

Horizontal plane	Vertical plane																							
	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0
-60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.9	0.0
-50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.4	0.4	0.4	0.3	0.2	0.1	0.0	0.0	0.0	0.0	2.7	0.0
-40	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.4	1.1	1.5	1.5	1.1	0.7	0.4	0.2	0.1	0.0	0.0	7.7	0.0
-30	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.7	1.6	4.2	8.9	8.9	4.2	1.6	0.7	0.3	0.1	0.0	0.0	31.8	11.8
-20	0.0	0.0	0.0	0.0	0.1	0.2	0.4	1.2	4.1	21.2	51.1	51.1	21.2	4.1	1.2	0.4	0.2	0.1	0.0	156.3	141.6
-10	0.0	0.0	0.0	0.0	0.1	0.2	0.5	1.5	8.0	46.8	94.2	94.2	46.8	8.0	1.5	0.5	0.2	0.1	0.0	302.6	289.8
0	0.0	0.0	0.0	0.0	0.1	0.2	0.5	1.5	7.4	42.8	87.9	87.9	42.8	7.4	1.5	0.5	0.2	0.1	0.0	280.8	267.9
10	0.0	0.0	0.0	0.0	0.1	0.2	0.4	1.0	3.4	15.7	36.3	36.3	15.7	3.4	1.0	0.4	0.2	0.1	0.0	114.1	98.1
20	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.6	1.3	2.9	5.2	5.2	2.9	1.3	0.6	0.3	0.1	0.0	0.0	20.9	1.9
30	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.5	0.8	1.0	1.0	0.8	0.5	0.3	0.2	0.1	0.0	0.0	0.0	5.8	0.0
40	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.3	0.3	0.3	0.3	0.2	0.1	0.0	0.0	0.0	0.0	0.0	2.1	0.0
50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.7	0.0
60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Flux(T)	0.0	0.0	0.2	0.9	2.7	7.7	31.8	156.3	302.6	280.8	114.1	20.9	5.8	2.1	0.7	0.2	0.0	0.0	0.0	927	
Flux(E)	0.0	0.0	0.0	0.0	0.0	0.0	11.8	141.6	289.8	267.9	98.1	1.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	811

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

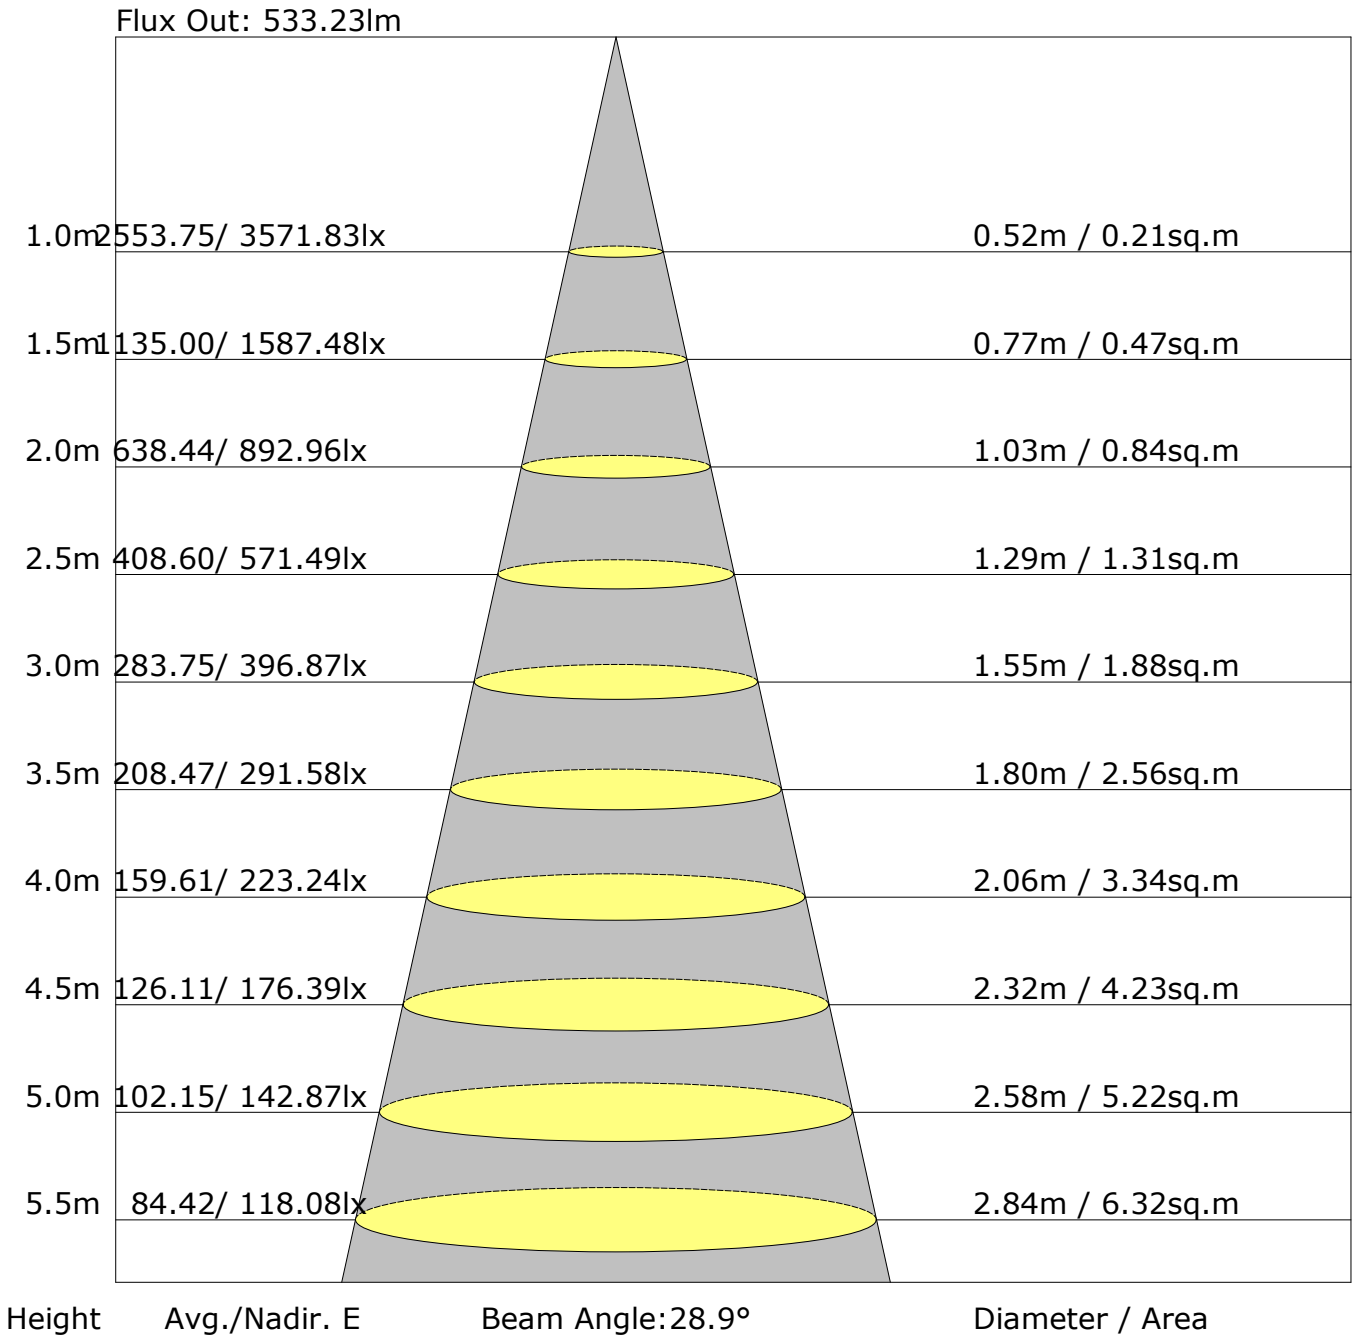

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

UGR Table


Reflectance: Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	11.0	11.7	11.3	11.8	12.0	11.8	12.4	12.1	12.6	12.8
3H	11.0	11.6	11.3	11.8	12.0	11.8	12.3	12.1	12.6	12.8
4H	10.9	11.5	11.2	11.7	12.0	11.7	12.3	12.0	12.5	12.8
6H	10.9	11.4	11.2	11.6	11.9	11.6	12.1	12.0	12.4	12.7
8H	10.8	11.3	11.2	11.6	11.9	11.6	12.1	11.9	12.4	12.7
12H	10.8	11.2	11.1	11.5	11.9	11.6	12.0	11.9	12.3	12.6
X=4H Y=2H	11.0	11.5	11.3	11.8	12.0	11.7	12.3	12.0	12.5	12.8
3H	11.0	11.4	11.3	11.7	12.0	11.7	12.2	12.1	12.5	12.8
4H	10.9	11.3	11.3	11.6	12.0	11.6	12.0	12.0	12.4	12.7
6H	10.8	11.2	11.2	11.5	11.9	11.5	11.9	11.9	12.3	12.7
8H	10.8	11.1	11.2	11.5	11.9	11.5	11.8	11.9	12.2	12.6
12H	10.7	11.0	11.1	11.4	11.8	11.4	11.7	11.9	12.2	12.6
X=8H Y=4H	10.8	11.1	11.2	11.5	11.9	11.5	11.8	11.9	12.2	12.6
6H	10.7	10.9	11.1	11.4	11.8	11.4	11.7	11.9	12.1	12.6
8H	10.6	10.9	11.1	11.3	11.8	11.4	11.6	11.8	12.0	12.5
12H	10.6	10.8	11.1	11.2	11.7	11.3	11.5	11.8	12.0	12.5
X=12H Y=4H	10.7	11.0	11.2	11.4	11.9	11.5	11.8	11.9	12.2	12.6
6H	10.6	10.9	11.1	11.3	11.8	11.4	11.6	11.8	12.0	12.5
8H	10.6	10.8	11.1	11.2	11.7	11.3	11.5	11.8	12.0	12.5
Variations with the observer position at spacings:										
S=1.0H	+2.8/-3.5					+3.2/-3.5				
S=1.5H	+5.1/-6.6					+5.6/-6.7				
S=2.0H	+7.0/-8.9					+7.6/-9.2				

Calculate in accordance with CIE Pub.117. The table is revised with 928lm (8log(F/F0) = -0.3).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

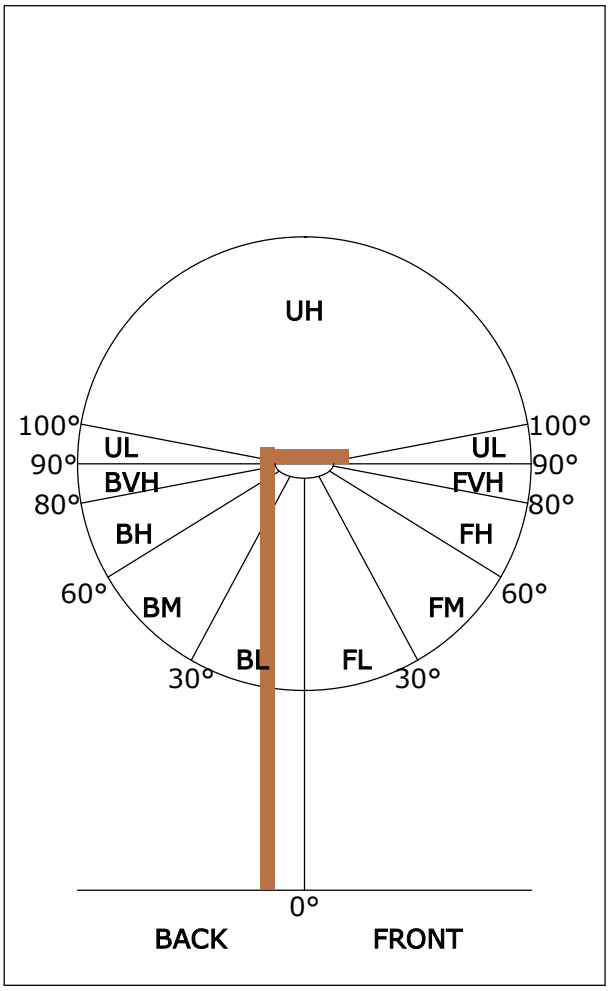

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	425	45.8
FL (0°-30°)	401	43.2
FM (30°-60°)	23	2.5
FH (60°-80°)	1	0.1
FVH (80°-90°)	0	0.0
BACK LIGHT	503	54.2
BL (0°-30°)	473	51.0
BM (30°-60°)	28	3.0
BH (60°-80°)	1	0.1
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(**B**acklight,**U**plight,**G**lare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3569.1	3.4	3.4	0.37	0.37
1.0-2.0	3555.0	10.2	13.6	1.10	1.47
2.0-3.0	3523.4	16.9	30.5	1.82	3.29
3.0-4.0	3475.7	23.3	53.7	2.51	5.79
4.0-5.0	3410.7	29.3	83.1	3.16	8.96
5.0-6.0	3327.1	35.0	118.1	3.77	12.73
6.0-7.0	3223.5	40.0	158.1	4.31	17.04
7.0-8.0	3099.2	44.4	202.4	4.78	21.82
8.0-9.0	2956.7	47.9	250.4	5.17	26.99
9.0-10.0	2797.2	50.6	301.0	5.46	32.45
10.0-11.0	2619.1	52.3	353.3	5.64	38.09
11.0-12.0	2425.2	53.0	406.3	5.72	43.81
12.0-13.0	2221.2	52.7	459.1	5.68	49.49
13.0-14.0	2008.3	51.4	510.5	5.54	55.03
14.0-15.0	1789.0	49.1	559.6	5.30	60.33
15.0-16.0	1568.1	46.0	605.6	4.95	65.28
16.0-17.0	1353.3	42.2	647.7	4.54	69.83
17.0-18.0	1150.0	37.9	685.6	4.09	73.91
18.0-19.0	962.3	33.5	719.1	3.61	77.52
19.0-20.0	793.9	29.1	748.2	3.13	80.66
20.0-21.0	644.7	24.8	772.9	2.67	83.33
21.0-22.0	515.5	20.7	793.7	2.23	85.56
22.0-23.0	409.6	17.2	810.8	1.85	87.41
23.0-24.0	325.9	14.2	825.1	1.54	88.95
24.0-25.0	260.3	11.8	836.9	1.28	90.22
25.0-26.0	209.8	9.9	846.8	1.07	91.29
26.0-27.0	171.1	8.4	855.2	0.90	92.20
27.0-28.0	141.1	7.1	862.4	0.77	92.97
28.0-29.0	117.7	6.2	868.5	0.66	93.63
29.0-30.0	99.7	5.4	873.9	0.58	94.21
30.0-31.0	85.4	4.8	878.6	0.51	94.72
31.0-32.0	73.9	4.2	882.9	0.46	95.18
32.0-33.0	64.6	3.8	886.7	0.41	95.59
33.0-34.0	57.0	3.4	890.1	0.37	95.96
34.0-35.0	50.9	3.2	893.3	0.34	96.30
35.0-36.0	45.7	2.9	896.2	0.31	96.62

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	40.6	2.7	898.9	0.29	96.90
37.0-38.0	36.3	2.4	901.3	0.26	97.16
38.0-39.0	33.0	2.3	903.5	0.24	97.41
39.0-40.0	30.0	2.1	905.6	0.23	97.63
40.0-41.0	27.2	1.9	907.6	0.21	97.84
41.0-42.0	24.5	1.8	909.3	0.19	98.03
42.0-43.0	21.6	1.6	911.0	0.17	98.20
43.0-44.0	19.5	1.5	912.4	0.16	98.36
44.0-45.0	17.9	1.4	913.8	0.15	98.51
45.0-46.0	16.0	1.3	915.1	0.14	98.65
46.0-47.0	14.2	1.1	916.2	0.12	98.77
47.0-48.0	13.0	1.1	917.2	0.11	98.88
48.0-49.0	12.1	1.0	918.2	0.11	98.99
49.0-50.0	11.2	0.9	919.2	0.10	99.09
50.0-51.0	10.3	0.9	920.0	0.09	99.18
51.0-52.0	9.5	0.8	920.8	0.09	99.27
52.0-53.0	8.8	0.8	921.6	0.08	99.35
53.0-54.0	7.9	0.7	922.3	0.08	99.43
54.0-55.0	7.1	0.6	922.9	0.07	99.50
55.0-56.0	6.3	0.6	923.5	0.06	99.56
56.0-57.0	5.7	0.5	924.0	0.06	99.61
57.0-58.0	5.1	0.5	924.5	0.05	99.67
58.0-59.0	4.5	0.4	924.9	0.05	99.71
59.0-60.0	3.9	0.4	925.3	0.04	99.75
60.0-61.0	3.3	0.3	925.6	0.03	99.79
61.0-62.0	3.1	0.3	925.9	0.03	99.82
62.0-63.0	2.7	0.3	926.2	0.03	99.85
63.0-64.0	2.3	0.2	926.4	0.02	99.87
64.0-65.0	1.9	0.2	926.6	0.02	99.89
65.0-66.0	1.7	0.2	926.8	0.02	99.91
66.0-67.0	1.5	0.1	926.9	0.02	99.92
67.0-68.0	1.3	0.1	927.0	0.01	99.94
68.0-69.0	1.2	0.1	927.2	0.01	99.95
69.0-70.0	1.0	0.1	927.3	0.01	99.96
70.0-71.0	0.8	0.1	927.3	0.01	99.97
71.0-72.0	0.7	0.1	927.4	0.01	99.98

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	0.6	0.1	927.5	0.01	99.99
73.0-74.0	0.4	0.0	927.5	0.00	99.99
74.0-75.0	0.3	0.0	927.6	0.00	99.99
75.0-76.0	0.2	0.0	927.6	0.00	100.00
76.0-77.0	0.2	0.0	927.6	0.00	100.00
77.0-78.0	0.1	0.0	927.6	0.00	100.00
78.0-79.0	0.0	0.0	927.6	0.00	100.00
79.0-80.0	0.0	0.0	927.6	0.00	100.00
80.0-81.0	0.0	0.0	927.6	0.00	100.00
81.0-82.0	0.0	0.0	927.6	0.00	100.00
82.0-83.0	0.0	0.0	927.6	0.00	100.00
83.0-84.0	0.0	0.0	927.6	0.00	100.00
84.0-85.0	0.0	0.0	927.6	0.00	100.00
85.0-86.0	0.0	0.0	927.6	0.00	100.00
86.0-87.0	0.0	0.0	927.6	0.00	100.00
87.0-88.0	0.0	0.0	927.6	0.00	100.00
88.0-89.0	0.0	0.0	927.6	0.00	100.00
89.0-90.0	0.0	0.0	927.6	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3571.8	3571.8								
G1.0	3538.2	3594.6								
G2.0	3488.6	3598.6								
G3.0	3424.3	3582.3								
G4.0	3342.7	3553.5								
G5.0	3240.6	3505.9								
G6.0	3119.5	3442.3								
G7.0	2975.7	3356.5								
G8.0	2813.3	3251.4								
G9.0	2636.6	3125.5								
G10.0	2446.1	2980.8								
G11.0	2226.4	2823.1								
G12.0	1994.4	2656.6								
G13.0	1763.4	2470.1								
G14.0	1536.7	2263.0								
G15.0	1311.9	2044.2								
G16.0	1101.6	1814.9								
G17.0	911.4	1585.5								
G18.0	745.8	1357.4								
G19.0	604.2	1141.7								
G20.0	487.5	942.3								
G21.0	392.6	756.4								
G22.0	313.2	599.8								
G23.0	250.0	475.4								
G24.0	199.6	378.6								
G25.0	162.0	301.2								
G26.0	134.5	241.4								
G27.0	113.4	195.1								
G28.0	96.1	159.8								
G29.0	82.4	132.6								
G30.0	71.1	112.6								
G31.0	61.6	96.4								
G32.0	53.5	84.1								
G33.0	46.7	74.1								
G34.0	41.5	65.6								
G35.0	38.4	58.2								
G36.0	35.3	50.8								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	31.8	44.6								
G38.0	28.8	40.2								
G39.0	26.4	36.5								
G40.0	23.9	33.1								
G41.0	21.8	30.2								
G42.0	19.2	26.6								
G43.0	16.5	24.2								
G44.0	15.1	22.1								
G45.0	14.1	20.3								
G46.0	12.9	17.0								
G47.0	11.7	15.3								
G48.0	11.0	14.1								
G49.0	10.1	13.2								
G50.0	9.6	12.0								
G51.0	8.6	11.0								
G52.0	8.2	10.1								
G53.0	7.2	9.6								
G54.0	6.3	8.6								
G55.0	5.5	7.9								
G56.0	5.0	7.0								
G57.0	4.5	6.2								
G58.0	4.1	5.5								
G59.0	3.8	4.8								
G60.0	2.9	4.1								
G61.0	2.8	3.6								
G62.0	2.6	3.4								
G63.0	2.2	2.8								
G64.0	1.5	2.6								
G65.0	1.7	1.9								
G66.0	1.4	1.7								
G67.0	1.2	1.5								
G68.0	1.2	1.4								
G69.0	0.9	1.2								
G70.0	0.9	1.0								
G71.0	0.5	0.9								
G72.0	0.5	0.9								
G73.0	0.5	0.5								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	0.2	0.5								
G75.0	0.2	0.2								
G76.0	0.2	0.3								
G77.0	0.0	0.3								
G78.0	0.0	0.0								
G79.0	0.0	0.0								
G80.0	0.0	0.0								
G81.0	0.0	0.0								
G82.0	0.0	0.0								
G83.0	0.0	0.0								
G84.0	0.0	0.0								
G85.0	0.0	0.0								
G86.0	0.0	0.0								
G87.0	0.0	0.0								
G88.0	0.0	0.0								
G89.0	0.0	0.0								
G90.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.218 m
Humidity:
Inspector: