Report No.: Test Time: 2026-05-06 17:01

Luminaire Property


Luminaire Manufacturer:
Luminaire Description: 61.02303 4000K
Luminous Length (mm): -49
Luminous Width (mm): -49
Voltage: 233.1 V
Current: 0.088 A
Power: 10.00 W
Power Factor: 0.484

Photometric Results

CIE Class: Direct
Total Rated Lamp Lumens: 668.1 lm
Measurement Flux: 668.1 lm
Efficiency: 100%
Downward Ratio: 100%
Upward Ratio: 0%
Horizontal Diffuse Angle(50%): H22.4
Vertical Diffuse Angle(50%): V22.4
Luminaire Efficacy Rating (LER): 66.86
Central Intensity: 3810.4 cd
Max. Intensity: 3813.86 cd
Pos of Max. Intensity: H180 V1
S/MH(C0/C180): 0.38
S/MH(C90/C270): 0.38


Picture Of Luminaire


Luminous Intensity Distribution Curve

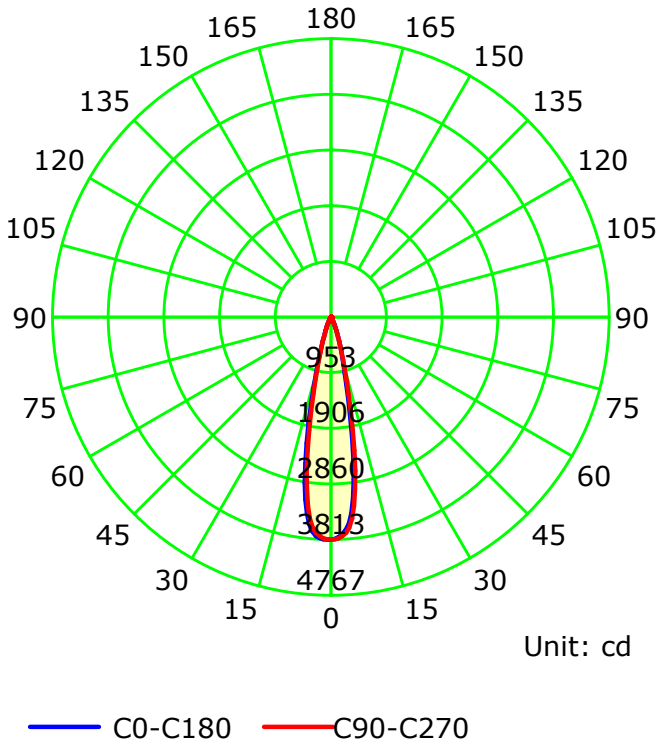

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Luminous Intensity Distribution Curve

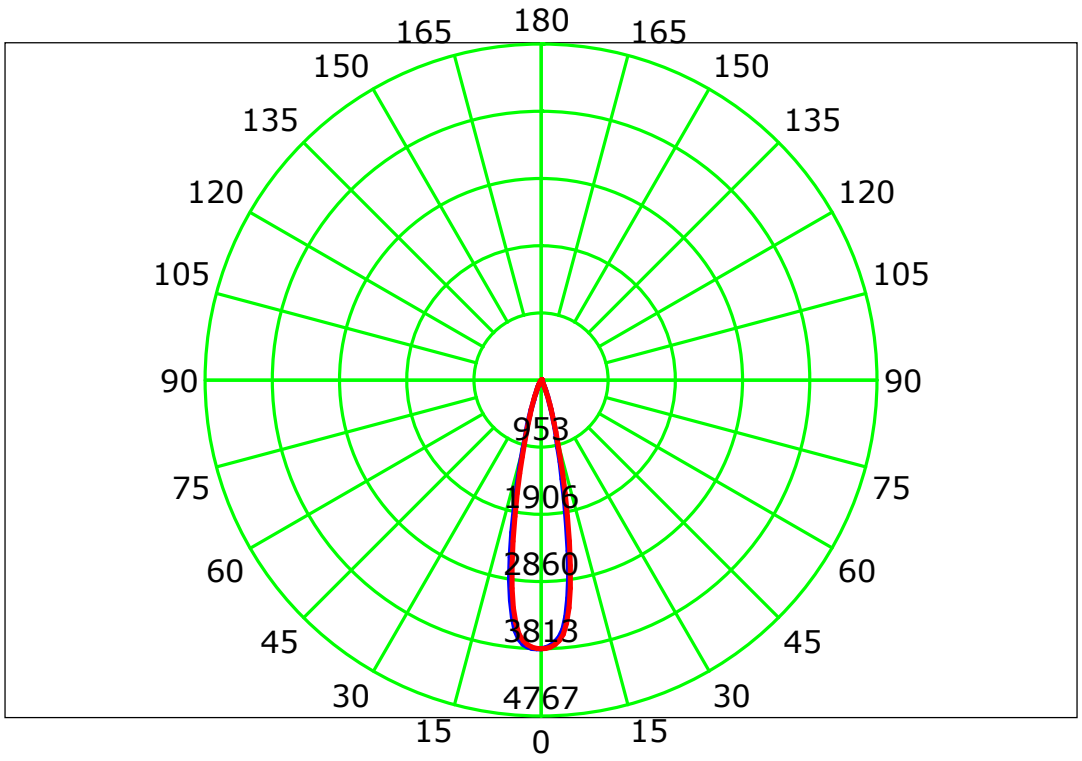


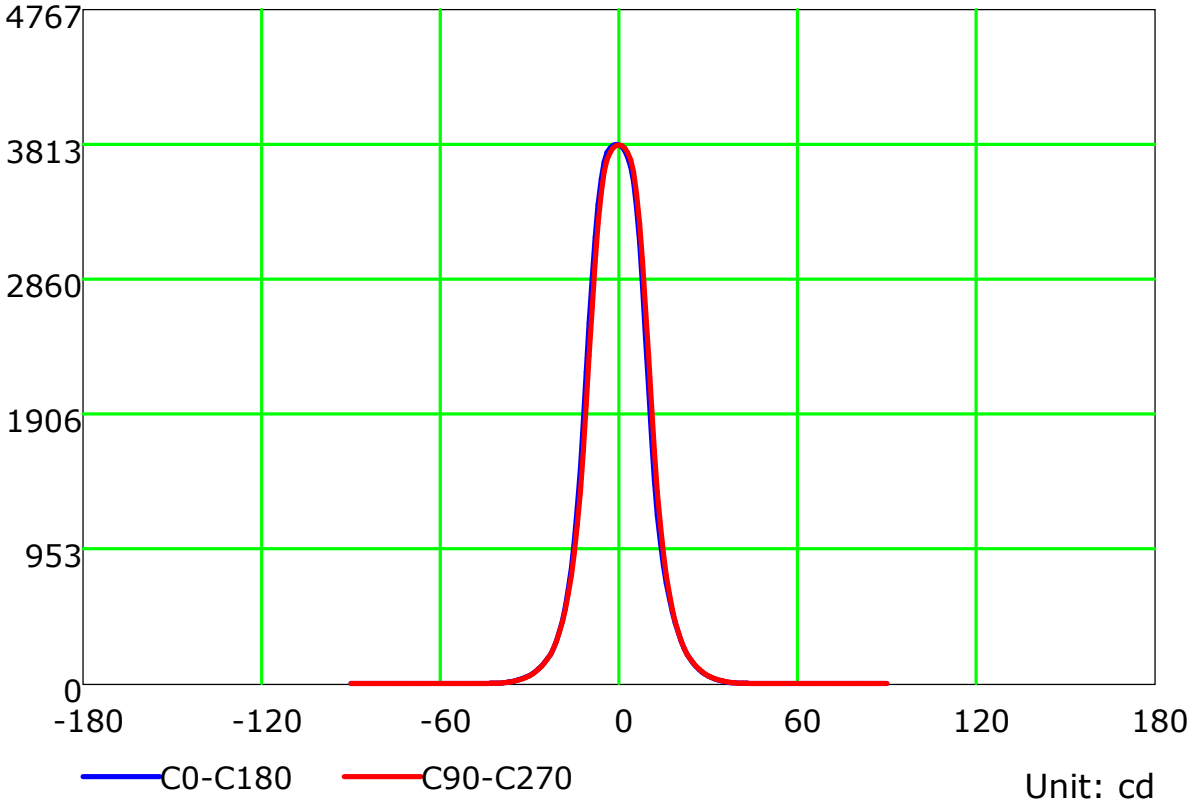

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

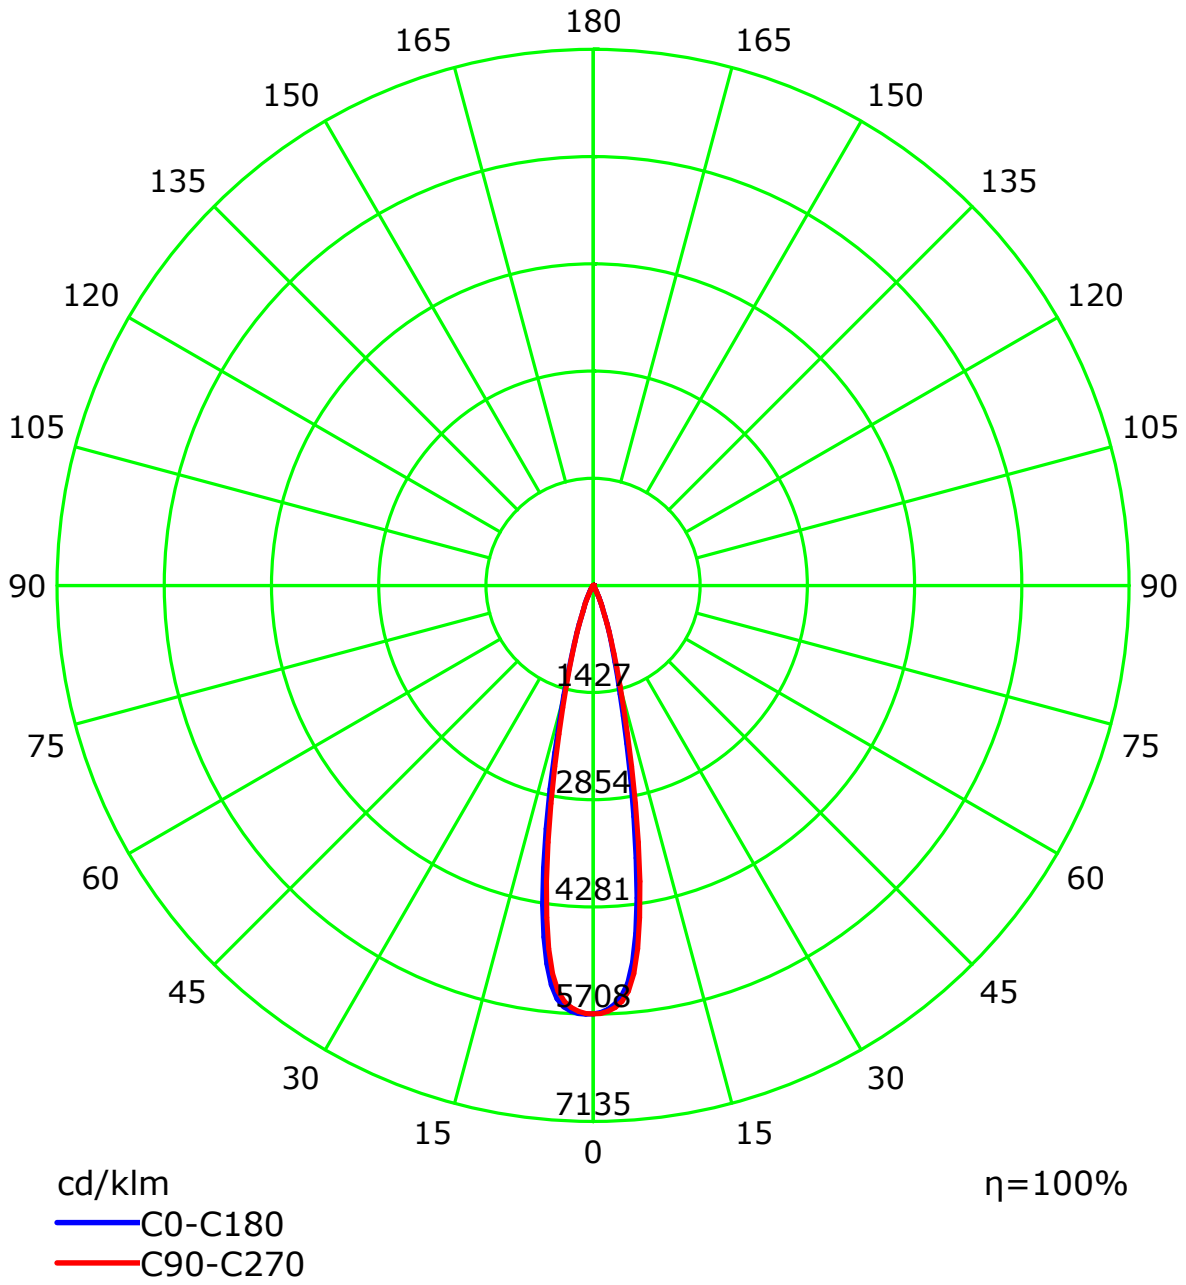

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

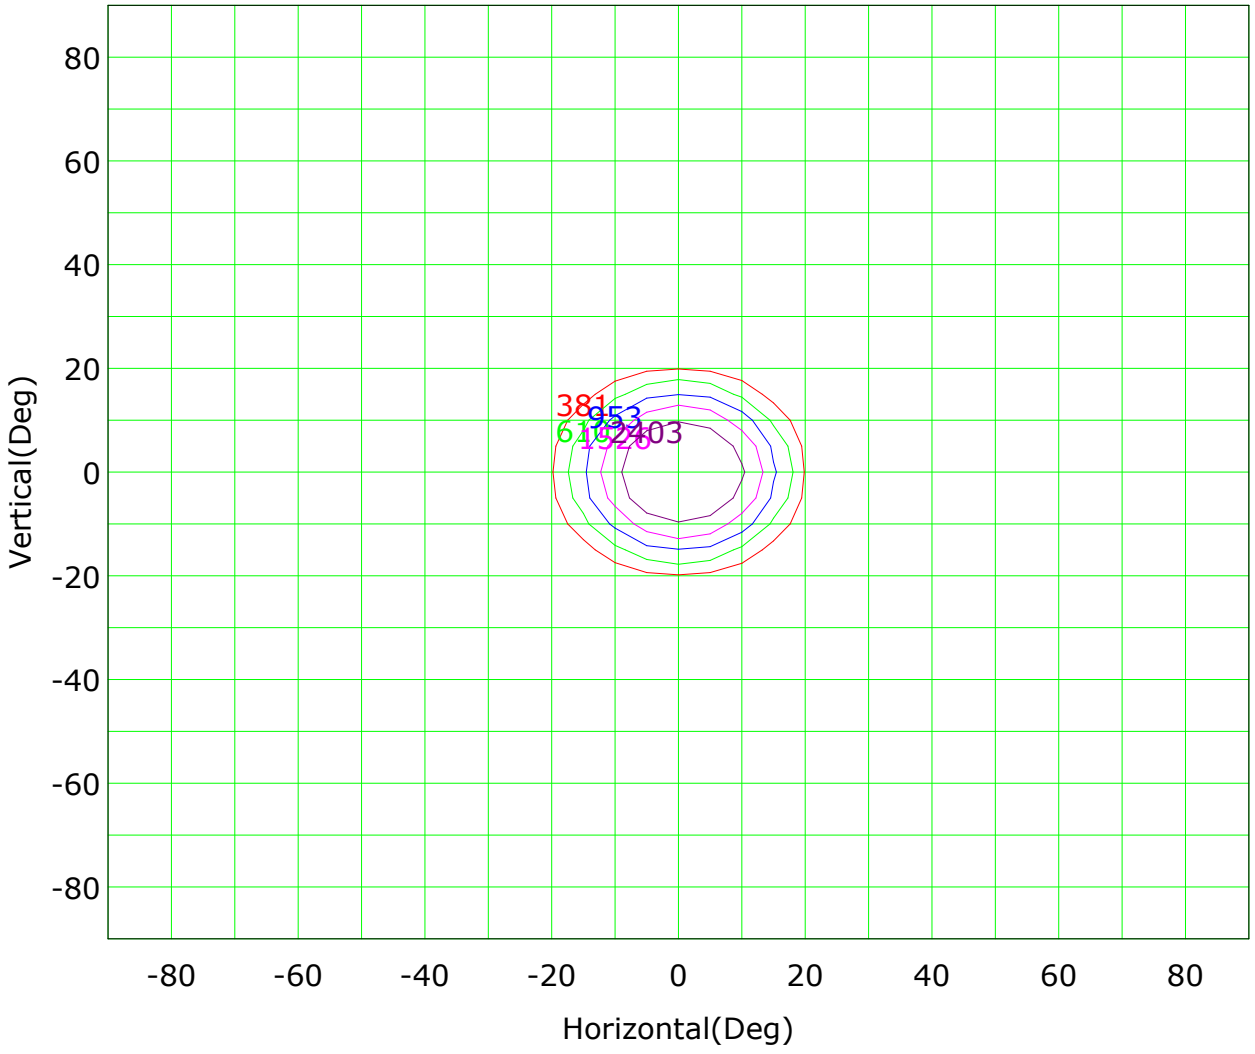


Imax (100%): 3814 cd

(10%): 381 cd
(16%): 610 cd
(25%): 953 cd
(40%): 1526 cd
(63%): 2403 cd
(100%): 3814 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

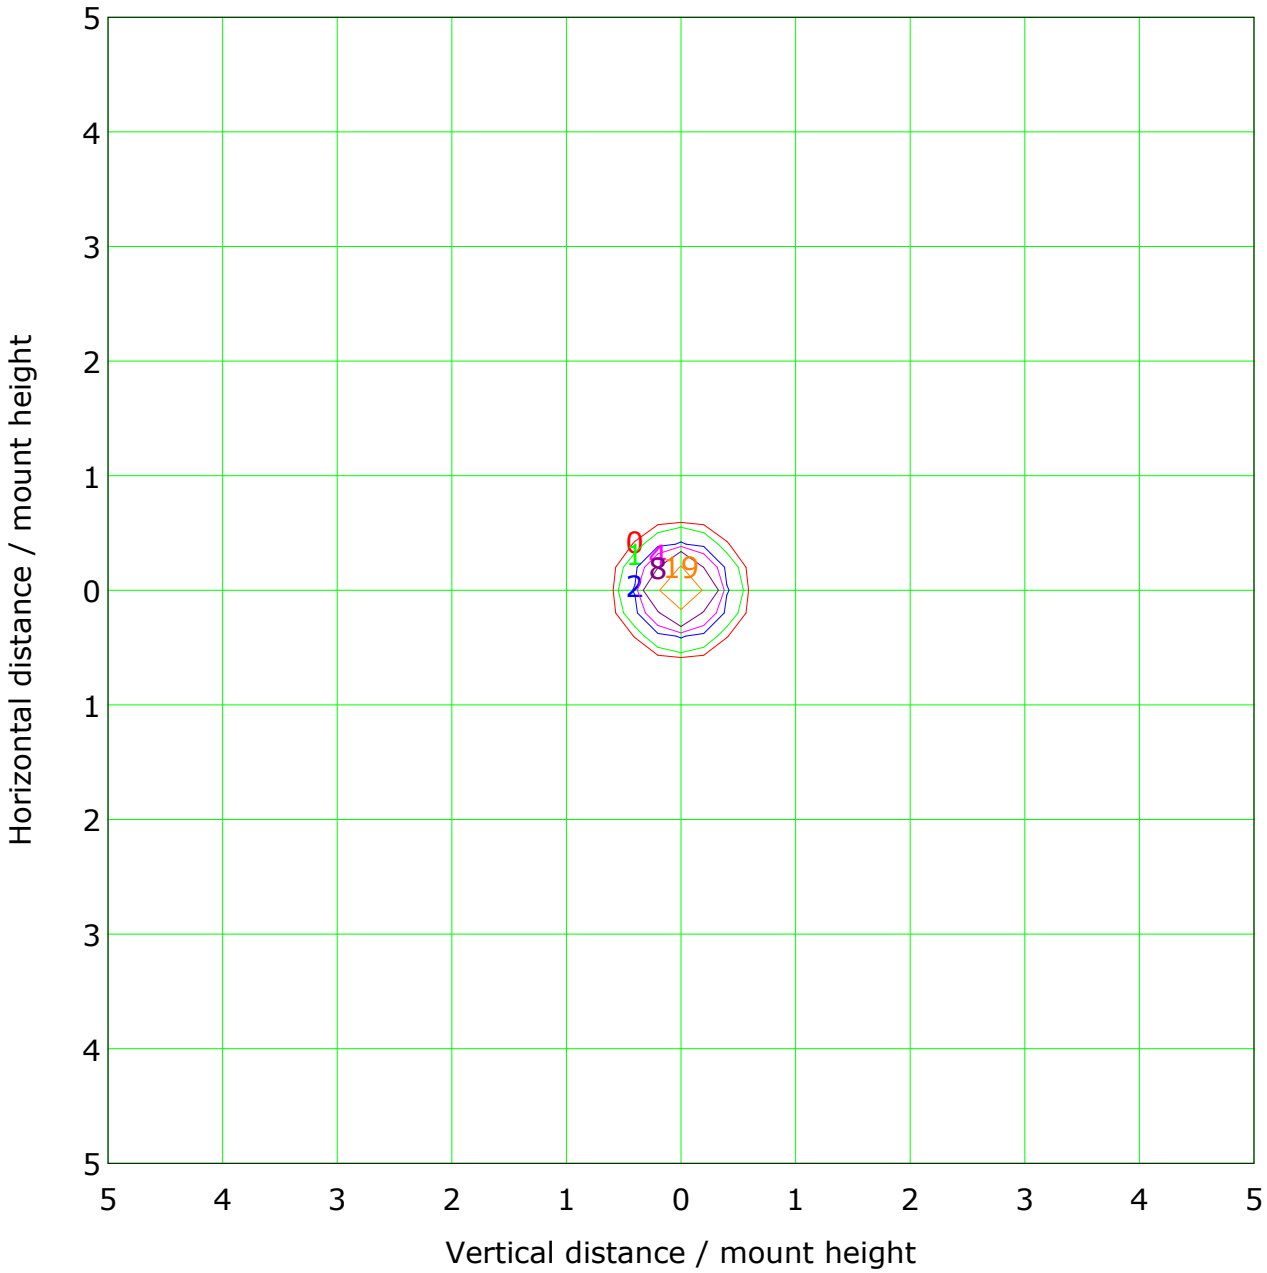


Mounting Height: 10.0m Max Lux(100%): 38.1 lx

(1%): 0.4 lx
(2%): 0.8 lx
(5%): 1.9 lx
(10%): 3.8 lx
(20%): 7.6 lx
(50%): 19.1 lx
(100%): 38.1 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Illuminance at a Distance

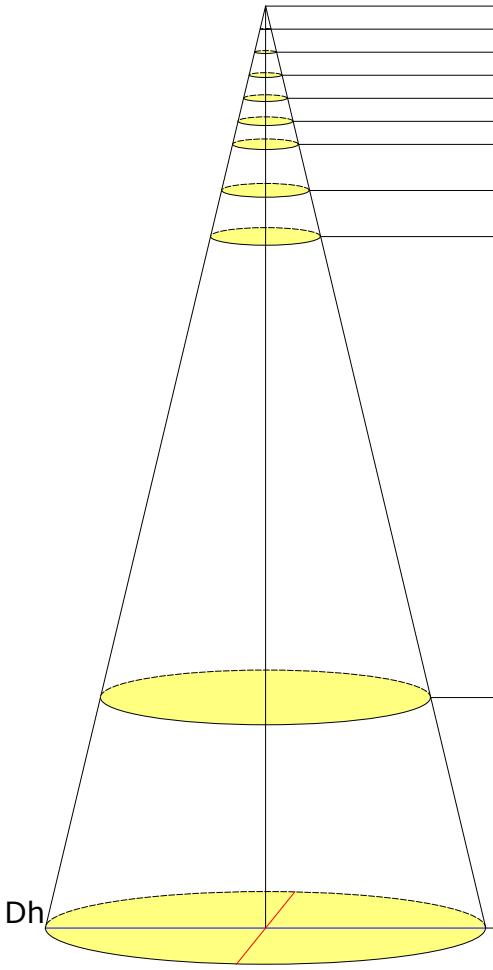


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	15241.60	0.20/0.20	0.0	7406.96
1.0	3810.40	0.40/0.40	0.1	1851.74
1.5	1693.51	0.59/0.59	0.3	823.00
2.0	952.60	0.79/0.79	0.5	462.94
2.5	609.66	0.99/0.99	0.8	296.28
3.0	423.38	1.19/1.19	1.1	205.75
4.0	238.15	1.58/1.59	2.0	115.73
5.0	152.42	1.98/1.98	3.1	74.07
15.0	16.94	5.93/5.95	27.7	8.23
20.0	9.53	7.91/7.93	49.2	4.63

Beam Angle(B): H22.4 V22.4 Field Angle(F): H39.5 V39.5

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

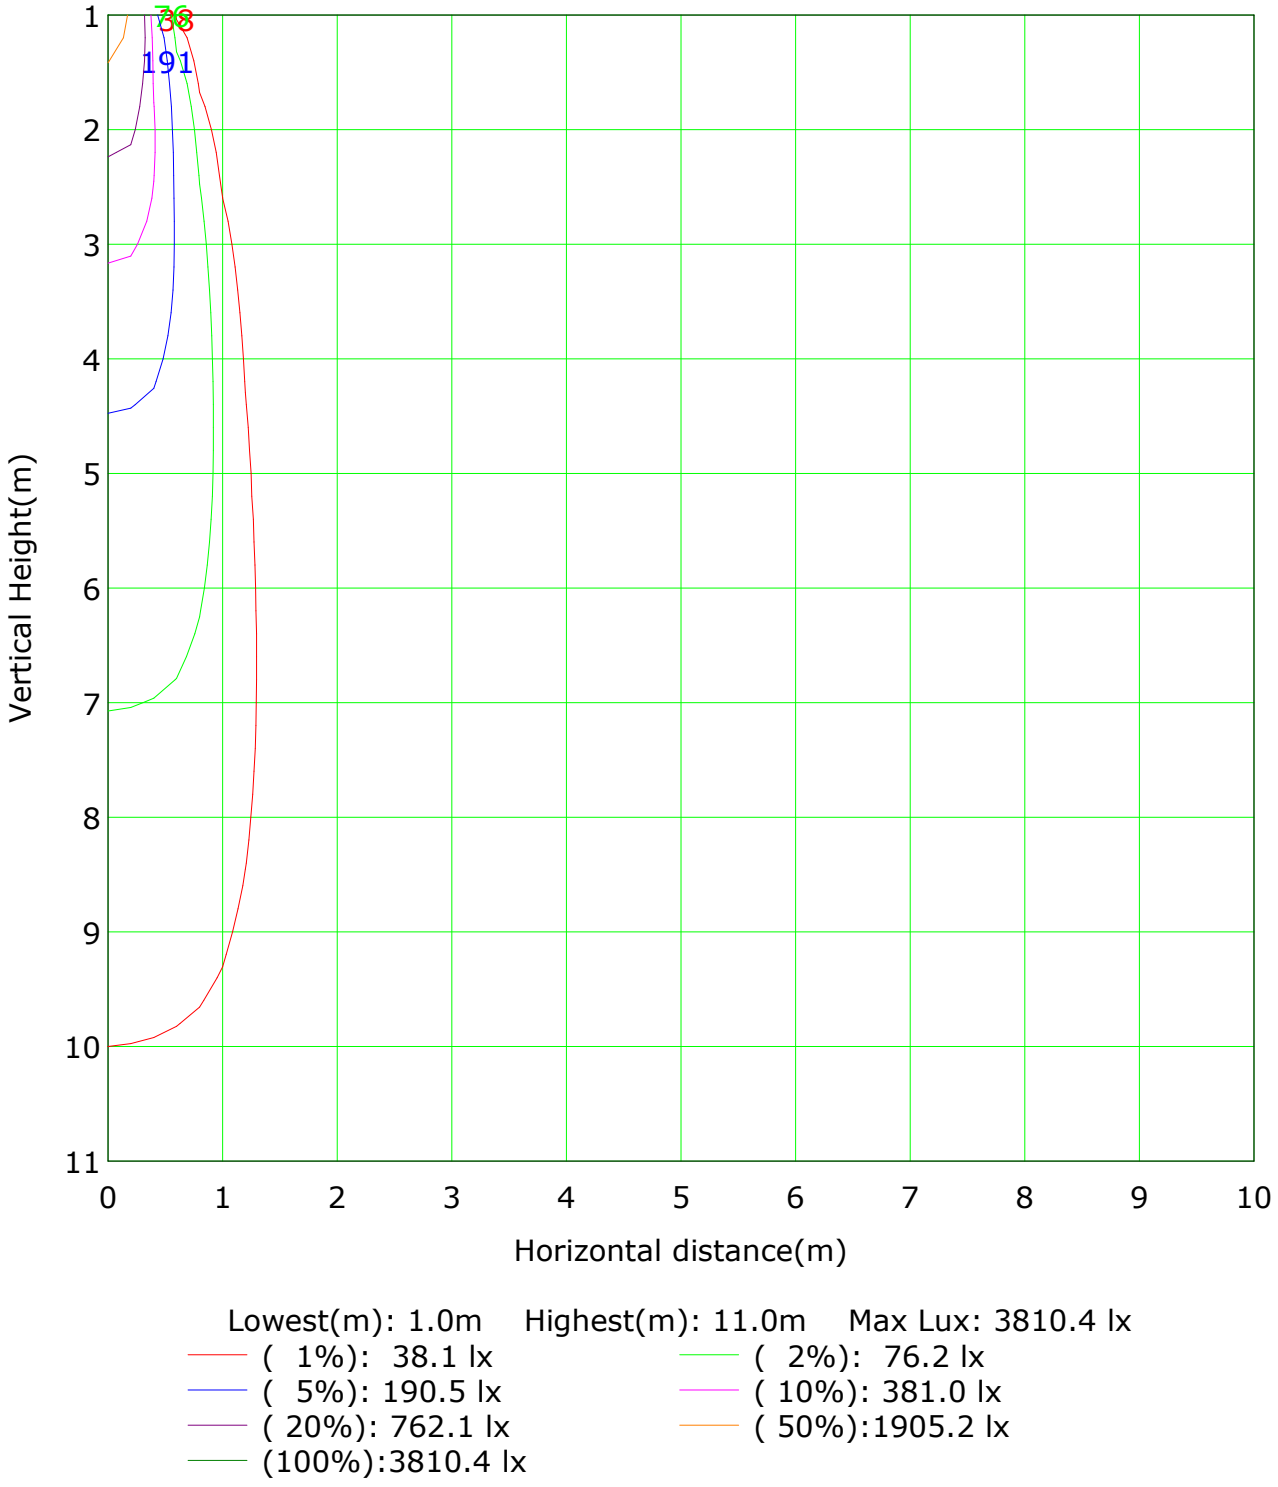

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3810.4 lx

(1%): 38.1 lx
(2%): 76.2 lx
(5%): 190.5 lx
(10%): 381.0 lx
(20%): 762.1 lx
(50%):1905.2 lx
(100%):3810.4 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Area Flux Table


Unit: lm

Horizontal plane	Vertical plane																							
	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
-50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0
-40	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	0.0
-30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	14.5	0.0
-20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	81.3	64.3
-10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	245.5	232.7
0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	234.3	221.6
10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	73.0	56.0
20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	14.0	0.0
30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.8	0.0
40	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0
50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.0
60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90	0.0	0.0	0.0	0.1	0.2	0.4	2.2	15.2	78.1	237.6	226.1	61.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	667	575
Flux(T)	0.0	0.0	0.0	0.1	0.3	2.0	14.5	81.3	245.5	234.3	73.0	14.0	1.8	0.3	0.2	0.1	0.0	0.0	0.0		
Flux(E)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	64.3	232.7	221.6	56.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

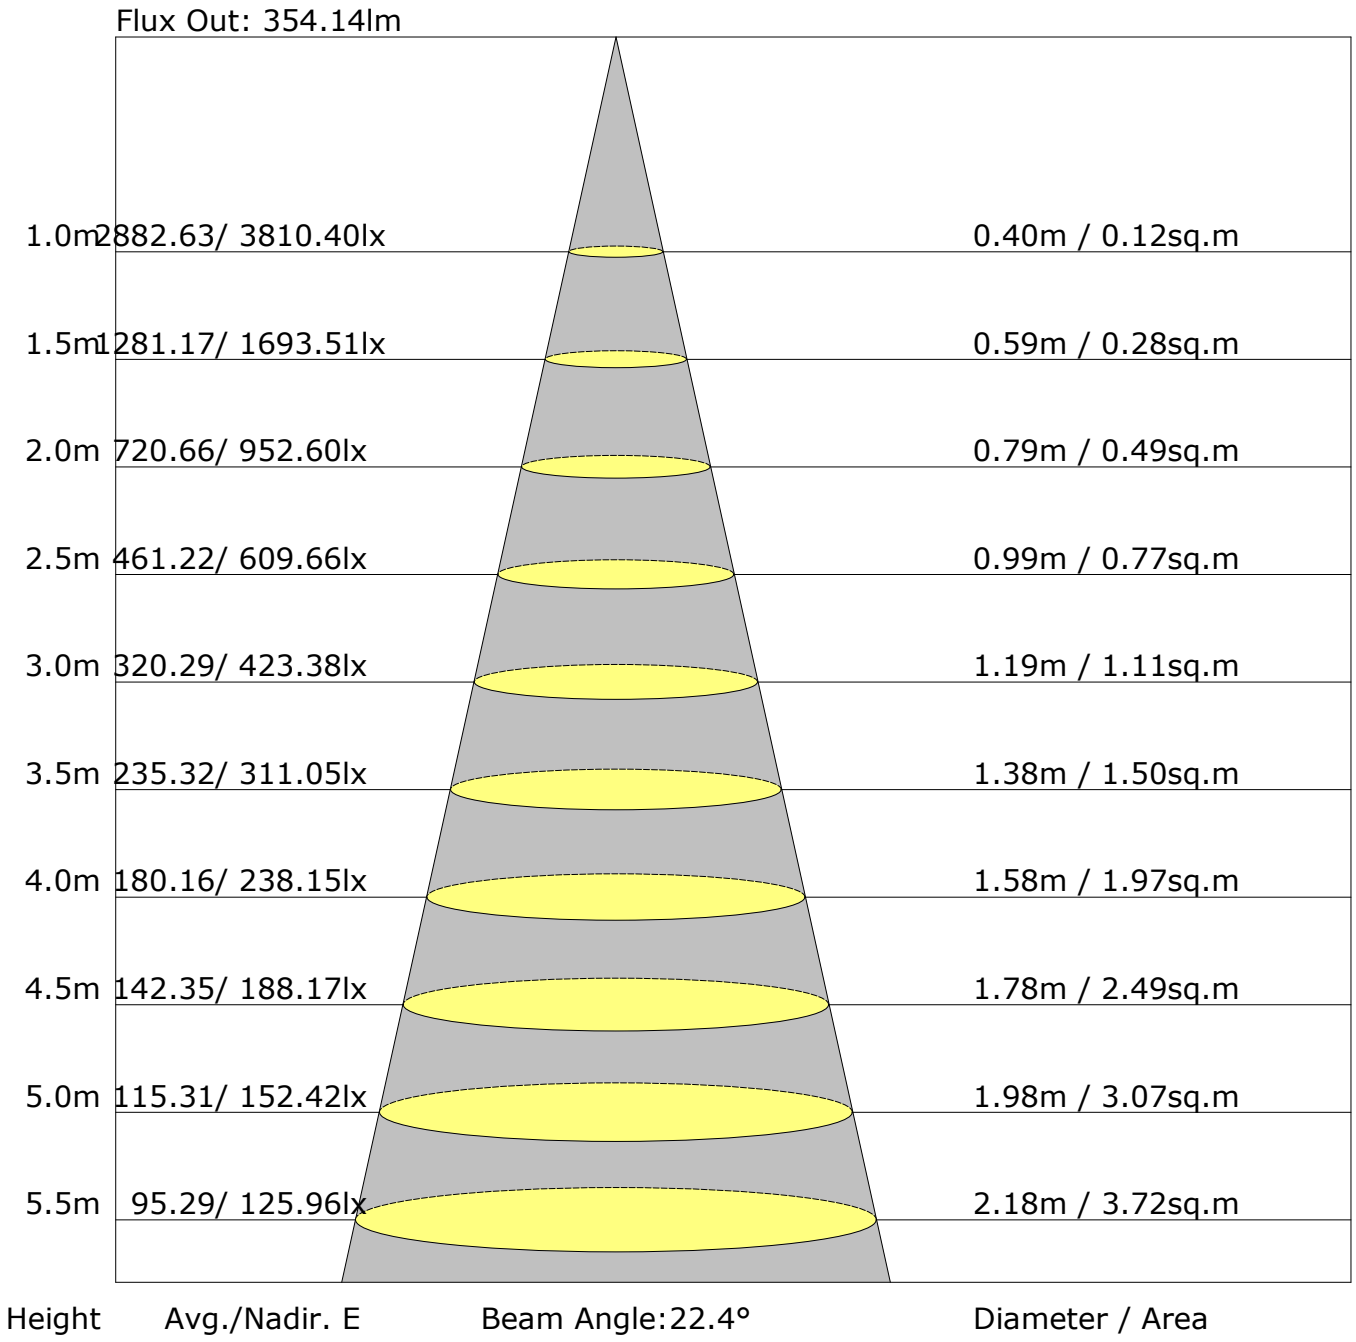

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	4.0	4.6	4.3	4.8	5.0	4.2	4.8	4.5	5.0	5.2
3H	4.1	4.6	4.3	4.8	5.0	4.2	4.7	4.5	4.9	5.2
4H	4.0	4.5	4.3	4.7	5.0	4.2	4.6	4.4	4.9	5.1
6H	3.9	4.4	4.2	4.6	4.9	4.1	4.5	4.4	4.8	5.1
8H	3.9	4.3	4.2	4.6	4.9	4.0	4.5	4.4	4.7	5.0
12H	3.8	4.3	4.2	4.6	4.9	4.0	4.4	4.3	4.7	5.0
X=4H Y=2H	4.0	4.4	4.3	4.7	4.9	4.2	4.6	4.5	4.9	5.1
3H	4.0	4.4	4.3	4.7	5.0	4.1	4.5	4.5	4.8	5.1
4H	3.9	4.3	4.3	4.6	4.9	4.0	4.4	4.4	4.7	5.1
6H	3.8	4.1	4.2	4.5	4.9	3.9	4.3	4.3	4.6	5.0
8H	3.8	4.1	4.2	4.4	4.8	3.9	4.2	4.3	4.6	5.0
12H	3.7	4.0	4.1	4.4	4.8	3.8	4.1	4.3	4.5	4.9
X=8H Y=4H	3.8	4.1	4.2	4.4	4.8	3.9	4.2	4.3	4.6	5.0
6H	3.7	3.9	4.1	4.3	4.8	3.8	4.0	4.2	4.5	4.9
8H	3.6	3.8	4.1	4.3	4.7	3.7	4.0	4.2	4.4	4.9
12H	3.5	3.7	4.0	4.2	4.7	3.7	3.9	4.2	4.3	4.8
X=12H Y=4H	3.7	4.0	4.1	4.4	4.8	3.8	4.1	4.3	4.5	4.9
6H	3.6	3.8	4.1	4.3	4.7	3.7	4.0	4.2	4.4	4.9
8H	3.5	3.7	4.0	4.2	4.7	3.7	3.9	4.2	4.3	4.8
Variations with the observer position at spacings:										
S=1.0H	+5.9/-7.0					+6.1/-7.4				
S=1.5H	+8.7/-7.7					+8.9/-8.1				
S=2.0H	+10.7/-17.9					+10.8/-13.4				

Calculate in accordance with CIE Pub.117. The table is revised with 668lm (8log(F/F0) = -1.4).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

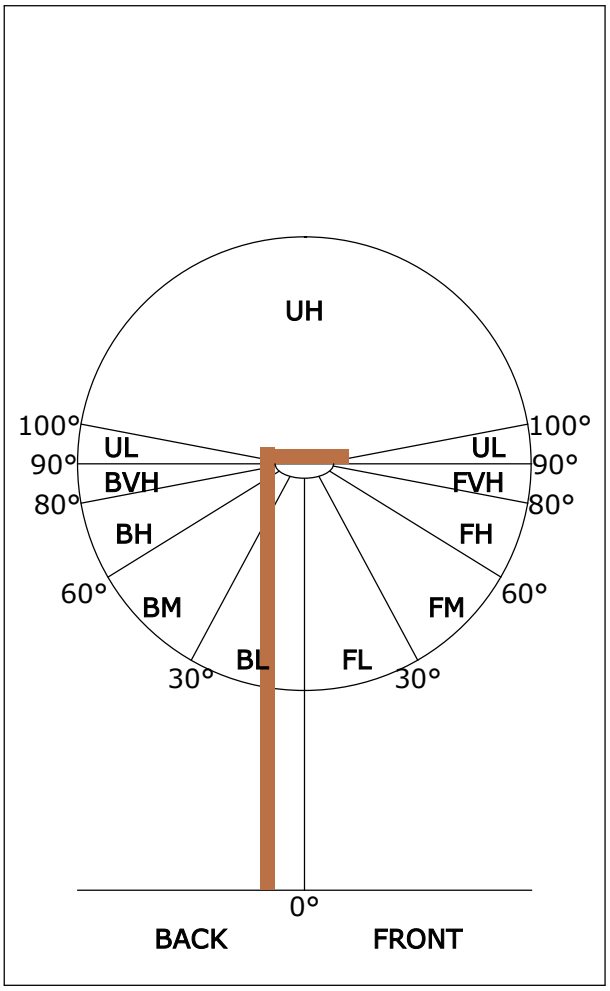

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	324	48.5
FL (0°-30°)	316	47.3
FM (30°-60°)	8	1.1
FH (60°-80°)	0	0.1
FVH (80°-90°)	0	0.0
BACK LIGHT	344	51.5
BL (0°-30°)	336	50.3
BM (30°-60°)	8	1.2
BH (60°-80°)	0	0.0
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(**B**acklight,**U**plight,**G**lare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3808.2	3.6	3.6	0.55	0.55
1.0-2.0	3798.1	10.9	14.5	1.63	2.18
2.0-3.0	3774.3	18.1	32.6	2.70	4.88
3.0-4.0	3732.4	25.0	57.6	3.74	8.62
4.0-5.0	3663.2	31.5	89.1	4.72	13.34
5.0-6.0	3545.2	37.3	126.4	5.58	18.91
6.0-7.0	3361.8	41.7	168.1	6.25	25.16
7.0-8.0	3118.1	44.6	212.7	6.68	31.84
8.0-9.0	2823.8	45.8	258.5	6.85	38.69
9.0-10.0	2492.0	45.1	303.6	6.75	45.44
10.0-11.0	2147.0	42.9	346.5	6.42	51.87
11.0-12.0	1809.9	39.6	386.1	5.92	57.79
12.0-13.0	1501.6	35.6	421.7	5.33	63.12
13.0-14.0	1239.1	31.7	453.4	4.75	67.87
14.0-15.0	1023.2	28.1	481.5	4.21	72.08
15.0-16.0	846.3	24.8	506.3	3.71	75.79
16.0-17.0	700.6	21.8	528.2	3.27	79.06
17.0-18.0	581.0	19.2	547.3	2.87	81.92
18.0-19.0	482.5	16.8	564.1	2.51	84.44
19.0-20.0	400.4	14.7	578.8	2.19	86.63
20.0-21.0	331.3	12.7	591.5	1.90	88.54
21.0-22.0	274.6	11.0	602.5	1.65	90.19
22.0-23.0	228.4	9.6	612.1	1.43	91.62
23.0-24.0	191.5	8.4	620.5	1.25	92.87
24.0-25.0	161.5	7.3	627.8	1.10	93.97
25.0-26.0	135.4	6.4	634.2	0.96	94.93
26.0-27.0	112.8	5.5	639.7	0.83	95.76
27.0-28.0	93.4	4.7	644.5	0.71	96.47
28.0-29.0	76.8	4.0	648.5	0.60	97.07
29.0-30.0	62.7	3.4	651.9	0.51	97.57
30.0-31.0	51.2	2.8	654.7	0.43	98.00
31.0-32.0	41.5	2.4	657.1	0.36	98.36
32.0-33.0	33.4	2.0	659.1	0.29	98.65
33.0-34.0	26.7	1.6	660.7	0.24	98.89
34.0-35.0	20.9	1.3	662.0	0.19	99.09
35.0-36.0	16.1	1.0	663.0	0.15	99.24

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	12.1	0.8	663.8	0.12	99.36
37.0-38.0	8.7	0.6	664.4	0.09	99.45
38.0-39.0	6.2	0.4	664.8	0.06	99.51
39.0-40.0	4.6	0.3	665.1	0.05	99.56
40.0-41.0	3.7	0.3	665.4	0.04	99.60
41.0-42.0	3.1	0.2	665.6	0.03	99.63
42.0-43.0	2.6	0.2	665.8	0.03	99.66
43.0-44.0	2.3	0.2	666.0	0.03	99.68
44.0-45.0	1.9	0.1	666.1	0.02	99.71
45.0-46.0	1.5	0.1	666.2	0.02	99.72
46.0-47.0	1.4	0.1	666.3	0.02	99.74
47.0-48.0	1.3	0.1	666.5	0.02	99.76
48.0-49.0	1.2	0.1	666.5	0.01	99.77
49.0-50.0	1.1	0.1	666.6	0.01	99.78
50.0-51.0	1.1	0.1	666.7	0.01	99.80
51.0-52.0	1.1	0.1	666.8	0.01	99.81
52.0-53.0	0.9	0.1	666.9	0.01	99.82
53.0-54.0	0.9	0.1	667.0	0.01	99.84
54.0-55.0	0.8	0.1	667.1	0.01	99.85
55.0-56.0	0.8	0.1	667.1	0.01	99.86
56.0-57.0	0.9	0.1	667.2	0.01	99.87
57.0-58.0	0.9	0.1	667.3	0.01	99.88
58.0-59.0	0.9	0.1	667.4	0.01	99.89
59.0-60.0	0.9	0.1	667.5	0.01	99.91
60.0-61.0	0.9	0.1	667.5	0.01	99.92
61.0-62.0	0.8	0.1	667.6	0.01	99.93
62.0-63.0	0.8	0.1	667.7	0.01	99.94
63.0-64.0	0.8	0.1	667.8	0.01	99.95
64.0-65.0	0.8	0.1	667.8	0.01	99.96
65.0-66.0	0.8	0.1	667.9	0.01	99.98
66.0-67.0	0.7	0.1	668.0	0.01	99.99
67.0-68.0	0.5	0.0	668.0	0.01	99.99
68.0-69.0	0.3	0.0	668.1	0.00	100.00
69.0-70.0	0.1	0.0	668.1	0.00	100.00
70.0-71.0	0.0	0.0	668.1	0.00	100.00
71.0-72.0	0.0	0.0	668.1	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	0.0	0.0	668.1	0.00	100.00
73.0-74.0	0.0	0.0	668.1	0.00	100.00
74.0-75.0	0.0	0.0	668.1	0.00	100.00
75.0-76.0	0.0	0.0	668.1	0.00	100.00
76.0-77.0	0.0	0.0	668.1	0.00	100.00
77.0-78.0	0.0	0.0	668.1	0.00	100.00
78.0-79.0	0.0	0.0	668.1	0.00	100.00
79.0-80.0	0.0	0.0	668.1	0.00	100.00
80.0-81.0	0.0	0.0	668.1	0.00	100.00
81.0-82.0	0.0	0.0	668.1	0.00	100.00
82.0-83.0	0.0	0.0	668.1	0.00	100.00
83.0-84.0	0.0	0.0	668.1	0.00	100.00
84.0-85.0	0.0	0.0	668.1	0.00	100.00
85.0-86.0	0.0	0.0	668.1	0.00	100.00
86.0-87.0	0.0	0.0	668.1	0.00	100.00
87.0-88.0	0.0	0.0	668.1	0.00	100.00
88.0-89.0	0.0	0.0	668.1	0.00	100.00
89.0-90.0	0.0	0.0	668.1	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3810.4	3810.4								
G1.0	3798.1	3813.9								
G2.0	3771.7	3808.6								
G3.0	3725.6	3791.2								
G4.0	3655.5	3757.3								
G5.0	3549.3	3690.9								
G6.0	3370.5	3570.0								
G7.0	3118.4	3388.2								
G8.0	2807.2	3158.6								
G9.0	2452.7	2876.7								
G10.0	2087.4	2551.3								
G11.0	1745.4	2204.1								
G12.0	1437.9	1852.1								
G13.0	1190.9	1525.4								
G14.0	994.5	1245.4								
G15.0	837.6	1015.3								
G16.0	709.7	822.6								
G17.0	600.9	669.2								
G18.0	507.0	546.8								
G19.0	429.3	447.0								
G20.0	357.9	367.4								
G21.0	298.2	301.8								
G22.0	248.8	249.7								
G23.0	206.7	208.2								
G24.0	173.7	177.2								
G25.0	144.9	150.3								
G26.0	120.1	126.4								
G27.0	99.1	105.7								
G28.0	81.2	87.7								
G29.0	66.1	72.1								
G30.0	53.9	58.8								
G31.0	43.8	48.2								
G32.0	35.1	38.7								
G33.0	27.8	32.0								
G34.0	21.8	25.4								
G35.0	16.8	19.7								
G36.0	12.5	15.3								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	9.0	11.6								
G38.0	6.0	8.4								
G39.0	4.7	5.9								
G40.0	3.5	4.5								
G41.0	3.2	3.6								
G42.0	2.7	2.8								
G43.0	2.4	2.4								
G44.0	2.3	2.0								
G45.0	1.6	1.8								
G46.0	1.5	1.2								
G47.0	1.5	1.2								
G48.0	1.4	1.2								
G49.0	1.2	1.0								
G50.0	1.2	1.0								
G51.0	1.2	1.0								
G52.0	1.2	0.8								
G53.0	0.9	0.8								
G54.0	1.0	0.8								
G55.0	0.9	0.6								
G56.0	1.0	0.8								
G57.0	1.0	0.6								
G58.0	1.0	0.8								
G59.0	1.0	0.8								
G60.0	0.9	0.8								
G61.0	1.0	0.8								
G62.0	0.9	0.4								
G63.0	1.0	0.8								
G64.0	1.0	0.4								
G65.0	1.0	0.4								
G66.0	1.0	0.4								
G67.0	0.8	0.4								
G68.0	0.2	0.4								
G69.0	0.0	0.4								
G70.0	0.0	0.2								
G71.0	0.0	0.0								
G72.0	0.0	0.0								
G73.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	0.0	0.0								
G75.0	0.0	0.0								
G76.0	0.0	0.0								
G77.0	0.0	0.0								
G78.0	0.0	0.0								
G79.0	0.0	0.0								
G80.0	0.0	0.0								
G81.0	0.0	0.0								
G82.0	0.0	0.0								
G83.0	0.0	0.0								
G84.0	0.0	0.0								
G85.0	0.0	0.0								
G86.0	0.0	0.0								
G87.0	0.0	0.0								
G88.0	0.0	0.0								
G89.0	0.0	0.0								
G90.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: