中山雅大光电有限公司
www.artdon.cn
0760-22211886
0760-22211890

Report No.: Test Time: 2026-09-10 15:21

Luminaire Property

Luminaire Manufacturer:
Luminaire Description: 24D
Luminous Width (mm): -40
Current: 0.064 A
Power Factor: 0.939
Luminous Length (mm): -40
Voltage: 229.2 V
Power: 13.80 W


Photometric Results

CIE Class: Direct
Measurement Flux: 1155.1 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(50%): H25.4
Vertical Diffuse Angle(50%): V25.4
Luminaire Efficacy Rating (LER): 83.75
Max. Intensity: 5129.05 cd
S/MH(C0/C180): 0.43
Total Rated Lamp Lumens: 1155.1 lm
Efficiency: 100%
Upward Ratio: 0%
Central Intensity: 5040.09 cd
Pos of Max. Intensity: H180 V2
S/MH(C90/C270): 0.43

Picture Of Luminaire





Luminous Intensity Distribution Curve

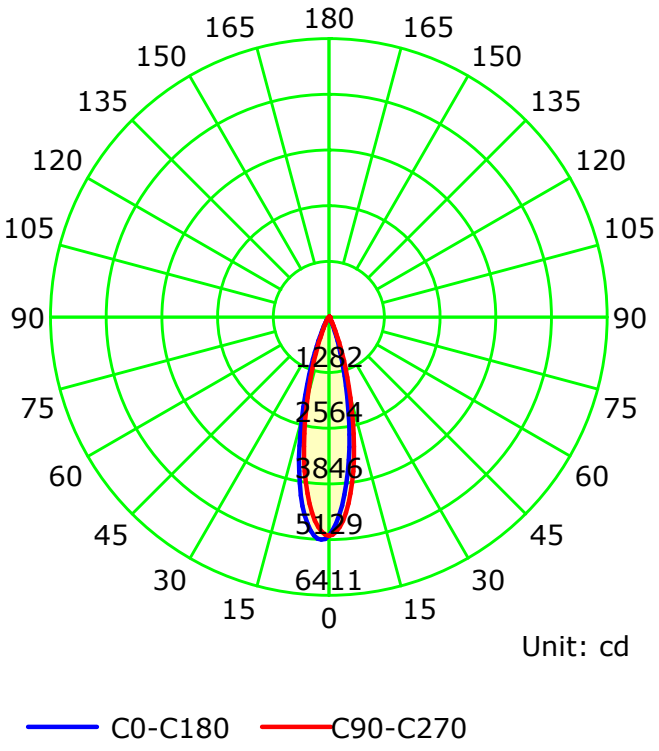

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:
Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve

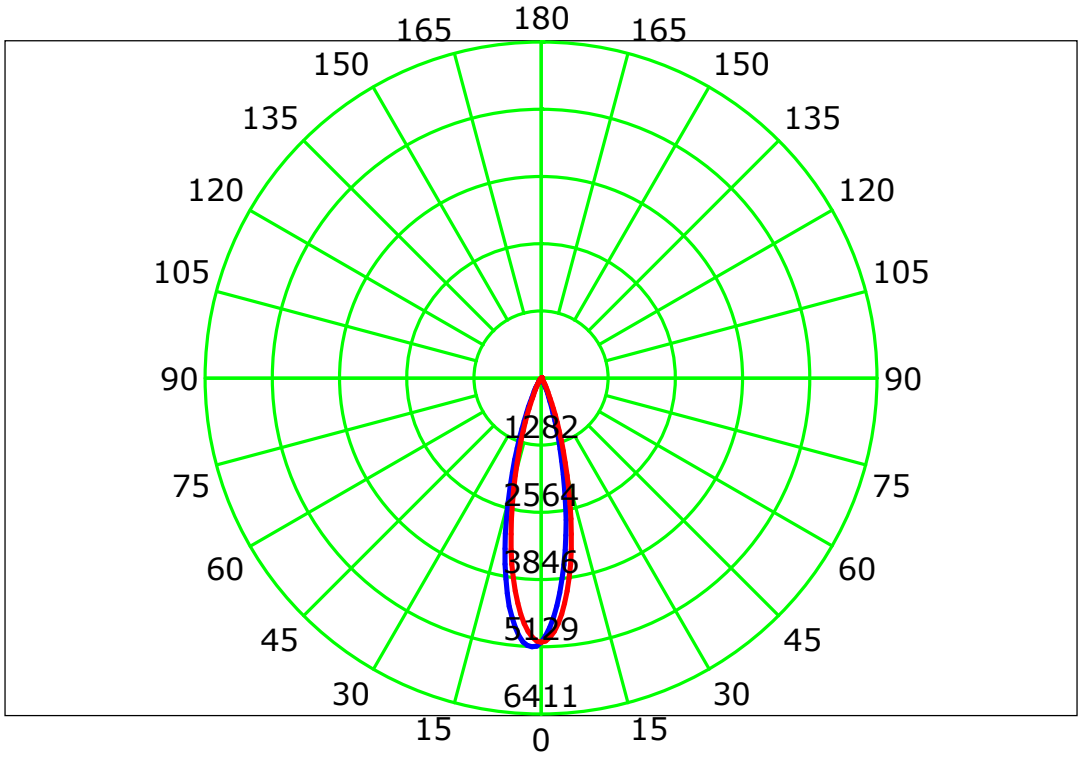


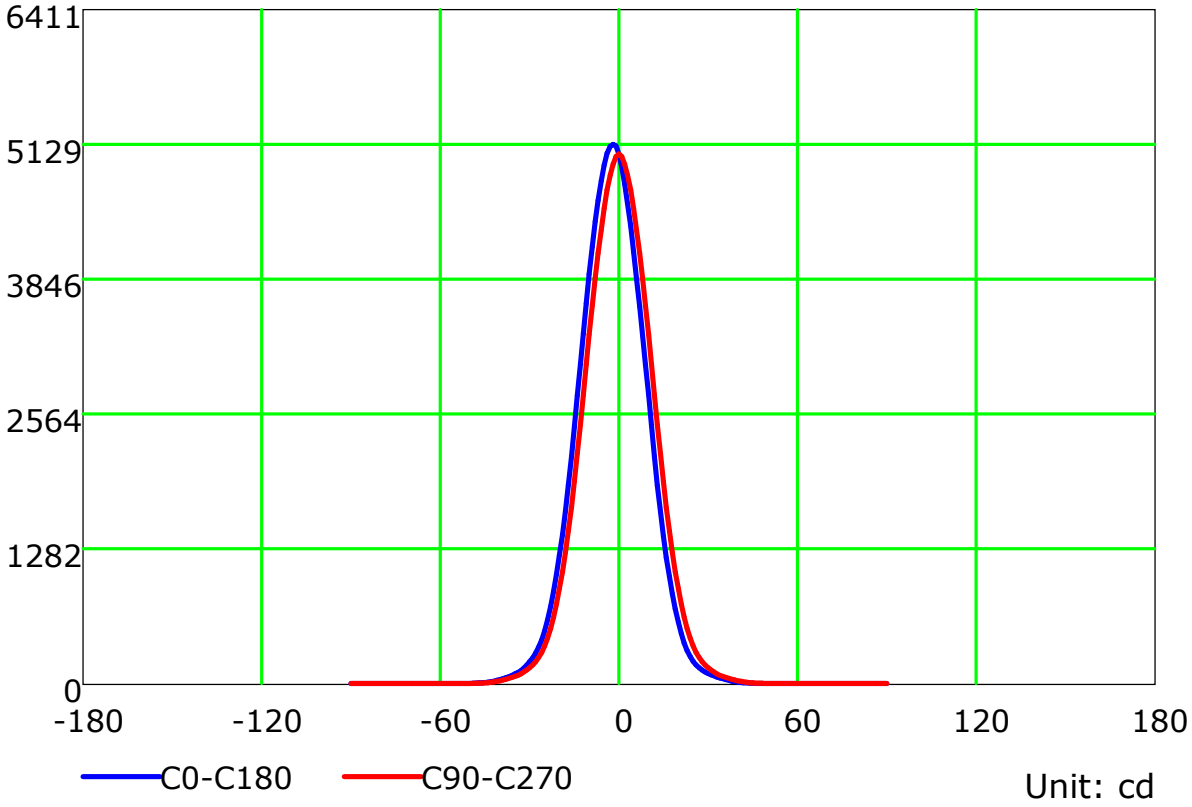

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

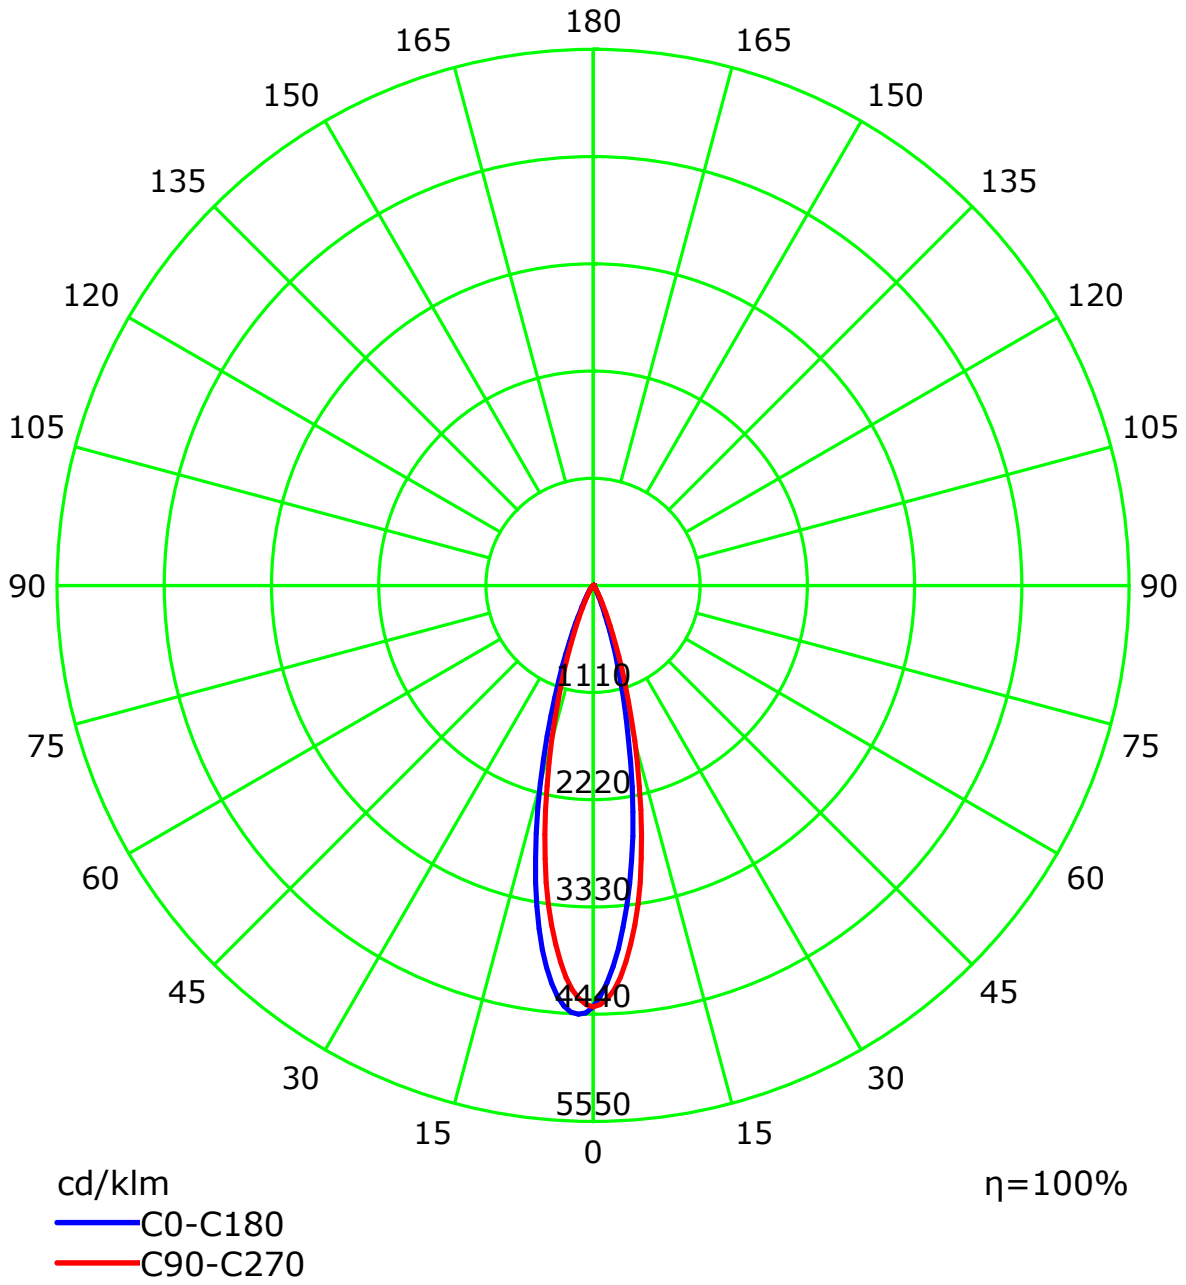

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

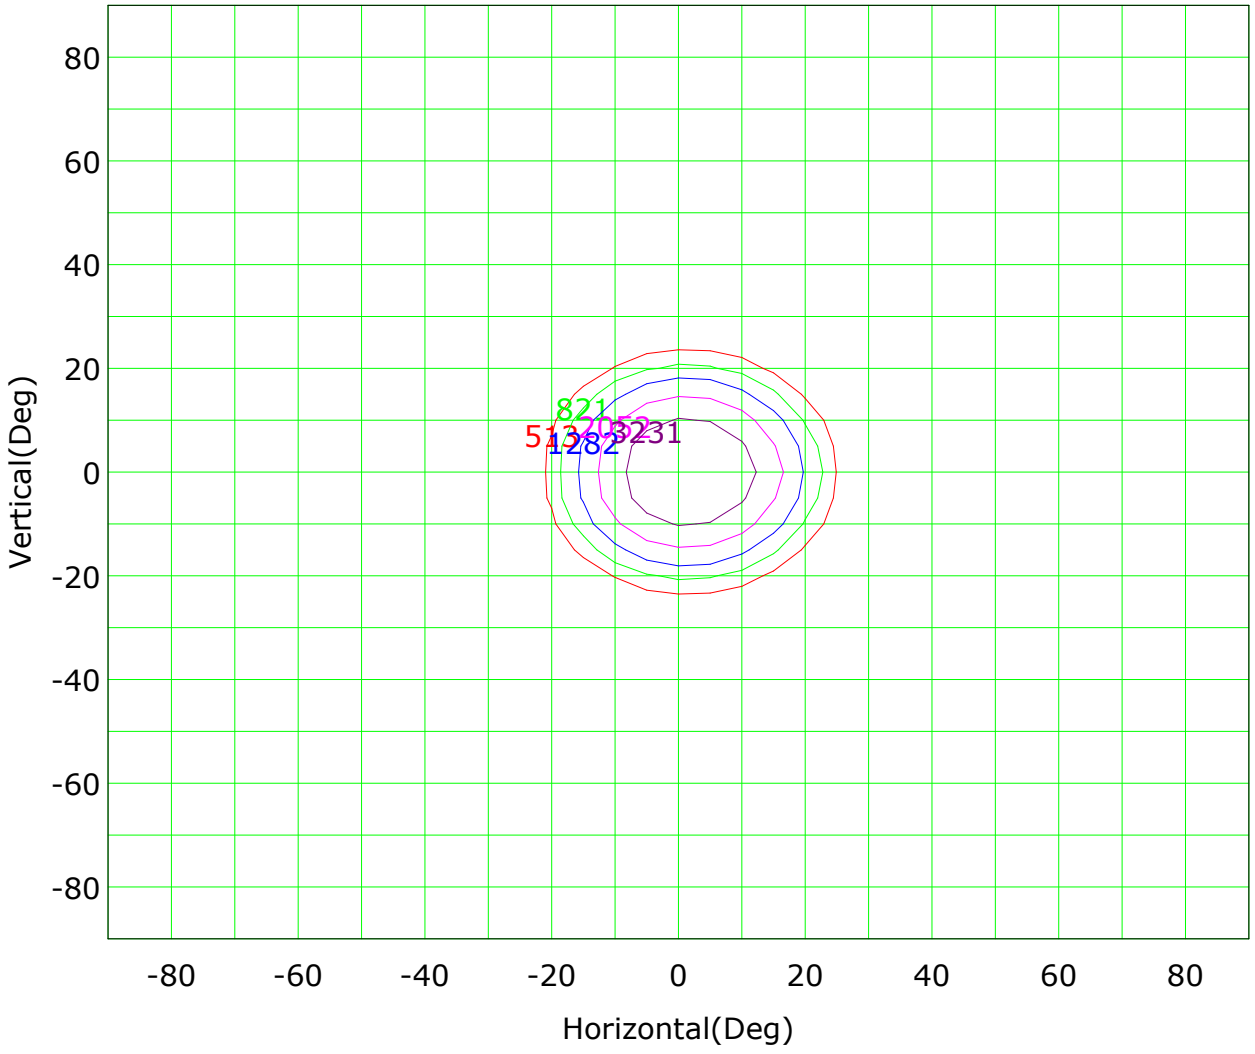


Imax (100%): 5129 cd

(10%): 513 cd
(16%): 821 cd
(25%): 1282 cd
(40%): 2052 cd
(63%): 3231 cd
(100%): 5129 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

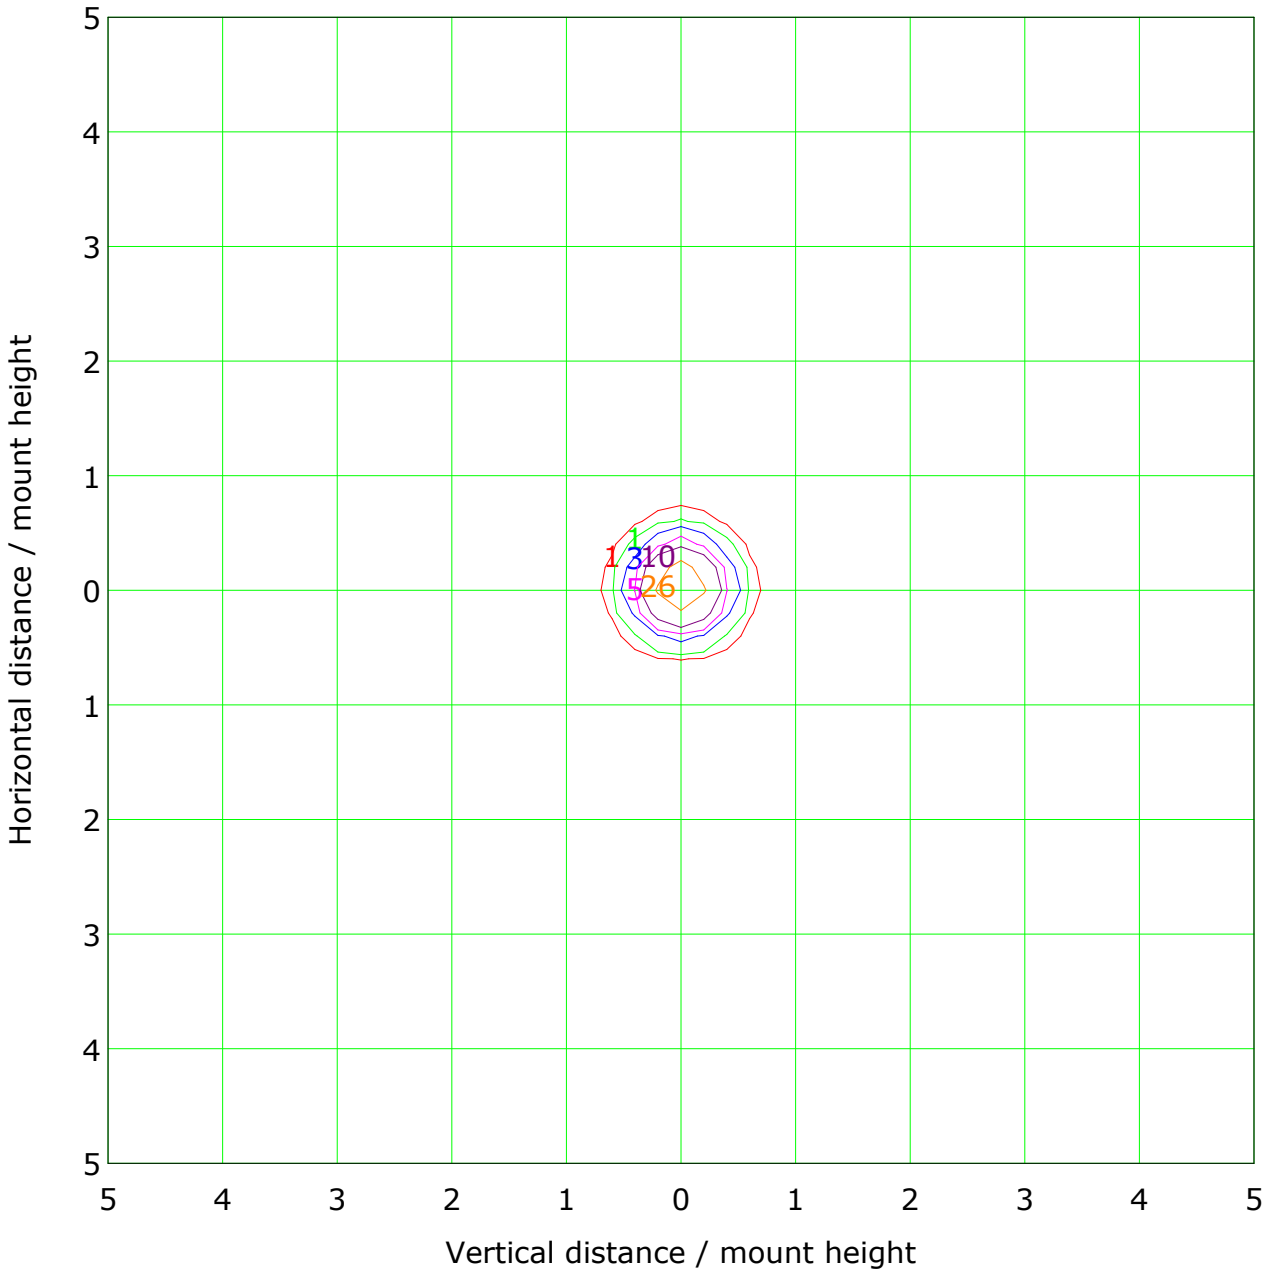


Mounting Height: 10.0m Max Lux(100%): 51.2 lx

(1%): 0.5 lx	(2%): 1.0 lx
(5%): 2.6 lx	(10%): 5.1 lx
(20%): 10.2 lx	(50%): 25.6 lx
(100%): 51.2 lx	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Illuminance at a Distance

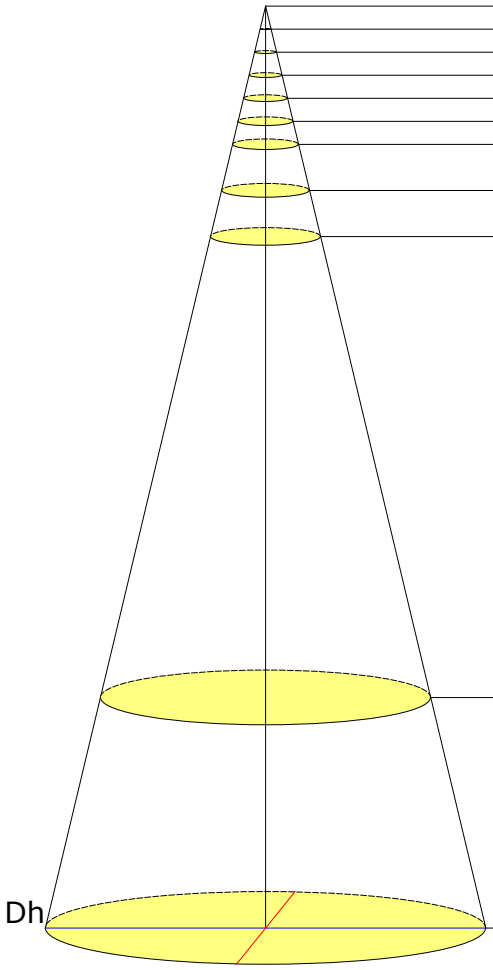


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	20160.36	0.22/0.23	0.0	9972.86
1.0	5040.09	0.45/0.45	0.2	2493.21
1.5	2240.04	0.67/0.68	0.4	1108.10
2.0	1260.02	0.89/0.91	0.6	623.30
2.5	806.41	1.12/1.14	1.0	398.91
3.0	560.01	1.34/1.36	1.4	277.02
4.0	315.01	1.79/1.82	2.6	155.83
5.0	201.60	2.24/2.27	4.0	99.73
15.0	22.40	6.71/6.82	35.9	11.08
20.0	12.60	8.95/9.09	63.8	6.23

Beam Angle(B): H25.2 V25.6 Field Angle(F): H45.6 V46.5

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

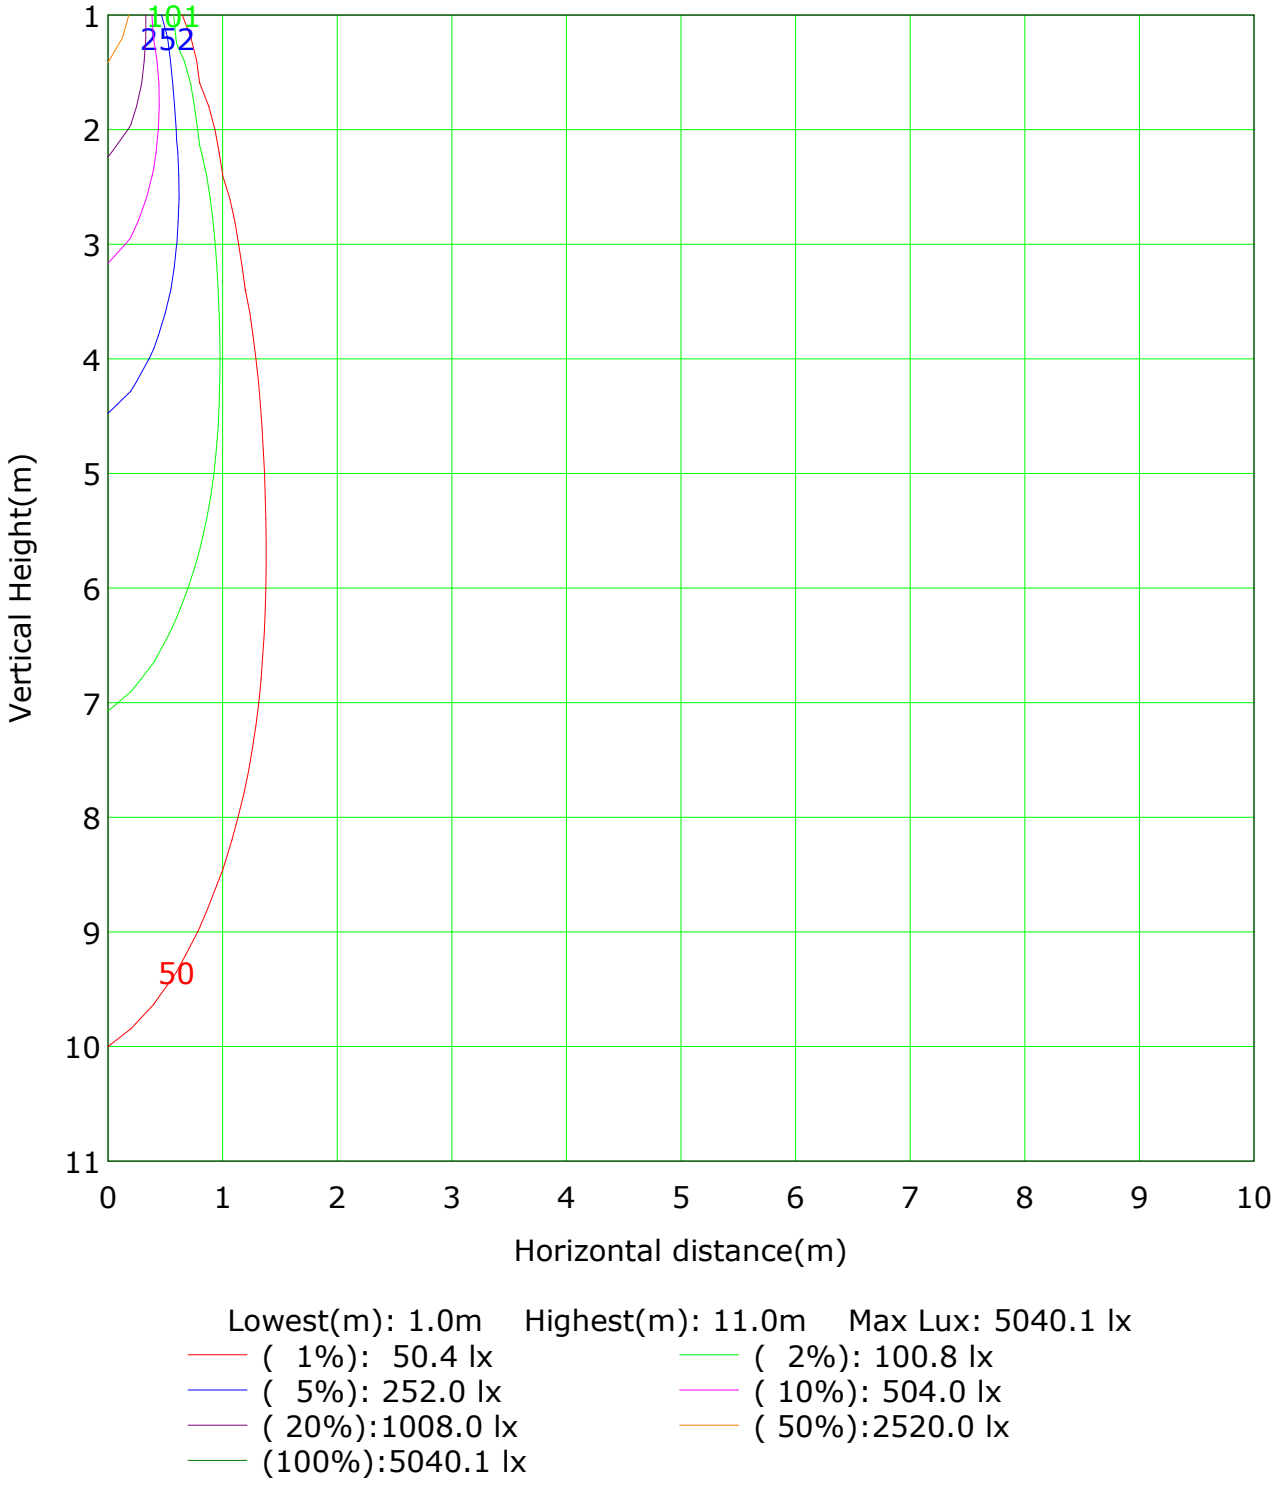

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 5040.1 lx

(1%): 50.4 lx
(2%): 100.8 lx
(5%): 252.0 lx
(10%): 504.0 lx
(20%):1008.0 lx
(50%):2520.0 lx
(100%):5040.1 lx

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Area Flux Table


Unit: lm

Horizontal plane	Vertical plane																							
	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-40	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
40	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90																					
Flux(T)	1007	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
Flux(E)	1007	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

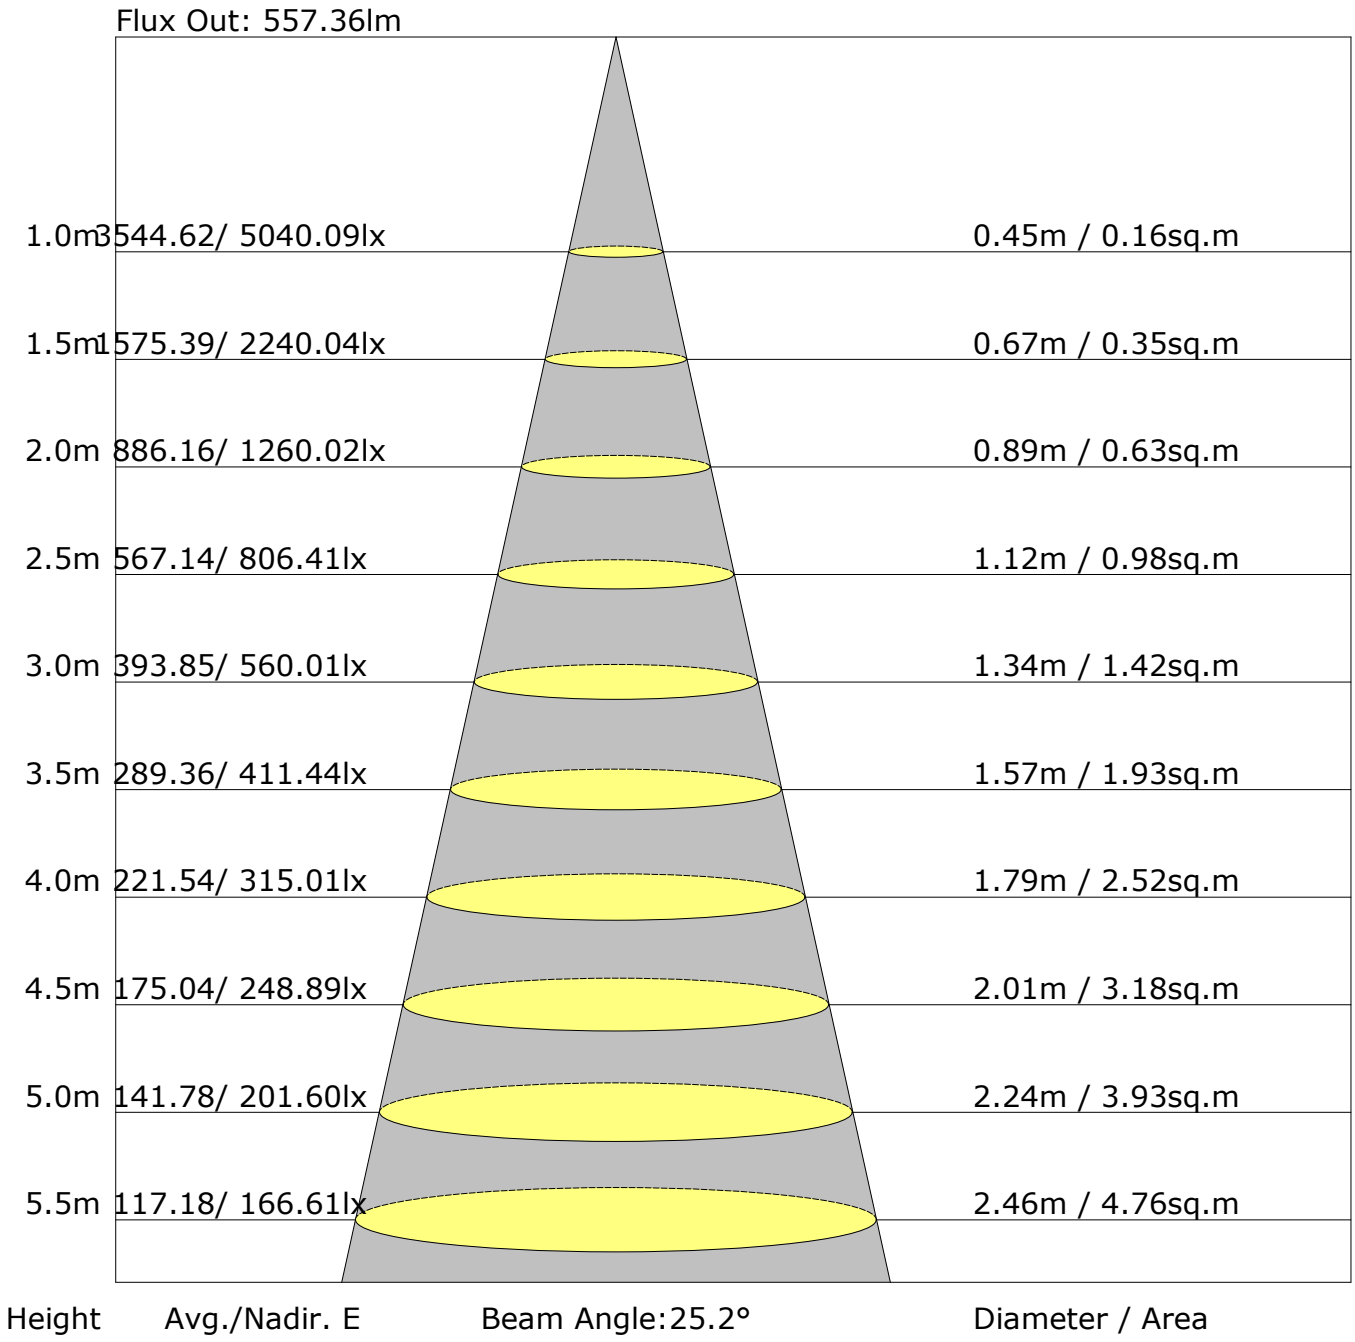

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	9.8	10.4	10.0	10.6	10.8	11.6	12.2	11.8	12.4	12.5
3H	9.7	10.2	9.9	10.4	10.7	11.4	12.0	11.7	12.2	12.4
4H	9.6	10.1	9.9	10.4	10.6	11.4	11.9	11.7	12.1	12.4
6H	9.5	10.0	9.8	10.3	10.6	11.3	11.8	11.6	12.0	12.3
8H	9.5	9.9	9.8	10.2	10.5	11.2	11.7	11.6	12.0	12.3
12H	9.4	9.9	9.8	10.2	10.5	11.2	11.7	11.6	12.0	12.3
X=4H Y=2H	9.6	10.1	9.9	10.4	10.6	11.4	11.9	11.7	12.1	12.4
3H	9.4	9.9	9.8	10.2	10.5	11.2	11.7	11.6	12.0	12.3
4H	9.3	9.7	9.7	10.1	10.4	11.1	11.5	11.5	11.9	12.2
6H	9.3	9.6	9.7	10.0	10.4	11.0	11.4	11.4	11.8	12.1
8H	9.2	9.5	9.6	9.9	10.3	11.0	11.3	11.4	11.7	12.1
12H	9.2	9.5	9.6	9.9	10.3	10.9	11.2	11.4	11.6	12.1
X=8H Y=4H	9.2	9.5	9.6	9.9	10.3	11.0	11.3	11.4	11.7	12.1
6H	9.1	9.4	9.6	9.8	10.3	10.9	11.1	11.3	11.6	12.0
8H	9.1	9.3	9.5	9.7	10.2	10.8	11.1	11.3	11.5	12.0
12H	9.0	9.2	9.5	9.7	10.2	10.8	11.0	11.3	11.4	11.9
X=12H Y=4H	9.2	9.5	9.6	9.9	10.3	10.9	11.2	11.4	11.6	12.1
6H	9.1	9.3	9.5	9.7	10.2	10.8	11.1	11.3	11.5	12.0
8H	9.0	9.2	9.5	9.7	10.2	10.8	11.0	11.3	11.4	11.9
Variations with the observer position at spacings:										
S=1.0H	+5.7/-1.$					+5.9/-1.$				
S=1.5H	+8.5/-1.$					+8.7/-1.$				
S=2.0H	+10.5/-1.$					+10.7/-1.$				

Calculate in accordance with CIE Pub.117. The table is revised with 1155lm (8log(F/F0) = 0.5).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

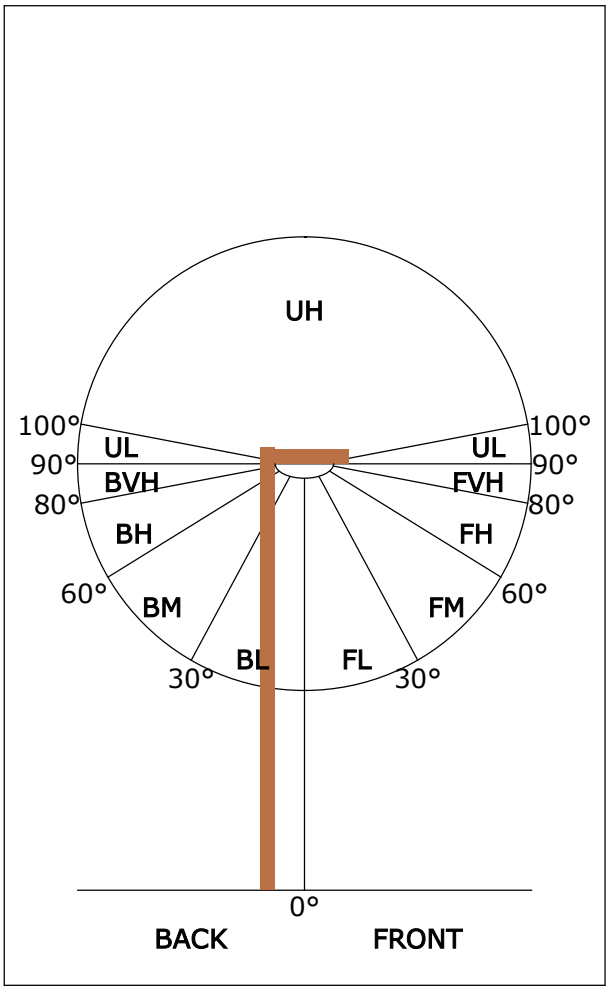

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	510	44.2
FL (0°-30°)	488	42.3
FM (30°-60°)	22	1.9
FH (60°-80°)	0	0.0
FVH (80°-90°)	0	0.0
BACK LIGHT	645	55.8
BL (0°-30°)	613	53.1
BM (30°-60°)	32	2.7
BH (60°-80°)	0	0.0
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(**B**acklight,**U**plight,**G**lare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	5027.3	4.8	4.8	0.42	0.42
1.0-2.0	4978.7	14.3	19.1	1.24	1.65
2.0-3.0	4890.8	23.4	42.5	2.03	3.68
3.0-4.0	4768.7	31.9	74.4	2.76	6.44
4.0-5.0	4609.3	39.7	114.1	3.43	9.88
5.0-6.0	4418.9	46.4	160.5	4.02	13.90
6.0-7.0	4206.0	52.2	212.7	4.52	18.42
7.0-8.0	3975.3	56.9	269.6	4.93	23.34
8.0-9.0	3726.9	60.4	330.0	5.23	28.57
9.0-10.0	3460.1	62.6	392.7	5.42	34.00
10.0-11.0	3178.9	63.5	456.2	5.50	39.49
11.0-12.0	2890.5	63.2	519.4	5.47	44.97
12.0-13.0	2605.2	61.8	581.2	5.35	50.32
13.0-14.0	2326.3	59.6	640.8	5.16	55.47
14.0-15.0	2056.8	56.5	697.3	4.89	60.36
15.0-16.0	1801.3	52.8	750.0	4.57	64.93
16.0-17.0	1564.9	48.7	798.8	4.22	69.15
17.0-18.0	1350.1	44.5	843.3	3.85	73.01
18.0-19.0	1156.0	40.2	883.5	3.48	76.49
19.0-20.0	983.0	36.0	919.5	3.12	79.61
20.0-21.0	829.6	31.9	951.4	2.76	82.36
21.0-22.0	694.7	27.9	979.3	2.42	84.78
22.0-23.0	578.6	24.3	1003.6	2.10	86.88
23.0-24.0	477.9	20.9	1024.5	1.81	88.69
24.0-25.0	393.9	17.9	1042.4	1.55	90.24
25.0-26.0	326.8	15.4	1057.8	1.34	91.58
26.0-27.0	272.1	13.3	1071.1	1.15	92.73
27.0-28.0	228.8	11.6	1082.7	1.00	93.73
28.0-29.0	193.7	10.1	1092.8	0.88	94.61
29.0-30.0	165.1	8.9	1101.8	0.77	95.38
30.0-31.0	141.3	7.9	1109.6	0.68	96.06
31.0-32.0	120.2	6.9	1116.5	0.60	96.66
32.0-33.0	101.4	6.0	1122.5	0.52	97.18
33.0-34.0	85.9	5.2	1127.7	0.45	97.63
34.0-35.0	74.3	4.6	1132.3	0.40	98.03
35.0-36.0	64.1	4.1	1136.4	0.35	98.38

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	54.3	3.5	1139.9	0.31	98.69
37.0-38.0	45.2	3.0	1142.9	0.26	98.95
38.0-39.0	37.3	2.5	1145.5	0.22	99.17
39.0-40.0	29.8	2.1	1147.6	0.18	99.35
40.0-41.0	23.7	1.7	1149.3	0.15	99.50
41.0-42.0	19.2	1.4	1150.7	0.12	99.62
42.0-43.0	15.1	1.1	1151.8	0.10	99.71
43.0-44.0	11.3	0.9	1152.6	0.07	99.79
44.0-45.0	8.7	0.7	1153.3	0.06	99.84
45.0-46.0	6.4	0.5	1153.8	0.04	99.89
46.0-47.0	4.5	0.4	1154.2	0.03	99.92
47.0-48.0	4.1	0.3	1154.5	0.03	99.95
48.0-49.0	3.4	0.3	1154.8	0.02	99.97
49.0-50.0	1.9	0.2	1154.9	0.01	99.99
50.0-51.0	0.8	0.1	1155.0	0.01	99.99
51.0-52.0	0.8	0.1	1155.1	0.01	100.00
52.0-53.0	0.4	0.0	1155.1	0.00	100.00
53.0-54.0	0.0	0.0	1155.1	0.00	100.00
54.0-55.0	0.0	0.0	1155.1	0.00	100.00
55.0-56.0	0.0	0.0	1155.1	0.00	100.00
56.0-57.0	0.0	0.0	1155.1	0.00	100.00
57.0-58.0	0.0	0.0	1155.1	0.00	100.00
58.0-59.0	0.0	0.0	1155.1	0.00	100.00
59.0-60.0	0.0	0.0	1155.1	0.00	100.00
60.0-61.0	0.0	0.0	1155.1	0.00	100.00
61.0-62.0	0.0	0.0	1155.1	0.00	100.00
62.0-63.0	0.0	0.0	1155.1	0.00	100.00
63.0-64.0	0.0	0.0	1155.1	0.00	100.00
64.0-65.0	0.0	0.0	1155.1	0.00	100.00
65.0-66.0	0.0	0.0	1155.1	0.00	100.00
66.0-67.0	0.0	0.0	1155.1	0.00	100.00
67.0-68.0	0.0	0.0	1155.1	0.00	100.00
68.0-69.0	0.0	0.0	1155.1	0.00	100.00
69.0-70.0	0.0	0.0	1155.1	0.00	100.00
70.0-71.0	0.0	0.0	1155.1	0.00	100.00
71.0-72.0	0.0	0.0	1155.1	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	0.0	0.0	1155.1	0.00	100.00
73.0-74.0	0.0	0.0	1155.1	0.00	100.00
74.0-75.0	0.0	0.0	1155.1	0.00	100.00
75.0-76.0	0.0	0.0	1155.1	0.00	100.00
76.0-77.0	0.0	0.0	1155.1	0.00	100.00
77.0-78.0	0.0	0.0	1155.1	0.00	100.00
78.0-79.0	0.0	0.0	1155.1	0.00	100.00
79.0-80.0	0.0	0.0	1155.1	0.00	100.00
80.0-81.0	0.0	0.0	1155.1	0.00	100.00
81.0-82.0	0.0	0.0	1155.1	0.00	100.00
82.0-83.0	0.0	0.0	1155.1	0.00	100.00
83.0-84.0	0.0	0.0	1155.1	0.00	100.00
84.0-85.0	0.0	0.0	1155.1	0.00	100.00
85.0-86.0	0.0	0.0	1155.1	0.00	100.00
86.0-87.0	0.0	0.0	1155.1	0.00	100.00
87.0-88.0	0.0	0.0	1155.1	0.00	100.00
88.0-89.0	0.0	0.0	1155.1	0.00	100.00
89.0-90.0	0.0	0.0	1155.1	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	5040.1	5040.1								
G1.0	4915.0	5114.0								
G2.0	4756.6	5129.0								
G3.0	4566.7	5111.0								
G4.0	4352.6	5044.6								
G5.0	4106.9	4933.0								
G6.0	3853.6	4782.3								
G7.0	3589.7	4598.3								
G8.0	3315.3	4397.8								
G9.0	3036.4	4158.1								
G10.0	2750.0	3895.8								
G11.0	2452.9	3616.9								
G12.0	2160.5	3331.9								
G13.0	1887.6	3040.9								
G14.0	1635.8	2740.9								
G15.0	1405.1	2445.4								
G16.0	1197.1	2157.4								
G17.0	1017.7	1887.6								
G18.0	854.8	1640.3								
G19.0	711.6	1417.2								
G20.0	583.5	1219.7								
G21.0	476.4	1038.8								
G22.0	386.0	877.5								
G23.0	316.6	734.2								
G24.0	256.3	604.6								
G25.0	212.6	502.0								
G26.0	177.9	414.6								
G27.0	150.8	345.3								
G28.0	129.7	289.5								
G29.0	111.6	244.2								
G30.0	96.5	208.1								
G31.0	84.4	176.4								
G32.0	73.9	146.2								
G33.0	63.3	122.1								
G34.0	52.8	105.5								
G35.0	46.7	92.0								
G36.0	39.2	78.4								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	33.2	66.3								
G38.0	24.1	57.3								
G39.0	19.6	48.2								
G40.0	13.6	37.7								
G41.0	12.1	31.7								
G42.0	9.1	24.1								
G43.0	7.5	19.6								
G44.0	4.5	13.6								
G45.0	4.5	12.1								
G46.0	1.5	7.5								
G47.0	1.5	7.5								
G48.0	1.5	6.0								
G49.0	1.5	4.5								
G50.0	0.0	1.5								
G51.0	0.0	1.5								
G52.0	0.0	1.5								
G53.0	0.0	0.0								
G54.0	0.0	0.0								
G55.0	0.0	0.0								
G56.0	0.0	0.0								
G57.0	0.0	0.0								
G58.0	0.0	0.0								
G59.0	0.0	0.0								
G60.0	0.0	0.0								
G61.0	0.0	0.0								
G62.0	0.0	0.0								
G63.0	0.0	0.0								
G64.0	0.0	0.0								
G65.0	0.0	0.0								
G66.0	0.0	0.0								
G67.0	0.0	0.0								
G68.0	0.0	0.0								
G69.0	0.0	0.0								
G70.0	0.0	0.0								
G71.0	0.0	0.0								
G72.0	0.0	0.0								
G73.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	0.0	0.0								
G75.0	0.0	0.0								
G76.0	0.0	0.0								
G77.0	0.0	0.0								
G78.0	0.0	0.0								
G79.0	0.0	0.0								
G80.0	0.0	0.0								
G81.0	0.0	0.0								
G82.0	0.0	0.0								
G83.0	0.0	0.0								
G84.0	0.0	0.0								
G85.0	0.0	0.0								
G86.0	0.0	0.0								
G87.0	0.0	0.0								
G88.0	0.0	0.0								
G89.0	0.0	0.0								
G90.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: