Report No.: Test Time: 2026-09-10 15:28

Luminaire Property

Luminaire Manufacturer:
Luminaire Description: 60D
Luminous Width (mm): -40
Current: 0.064 A
Power Factor: 0.940
Luminous Length (mm): -40
Voltage: 229.8 V
Power: 13.80 W


Photometric Results

CIE Class: Direct
Measurement Flux: 1026.3 lm
Downward Ratio: 100%
Horizontal Diffuse Angle(50%): H56.6
Vertical Diffuse Angle(50%): V56.6
Luminaire Efficacy Rating (LER): 74.42
Max. Intensity: 1245.11 cd
S/MH(C0/C180): 0.90
Total Rated Lamp Lumens: 1026.3 lm
Efficiency: 100%
Upward Ratio: 0%
Central Intensity: 1244.36 cd
Pos of Max. Intensity: H0 V1
S/MH(C90/C270): 0.90

Picture Of Luminaire




Luminous Intensity Distribution Curve

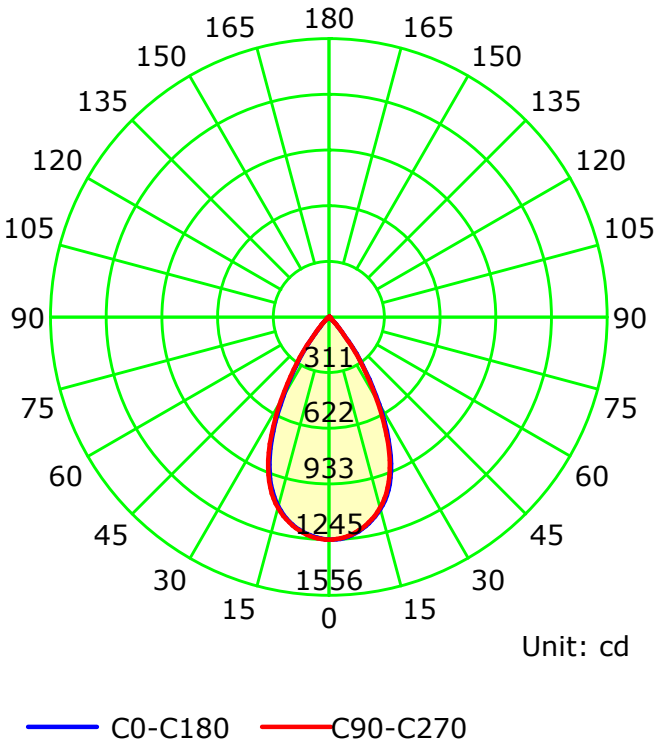


Unit: cd

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:
Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve

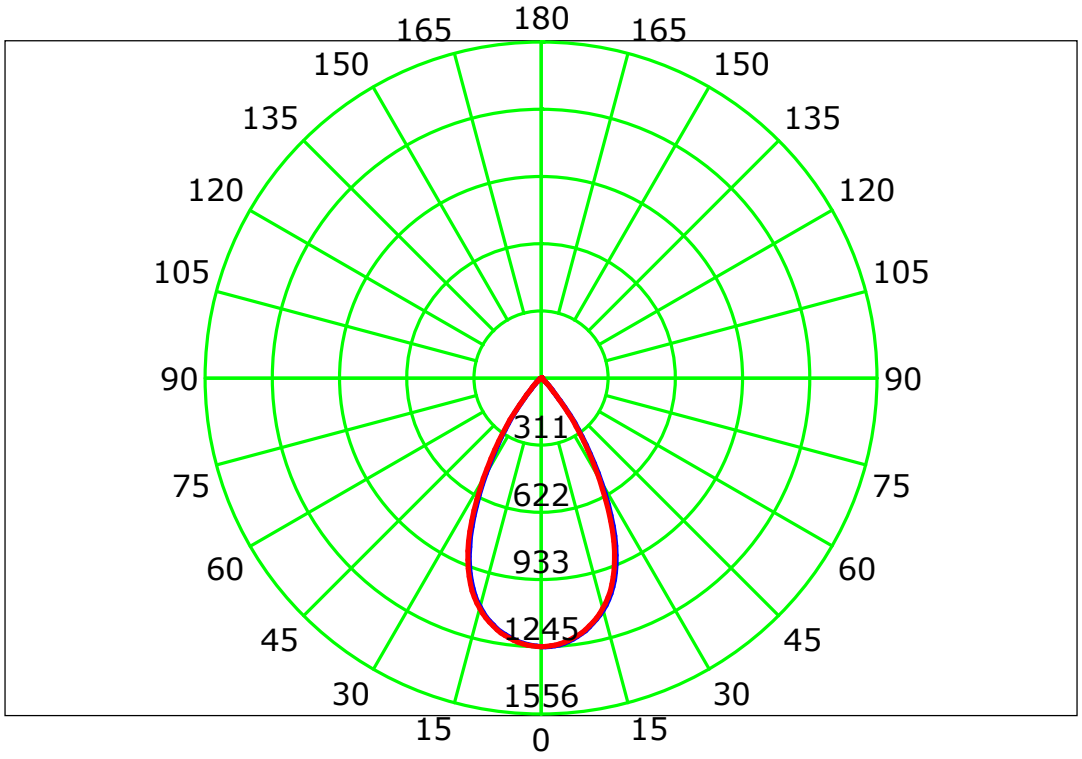


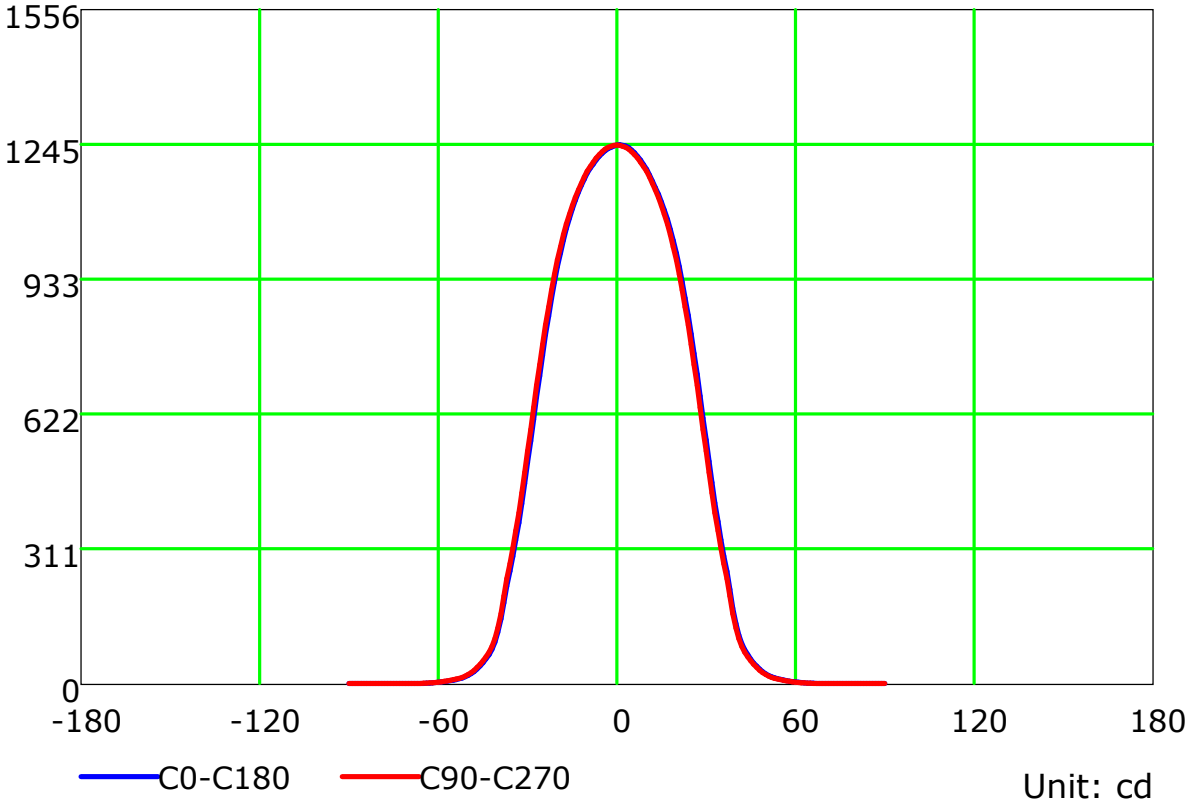

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

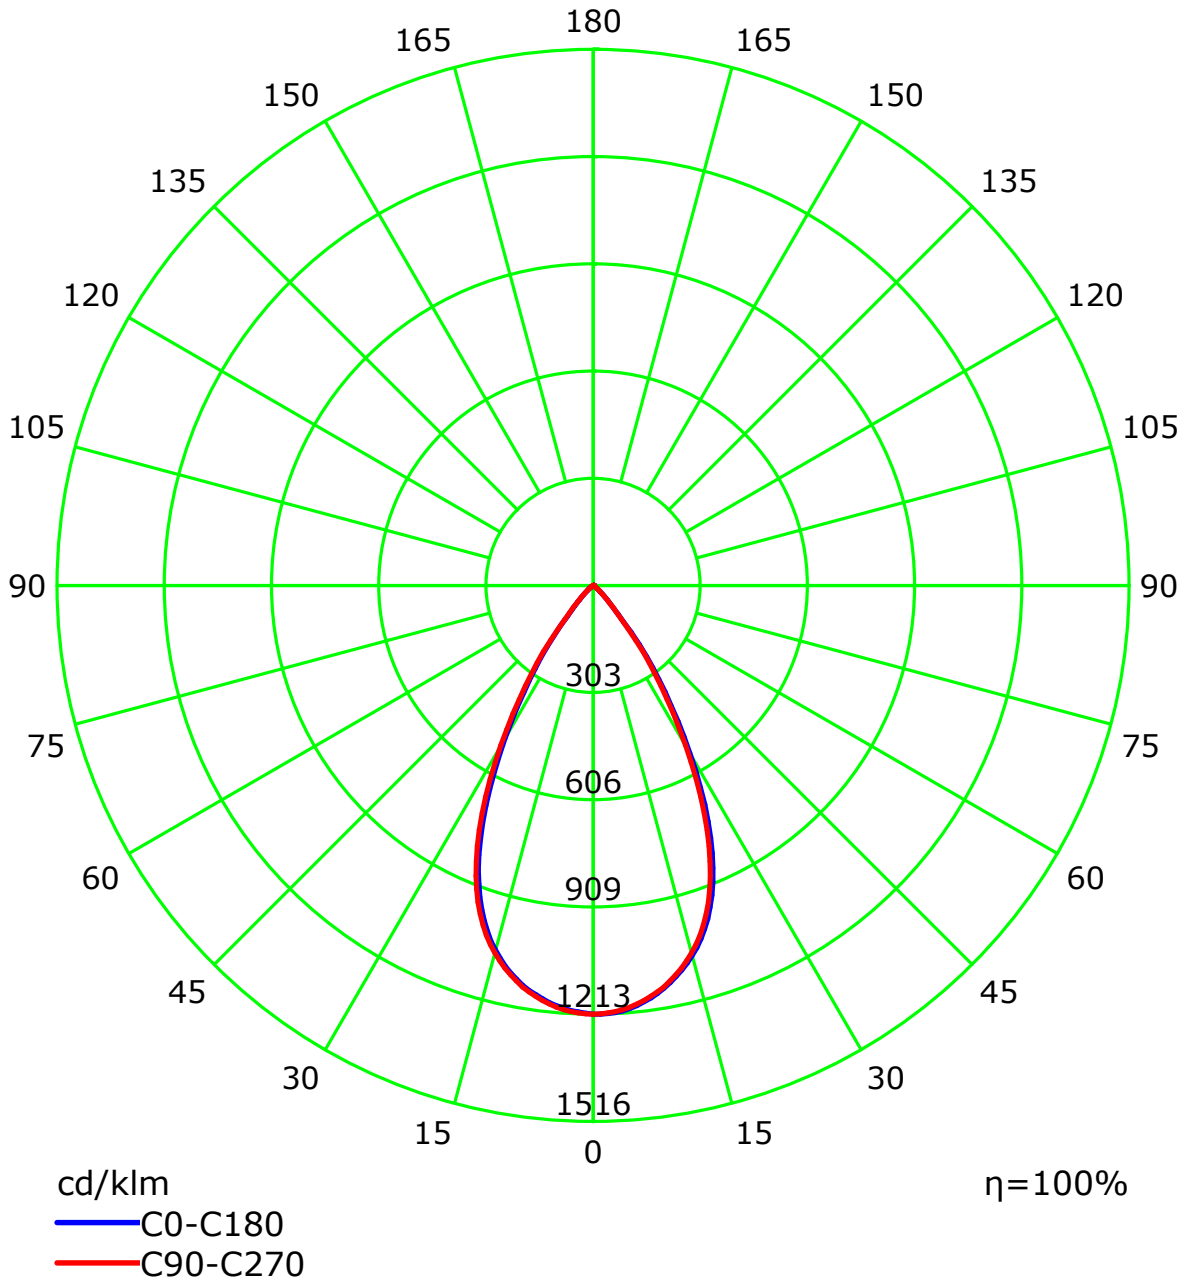

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

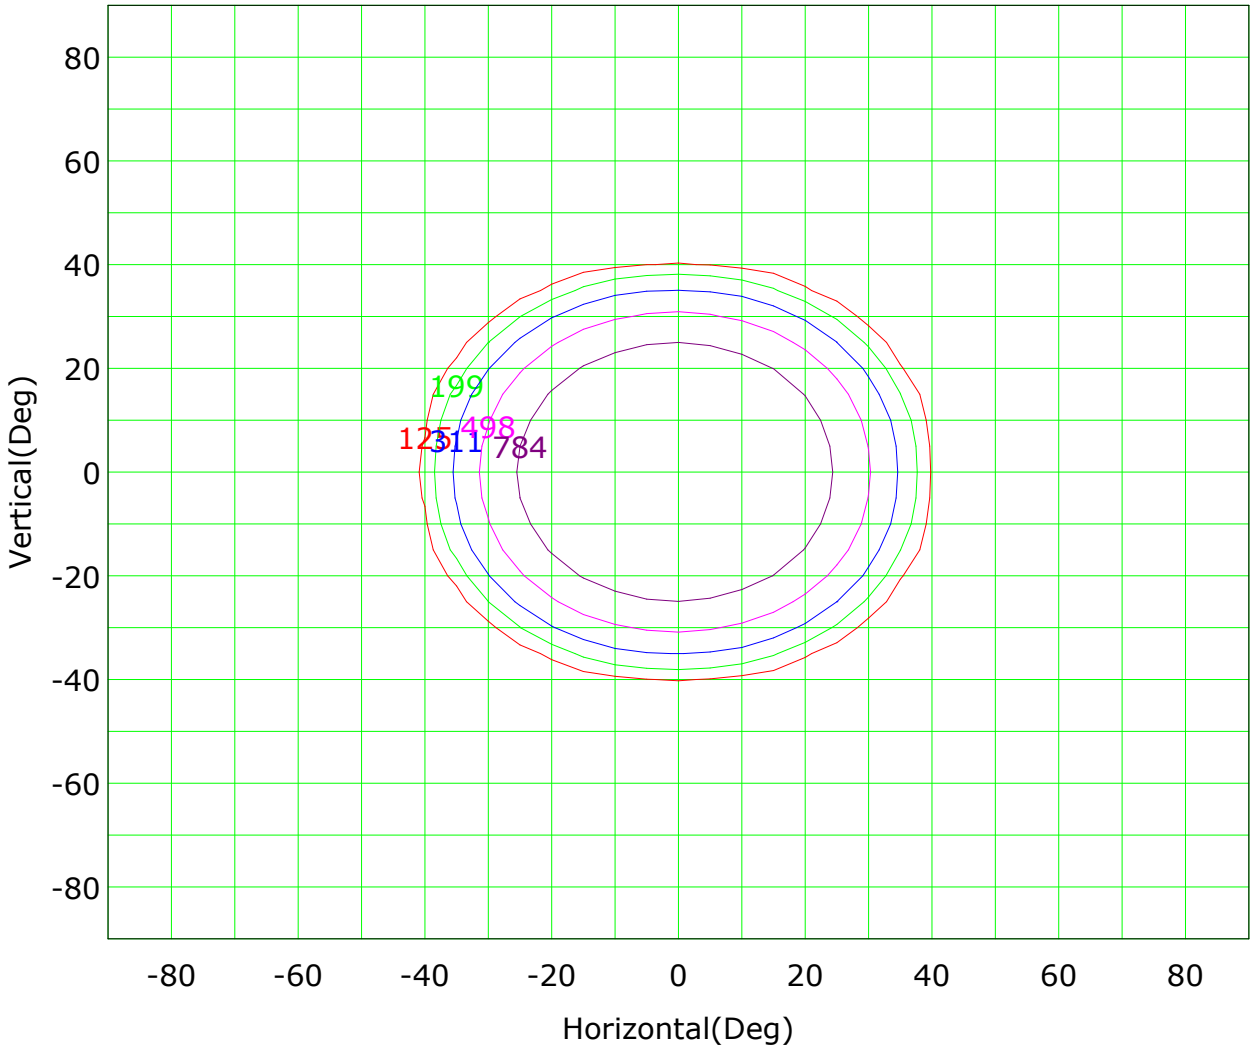


Imax (100%): 1245 cd

(10%): 125 cd
(16%): 199 cd
(25%): 311 cd
(40%): 498 cd
(63%): 784 cd
(100%): 1245 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

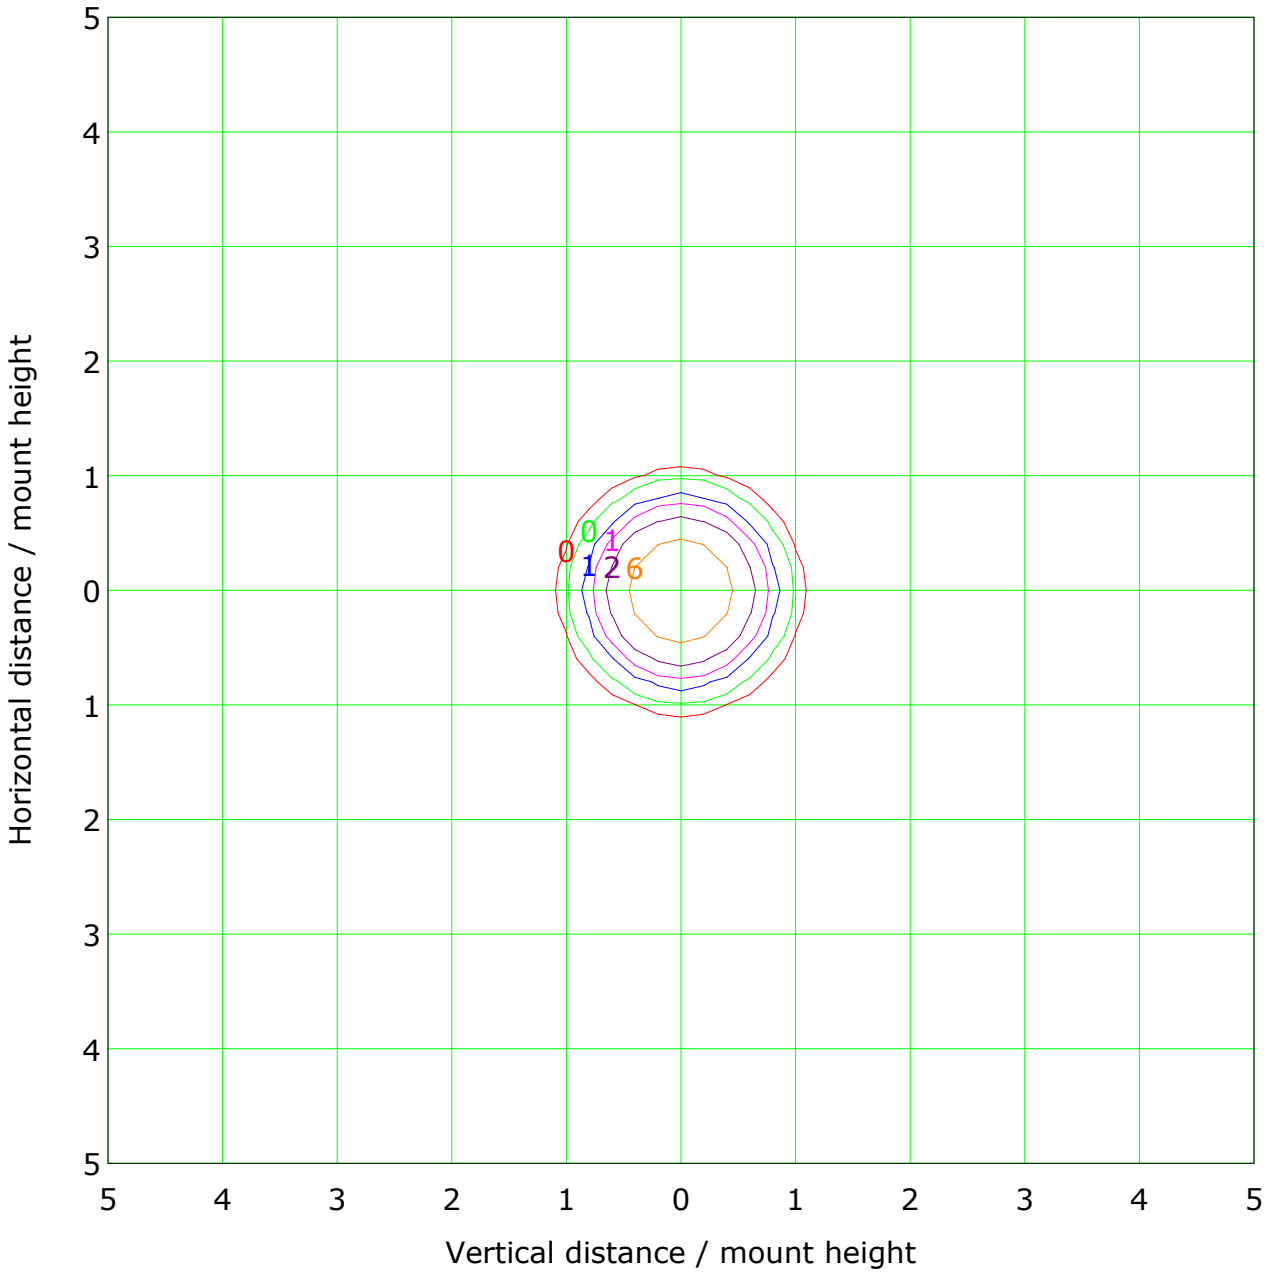


Mounting Height: 10.0m Max Lux(100%): 12.4 lx

(1%): 0.1 lx
(2%): 0.2 lx
(5%): 0.6 lx
(10%): 1.2 lx
(20%): 2.5 lx
(50%): 6.2 lx
(100%): 12.4 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Illuminance at a Distance

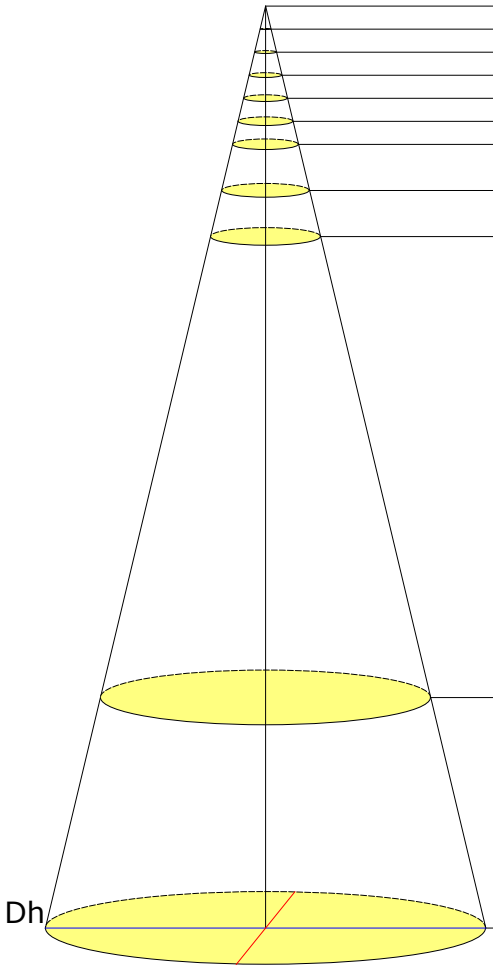


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	4977.44	0.54/0.54	0.2	2010.90
1.0	1244.36	1.08/1.08	0.9	502.72
1.5	553.05	1.61/1.62	2.0	223.43
2.0	311.09	2.15/2.15	3.6	125.68
2.5	199.10	2.69/2.69	5.7	80.44
3.0	138.26	3.23/3.23	8.2	55.86
4.0	77.77	4.31/4.31	14.6	31.42
5.0	49.77	5.38/5.39	22.8	20.11
15.0	5.53	16.15/16.16	204.9	2.23
20.0	3.11	21.53/21.54	364.4	1.26

Beam Angle(B): H56.6 V56.6 Field Angle(F): H80.3 V80.3

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

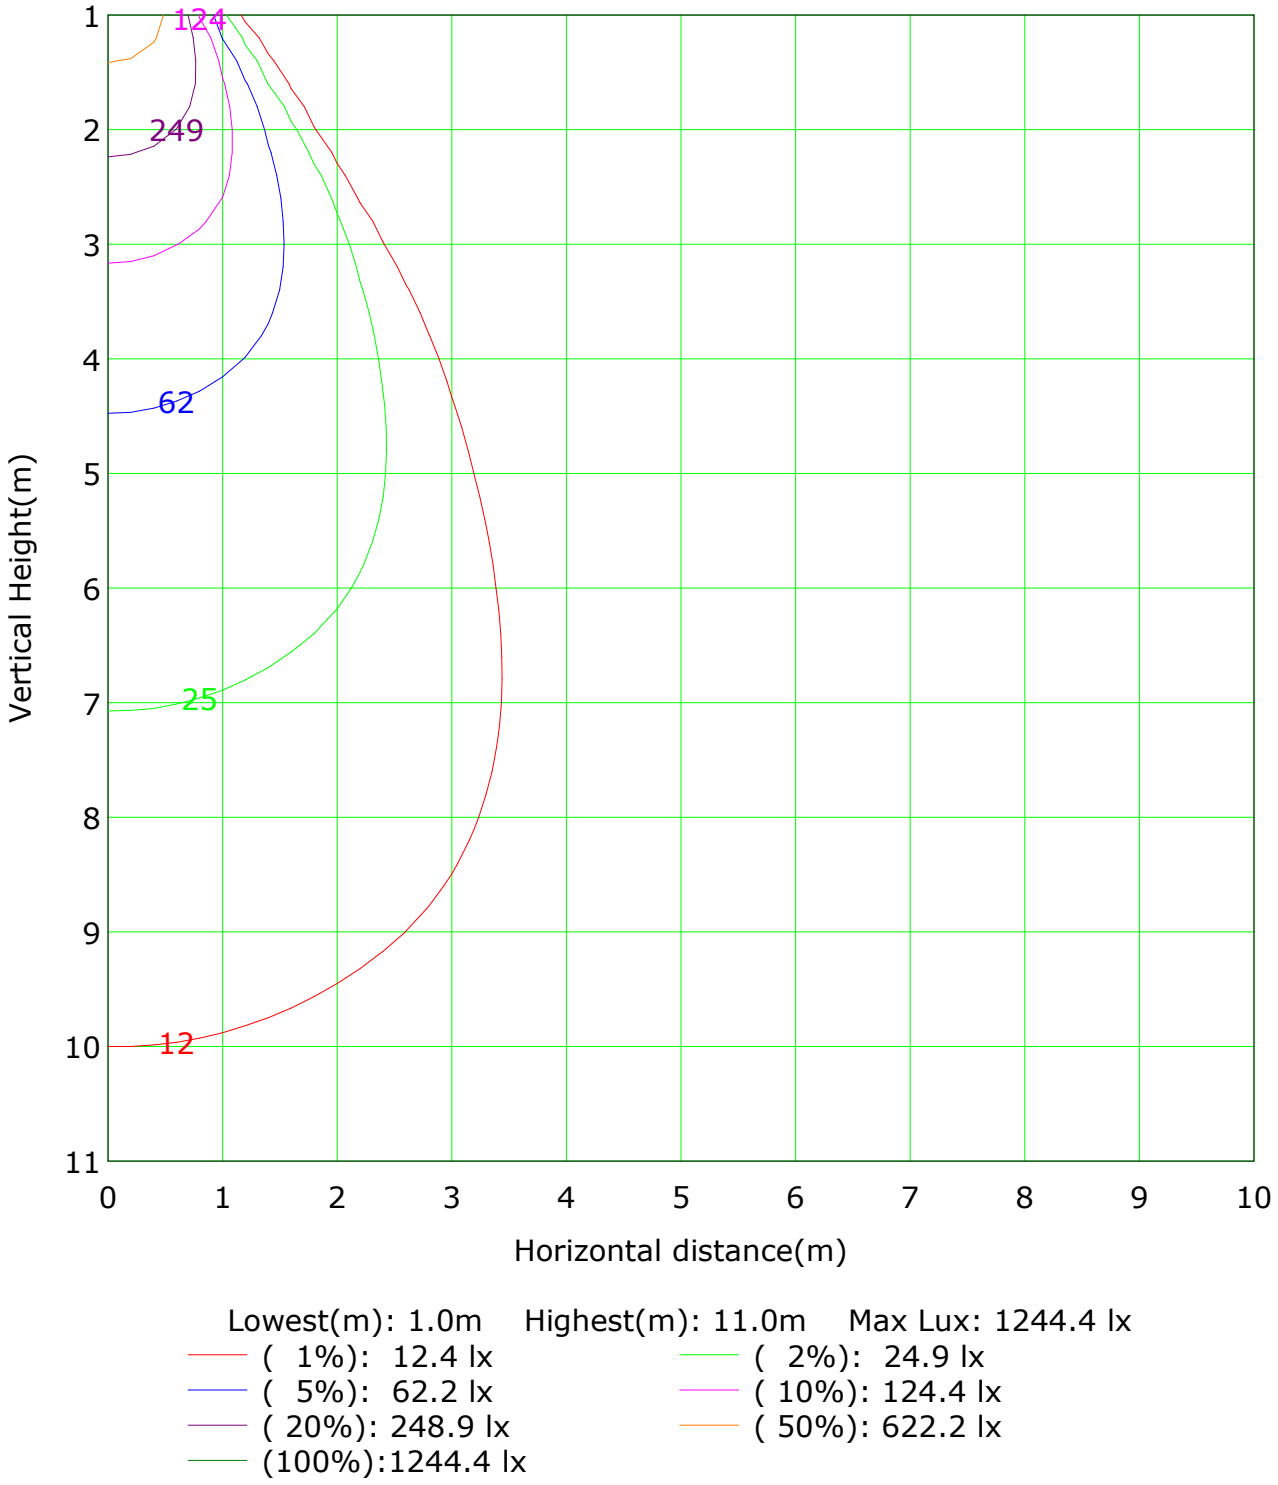

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 1244.4 lx

(1%): 12.4 lx
(2%): 24.9 lx
(5%): 62.2 lx
(10%): 124.4 lx
(20%): 248.9 lx
(50%): 622.2 lx
(100%):1244.4 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Area Flux Table

Unit: lm


Horizontal plane	Vertical plane																									
	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.8	0.0
-50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	1.1	0.8	0.5	0.2	0.1	0.0	0.0	0.0	0.0	0.0	5.5	0.0
-40	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.2	0.8	7.2	5.2	2.4	0.8	0.2	0.1	0.0	0.0	0.0	0.0	31.9	25.5
-30	0.0	0.0	0.0	0.0	0.0	0.1	0.6	2.7	8.7	20.1	15.8	8.7	2.7	0.6	0.1	0.0	0.0	0.0	0.0	96.1	91.3
-20	0.0	0.0	0.0	0.0	0.0	0.2	1.2	6.3	17.0	31.4	26.9	17.0	6.3	1.2	0.2	0.0	0.0	0.0	0.0	165.8	161.5
-10	0.0	0.0	0.0	0.0	0.0	0.3	1.7	9.2	22.5	36.4	32.5	22.5	9.2	1.7	0.3	0.0	0.0	0.0	0.0	205.2	201.0
0	0.0	0.0	0.0	0.0	0.0	0.3	1.7	9.3	22.7	36.5	32.6	22.7	9.3	1.7	0.3	0.0	0.0	0.0	0.0	206.3	202.2
10	0.0	0.0	0.0	0.0	0.0	0.2	1.2	6.5	17.5	31.8	27.4	17.5	6.5	1.2	0.2	0.0	0.0	0.0	0.0	169.5	165.2
20	0.0	0.0	0.0	0.0	0.0	0.1	0.7	2.9	9.3	21.2	16.7	9.3	2.9	0.7	0.1	0.0	0.0	0.0	0.0	101.8	97.1
30	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.9	2.7	8.1	5.8	2.7	0.9	0.3	0.1	0.0	0.0	0.0	0.0	35.5	29.3
40	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.5	1.3	1.0	0.5	0.2	0.1	0.0	0.0	0.0	0.0	0.0	6.4	0.1
50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.2	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0
60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90																				1026	973
Flux(E)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Flux(T)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0			
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0				
60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0					
50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0						
40	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0							
30	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0								
20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0									
10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0										
0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0											
-10	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0												
-20	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0													
-30	0.0	0.0	0.0	0.0	0.0	0.0	0.0														
-40	0.0	0.0	0.0	0.0	0.0	0.0															
-50	0.0	0.0	0.0	0.0	0.0																
-60	0.0	0.0	0.0	0.0																	
-70	0.0	0.0	0.0																		
-80	0.0	0.0																			
-90	0.0																				

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

Flux Out: 722.90lm

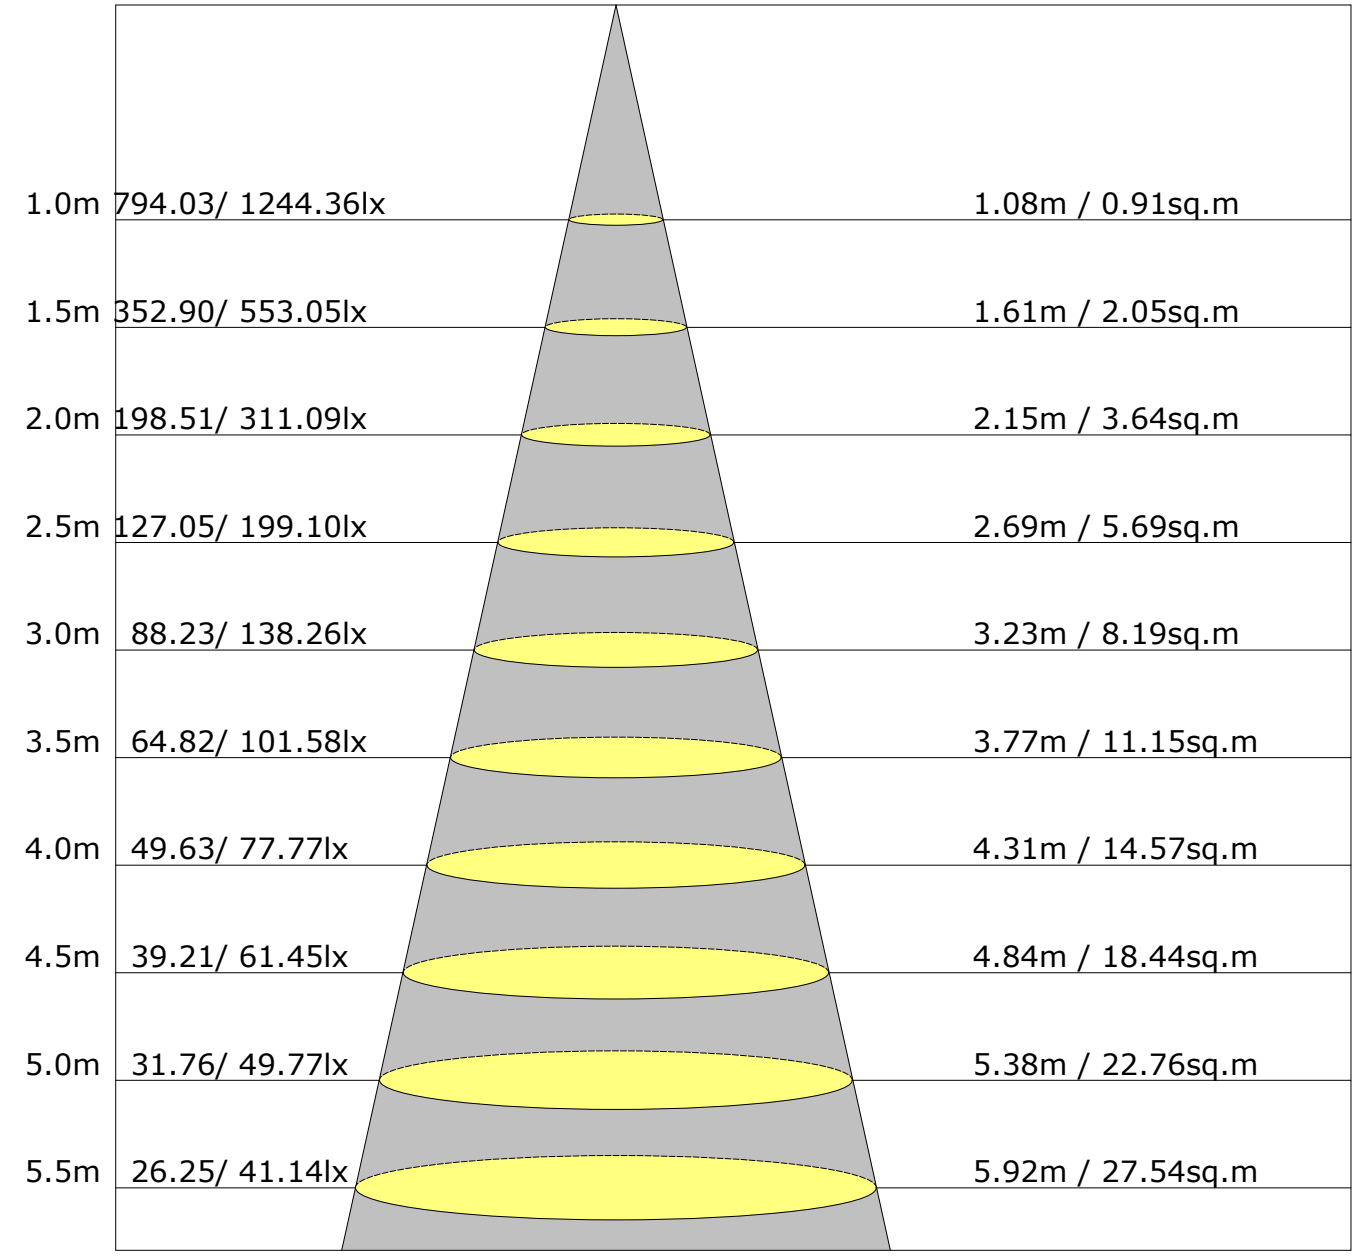

Height Avg./Nadir. E Beam Angle:56.6° Diameter / Area

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	23.1	24.0	23.4	24.2	24.4	22.9	23.7	23.2	23.9	24.1
3H	23.0	23.8	23.3	24.0	24.2	22.7	23.5	23.0	23.7	24.0
4H	22.9	23.6	23.2	23.9	24.2	22.7	23.4	23.0	23.6	23.9
6H	22.8	23.5	23.2	23.8	24.1	22.6	23.3	22.9	23.5	23.8
8H	22.8	23.4	23.2	23.7	24.0	22.6	23.2	22.9	23.5	23.8
12H	22.8	23.4	23.1	23.7	24.0	22.5	23.1	22.9	23.4	23.8
X=4H Y=2H	22.9	23.6	23.2	23.9	24.2	22.7	23.4	23.0	23.6	23.9
3H	22.8	23.4	23.1	23.7	24.0	22.5	23.1	22.9	23.4	23.8
4H	22.7	23.2	23.1	23.6	23.9	22.4	23.0	22.8	23.3	23.7
6H	22.6	23.1	23.0	23.5	23.8	22.4	22.8	22.8	23.2	23.6
8H	22.6	23.0	23.0	23.4	23.8	22.3	22.8	22.7	23.1	23.5
12H	22.5	22.9	23.0	23.3	23.7	22.3	22.7	22.7	23.1	23.5
X=8H Y=4H	22.6	23.0	23.0	23.4	23.8	22.3	22.8	22.7	23.1	23.5
6H	22.5	22.8	22.9	23.3	23.7	22.2	22.6	22.7	23.0	23.5
8H	22.4	22.7	22.9	23.2	23.7	22.2	22.5	22.7	22.9	23.4
12H	22.4	22.7	22.9	23.1	23.6	22.1	22.4	22.6	22.9	23.4
X=12H Y=4H	22.5	22.9	23.0	23.3	23.7	22.3	22.7	22.7	23.1	23.5
6H	22.4	22.7	22.9	23.2	23.7	22.2	22.5	22.7	22.9	23.4
8H	22.4	22.7	22.9	23.1	23.6	22.1	22.4	22.6	22.9	23.4
Variations with the observer position at spacings:										
S=1.0H	+5.2/-12.6					+5.1/-12.8				
S=1.5H	+7.9/-20.3					+7.9/-21.0				
S=2.0H	+9.9/-34.9					+9.9/-37.0				

Calculate in accordance with CIE Pub.117. The table is revised with 1026lm (8log(F/F0) = 0.1).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

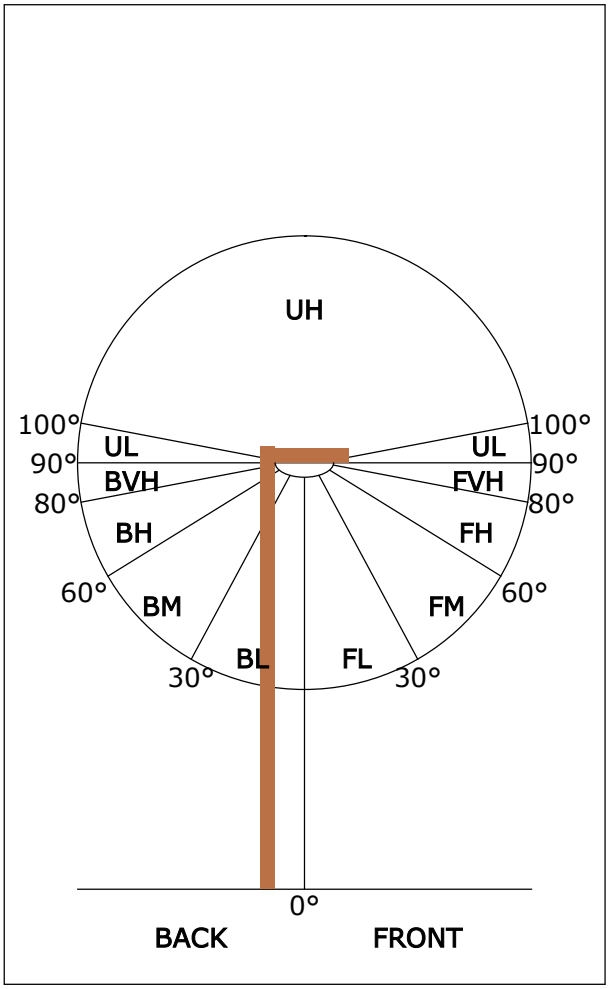

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	521	50.7
FL (0°-30°)	391	38.1
FM (30°-60°)	129	12.6
FH (60°-80°)	1	0.1
FVH (80°-90°)	0	0.0
BACK LIGHT	506	49.3
BL (0°-30°)	384	37.5
BM (30°-60°)	121	11.8
BH (60°-80°)	0	0.0
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(**B**acklight,**U**plight,**G**lare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B1 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B1 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	1244.0	1.2	1.2	0.12	0.12
1.0-2.0	1242.5	3.6	4.8	0.35	0.46
2.0-3.0	1240.2	5.9	10.7	0.58	1.04
3.0-4.0	1236.6	8.3	19.0	0.81	1.85
4.0-5.0	1231.3	10.6	29.6	1.03	2.88
5.0-6.0	1225.2	12.9	42.4	1.25	4.14
6.0-7.0	1217.7	15.1	57.6	1.47	5.61
7.0-8.0	1208.9	17.3	74.9	1.69	7.29
8.0-9.0	1199.6	19.4	94.3	1.89	9.19
9.0-10.0	1189.0	21.5	115.8	2.10	11.29
10.0-11.0	1176.5	23.5	139.3	2.29	13.58
11.0-12.0	1162.6	25.4	164.8	2.48	16.05
12.0-13.0	1147.9	27.2	192.0	2.65	18.71
13.0-14.0	1131.7	29.0	221.0	2.82	21.53
14.0-15.0	1113.8	30.6	251.6	2.98	24.51
15.0-16.0	1094.6	32.1	283.6	3.13	27.64
16.0-17.0	1073.1	33.4	317.1	3.26	30.89
17.0-18.0	1049.1	34.6	351.6	3.37	34.26
18.0-19.0	1022.9	35.6	387.2	3.47	37.73
19.0-20.0	993.8	36.4	423.6	3.54	41.28
20.0-21.0	961.9	36.9	460.6	3.60	44.88
21.0-22.0	927.3	37.3	497.8	3.63	48.51
22.0-23.0	889.8	37.3	535.2	3.64	52.15
23.0-24.0	849.3	37.1	572.3	3.62	55.77
24.0-25.0	806.0	36.7	609.0	3.57	59.34
25.0-26.0	760.2	35.9	644.8	3.50	62.83
26.0-27.0	712.6	34.9	679.7	3.40	66.23
27.0-28.0	663.0	33.6	713.3	3.27	69.50
28.0-29.0	612.3	32.0	745.3	3.12	72.62
29.0-30.0	562.0	30.4	775.7	2.96	75.58
30.0-31.0	512.5	28.5	804.2	2.78	78.36
31.0-32.0	464.2	26.6	830.8	2.59	80.95
32.0-33.0	417.5	24.6	855.4	2.40	83.35
33.0-34.0	373.7	22.6	878.0	2.20	85.55
34.0-35.0	333.1	20.7	898.7	2.02	87.57
35.0-36.0	295.3	18.8	917.5	1.83	89.40

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	259.5	16.9	934.4	1.65	91.05
37.0-38.0	222.0	14.8	949.3	1.44	92.49
38.0-39.0	181.9	12.4	961.7	1.21	93.71
39.0-40.0	145.2	10.1	971.8	0.99	94.69
40.0-41.0	116.2	8.3	980.1	0.81	95.50
41.0-42.0	95.1	6.9	987.0	0.67	96.17
42.0-43.0	79.6	5.9	992.9	0.57	96.75
43.0-44.0	67.5	5.1	998.0	0.50	97.24
44.0-45.0	57.3	4.4	1002.4	0.43	97.67
45.0-46.0	48.5	3.8	1006.2	0.37	98.04
46.0-47.0	40.8	3.2	1009.4	0.32	98.36
47.0-48.0	34.0	2.7	1012.2	0.27	98.63
48.0-49.0	28.1	2.3	1014.5	0.22	98.85
49.0-50.0	23.2	1.9	1016.4	0.19	99.04
50.0-51.0	19.2	1.6	1018.0	0.16	99.20
51.0-52.0	16.0	1.4	1019.4	0.13	99.33
52.0-53.0	13.5	1.2	1020.6	0.11	99.45
53.0-54.0	11.6	1.0	1021.6	0.10	99.54
54.0-55.0	9.8	0.9	1022.5	0.08	99.63
55.0-56.0	8.3	0.7	1023.2	0.07	99.70
56.0-57.0	7.0	0.6	1023.9	0.06	99.77
57.0-58.0	5.8	0.5	1024.4	0.05	99.82
58.0-59.0	4.8	0.4	1024.9	0.04	99.86
59.0-60.0	3.8	0.4	1025.2	0.04	99.90
60.0-61.0	3.1	0.3	1025.5	0.03	99.92
61.0-62.0	2.4	0.2	1025.7	0.02	99.95
62.0-63.0	1.8	0.2	1025.9	0.02	99.97
63.0-64.0	1.3	0.1	1026.1	0.01	99.98
64.0-65.0	0.9	0.1	1026.1	0.01	99.99
65.0-66.0	0.6	0.1	1026.2	0.01	99.99
66.0-67.0	0.3	0.0	1026.2	0.00	100.00
67.0-68.0	0.1	0.0	1026.2	0.00	100.00
68.0-69.0	0.1	0.0	1026.3	0.00	100.00
69.0-70.0	0.1	0.0	1026.3	0.00	100.00
70.0-71.0	0.0	0.0	1026.3	0.00	100.00
71.0-72.0	0.1	0.0	1026.3	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	0.1	0.0	1026.3	0.00	100.00
73.0-74.0	0.0	0.0	1026.3	0.00	100.00
74.0-75.0	0.0	0.0	1026.3	0.00	100.00
75.0-76.0	0.0	0.0	1026.3	0.00	100.00
76.0-77.0	0.0	0.0	1026.3	0.00	100.00
77.0-78.0	0.0	0.0	1026.3	0.00	100.00
78.0-79.0	0.0	0.0	1026.3	0.00	100.00
79.0-80.0	0.0	0.0	1026.3	0.00	100.00
80.0-81.0	0.0	0.0	1026.3	0.00	100.00
81.0-82.0	0.0	0.0	1026.3	0.00	100.00
82.0-83.0	0.0	0.0	1026.3	0.00	100.00
83.0-84.0	0.0	0.0	1026.3	0.00	100.00
84.0-85.0	0.0	0.0	1026.3	0.00	100.00
85.0-86.0	0.0	0.0	1026.3	0.00	100.00
86.0-87.0	0.0	0.0	1026.3	0.00	100.00
87.0-88.0	0.0	0.0	1026.3	0.00	100.00
88.0-89.0	0.0	0.0	1026.3	0.00	100.00
89.0-90.0	0.0	0.0	1026.3	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	1244.4	1244.4								
G1.0	1245.1	1242.1								
G2.0	1243.6	1239.1								
G3.0	1242.1	1235.9								
G4.0	1238.1	1230.4								
G5.0	1232.2	1224.7								
G6.0	1225.9	1217.9								
G7.0	1217.5	1209.4								
G8.0	1208.9	1199.9								
G9.0	1199.0	1190.5								
G10.0	1187.6	1178.9								
G11.0	1174.4	1165.1								
G12.0	1160.4	1150.7								
G13.0	1145.6	1135.1								
G14.0	1129.8	1116.3								
G15.0	1112.5	1096.6								
G16.0	1093.6	1075.6								
G17.0	1072.2	1051.0								
G18.0	1049.0	1024.4								
G19.0	1023.3	994.8								
G20.0	994.1	962.8								
G21.0	962.8	927.9								
G22.0	927.9	890.8								
G23.0	890.9	849.5								
G24.0	850.8	806.1								
G25.0	807.9	759.1								
G26.0	762.4	711.2								
G27.0	714.7	662.3								
G28.0	664.7	610.5								
G29.0	613.5	560.5								
G30.0	563.0	511.2								
G31.0	513.3	462.6								
G32.0	465.0	415.7								
G33.0	417.7	371.6								
G34.0	374.1	331.4								
G35.0	332.7	294.3								
G36.0	294.4	259.7								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	258.8	225.1								
G38.0	217.6	186.5								
G39.0	174.3	149.4								
G40.0	138.7	118.3								
G41.0	112.3	95.6								
G42.0	92.9	79.6								
G43.0	78.8	67.1								
G44.0	66.7	57.3								
G45.0	56.6	48.7								
G46.0	47.7	41.0								
G47.0	40.4	33.9								
G48.0	33.5	28.1								
G49.0	27.6	23.1								
G50.0	22.8	19.2								
G51.0	18.9	15.9								
G52.0	15.9	13.2								
G53.0	13.8	11.3								
G54.0	11.6	9.6								
G55.0	9.8	8.1								
G56.0	8.4	6.9								
G57.0	6.9	5.7								
G58.0	5.7	4.8								
G59.0	4.7	3.9								
G60.0	3.8	3.0								
G61.0	3.3	2.4								
G62.0	2.4	1.6								
G63.0	2.1	1.2								
G64.0	1.2	0.8								
G65.0	1.0	0.4								
G66.0	0.8	0.2								
G67.0	0.4	0.0								
G68.0	0.2	0.0								
G69.0	0.2	0.0								
G70.0	0.2	0.0								
G71.0	0.0	0.0								
G72.0	0.3	0.0								
G73.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	0.0	0.0								
G75.0	0.0	0.0								
G76.0	0.0	0.0								
G77.0	0.0	0.0								
G78.0	0.0	0.0								
G79.0	0.0	0.0								
G80.0	0.0	0.0								
G81.0	0.0	0.0								
G82.0	0.0	0.0								
G83.0	0.0	0.0								
G84.0	0.0	0.0								
G85.0	0.0	0.0								
G86.0	0.0	0.0								
G87.0	0.0	0.0								
G88.0	0.0	0.0								
G89.0	0.0	0.0								
G90.0	0.0	0.0								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: