中山雅大光电有限公司
www.artdon.cn
0760-22211886
0760-22211890

Report No.: Test Time: 2026-09-10 16:41

Luminaire Property


Luminaire Manufacturer:
Luminaire Description: 60D
Luminous Length (mm): -60
Luminous Width (mm): -60
Voltage: 230.2 V
Current: 0.108 A
Power: 24.40 W
Power Factor: 0.977

Photometric Results

CIE Class: Direct
Total Rated Lamp Lumens: 2675.8 lm
Measurement Flux: 2675.8 lm
Efficiency: 100%
Downward Ratio: 100%
Upward Ratio: 0%
Horizontal Diffuse Angle(50%): H56.8
Vertical Diffuse Angle(50%): V56.8
Luminaire Efficacy Rating (LER): 109.71
Central Intensity: 3208.19 cd
Max. Intensity: 3217.06 cd
Pos of Max. Intensity: H0 V6
S/MH(C0/C180): 0.90
S/MH(C90/C270): 0.90


Picture Of Luminaire


Luminous Intensity Distribution Curve

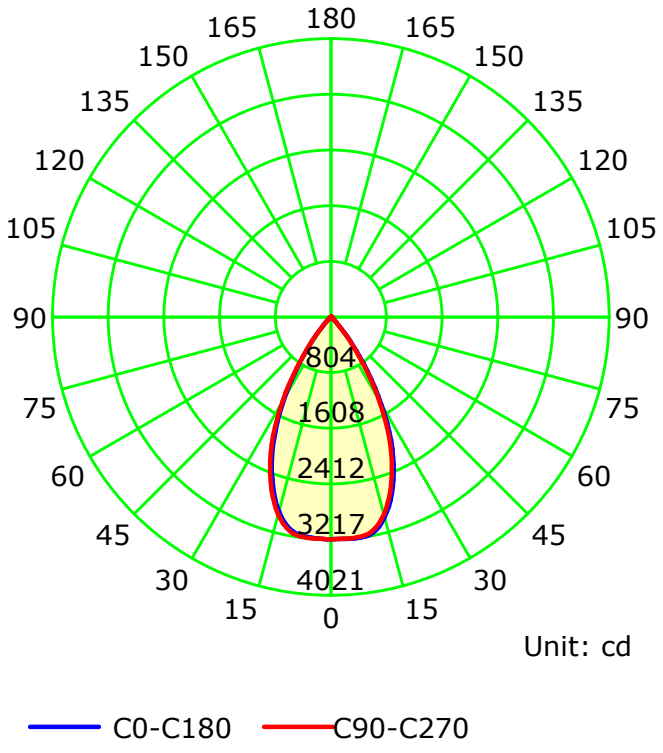

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Luminous Intensity Distribution Curve

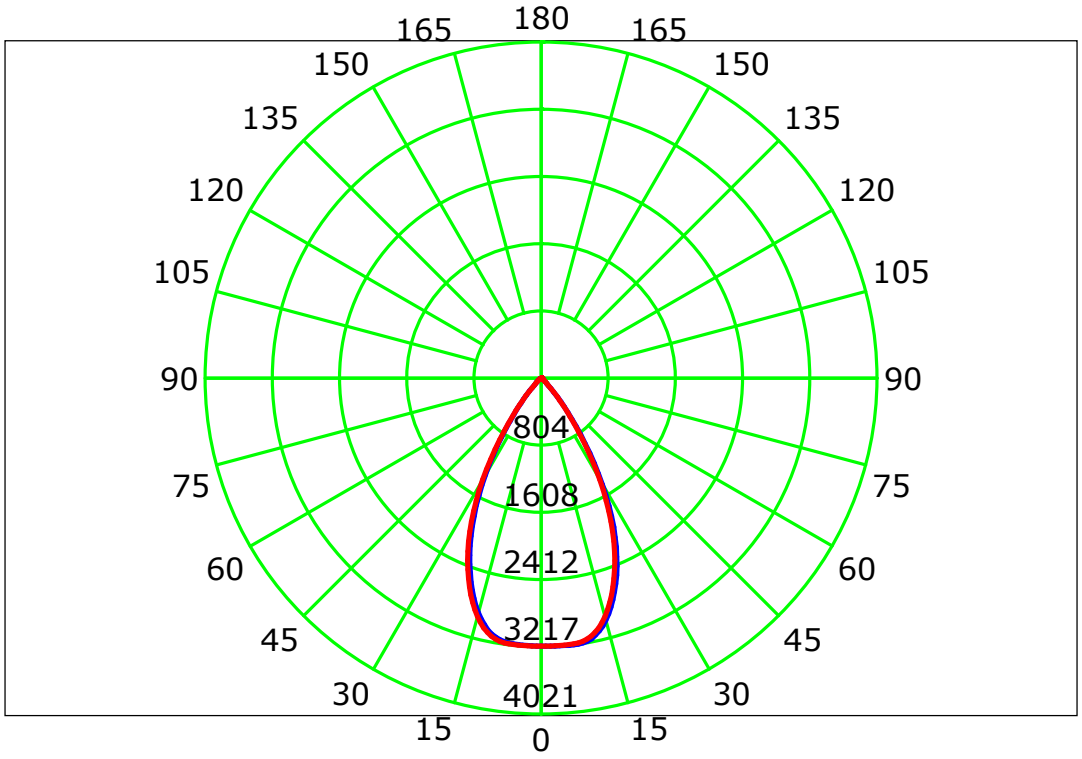


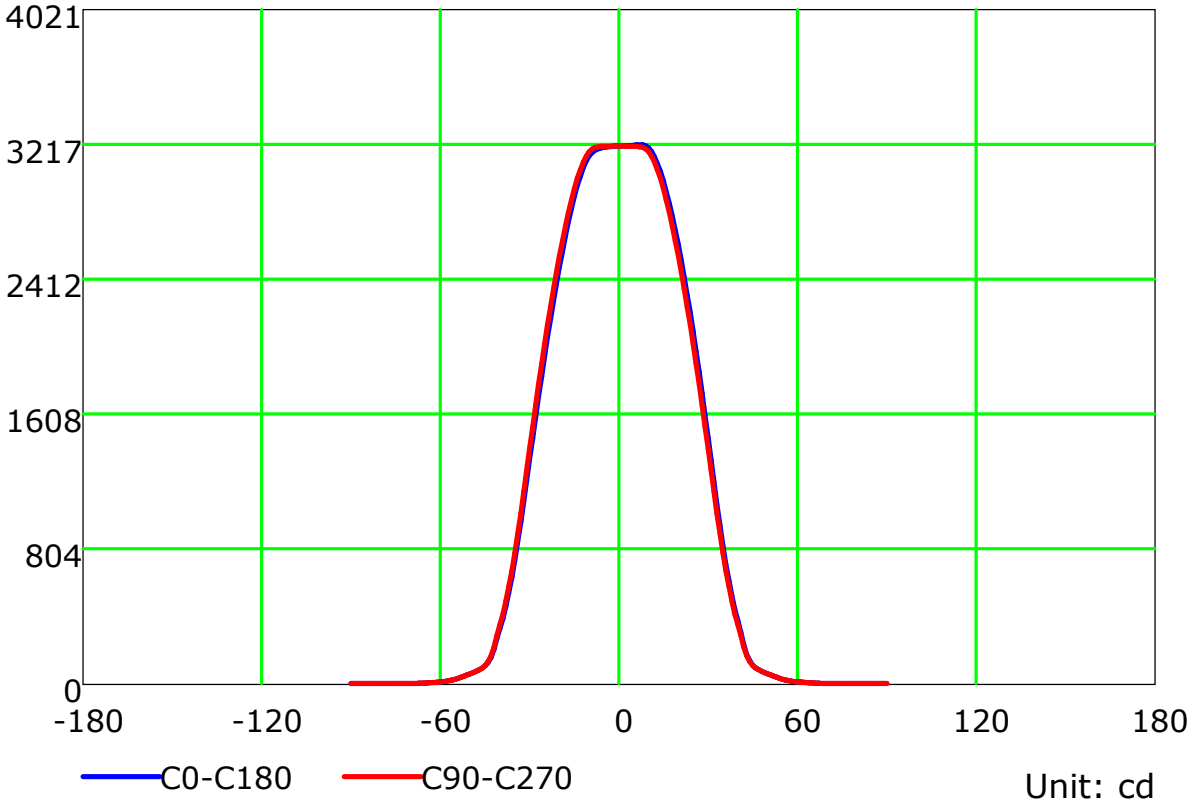

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:


Luminous Intensity Distribution Curve(cd/klm)

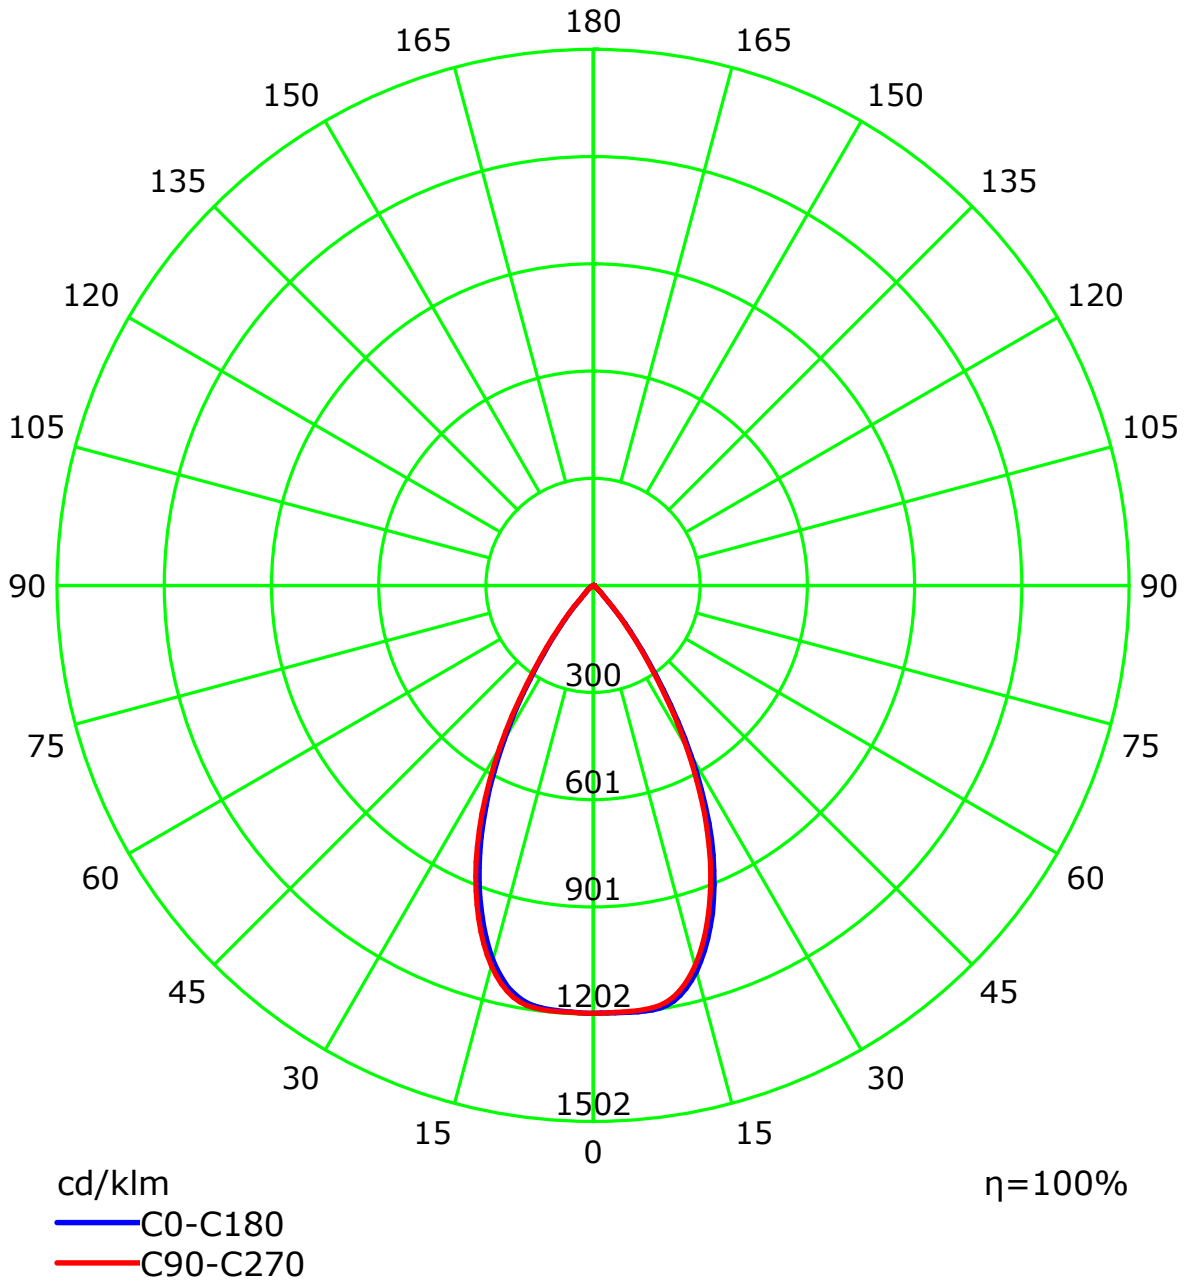

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Isocandela (rectangle)

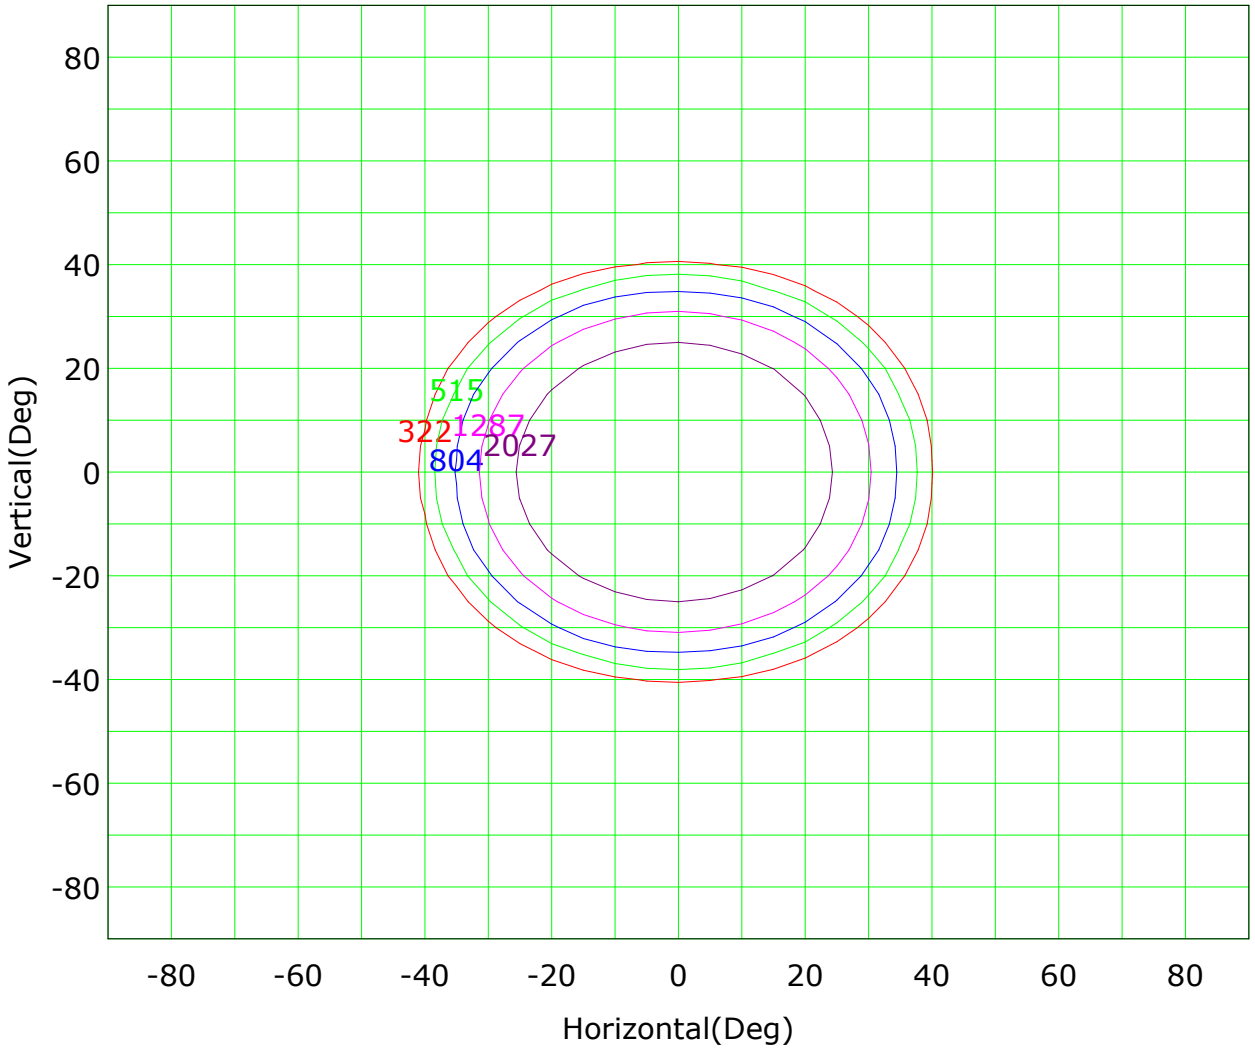


Imax (100%): 3217 cd

(10%): 322 cd
(16%): 515 cd
(25%): 804 cd
(40%): 1287 cd
(63%): 2027 cd
(100%): 3217 cd

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

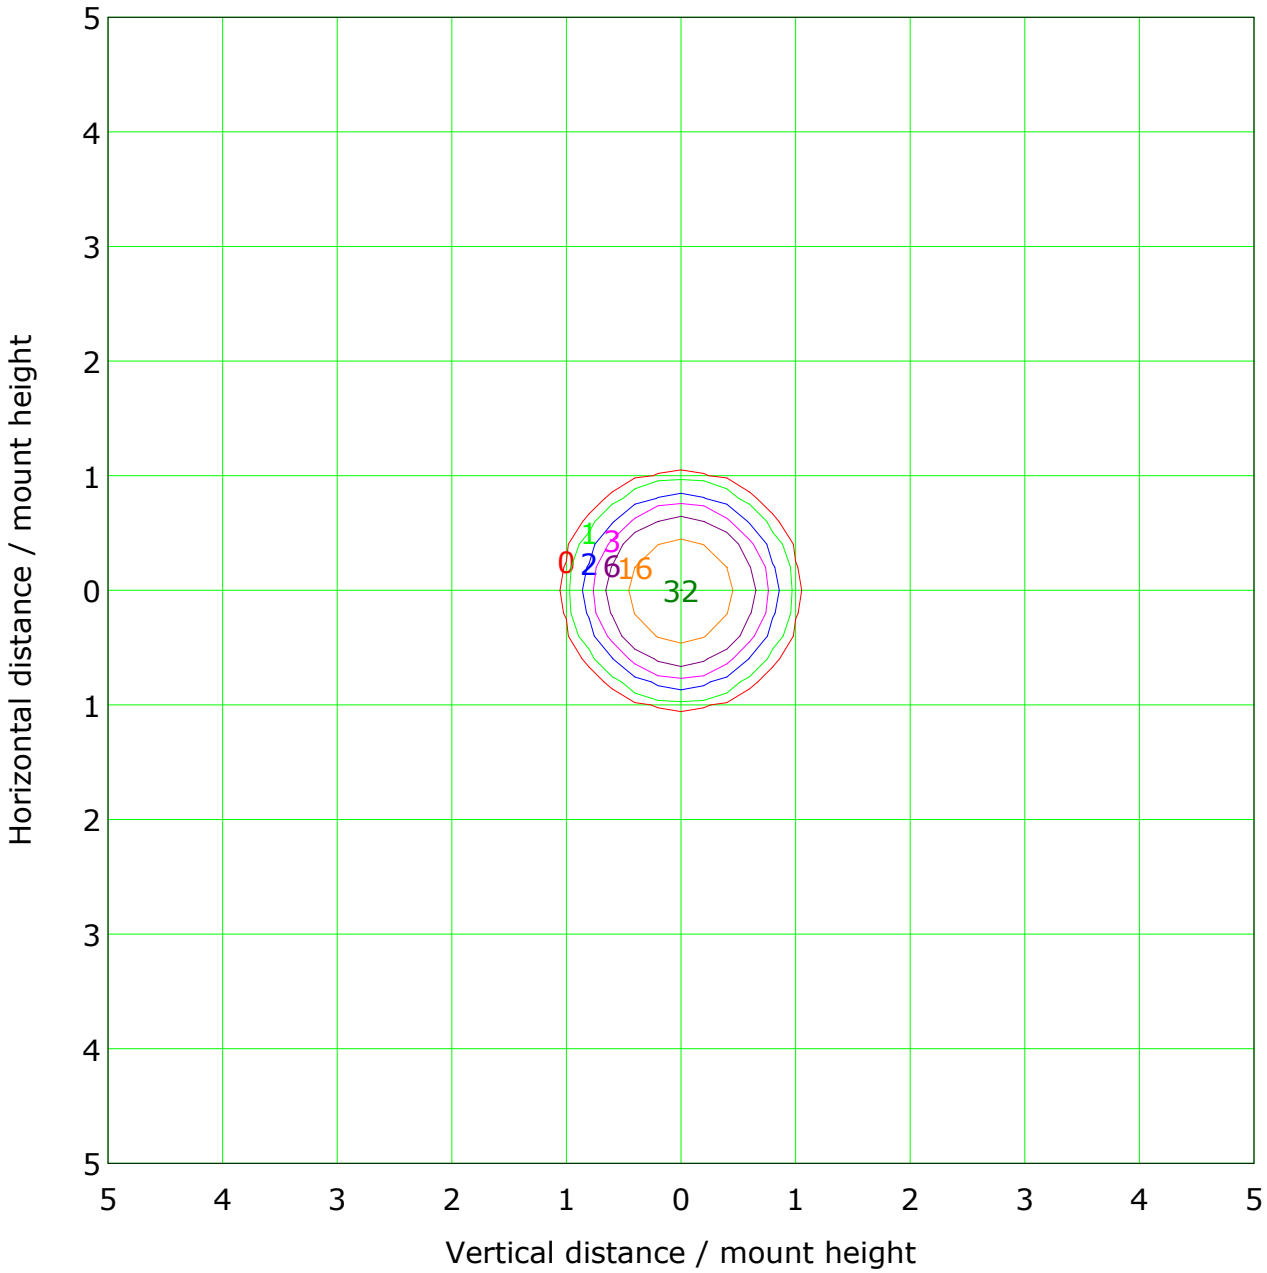


Mounting Height: 10.0m Max Lux(100%): 32.1 lx

(1%): 0.3 lx
(2%): 0.6 lx
(5%): 1.6 lx
(10%): 3.2 lx
(20%): 6.4 lx
(50%): 16.0 lx
(100%): 32.1 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Illuminance at a Distance

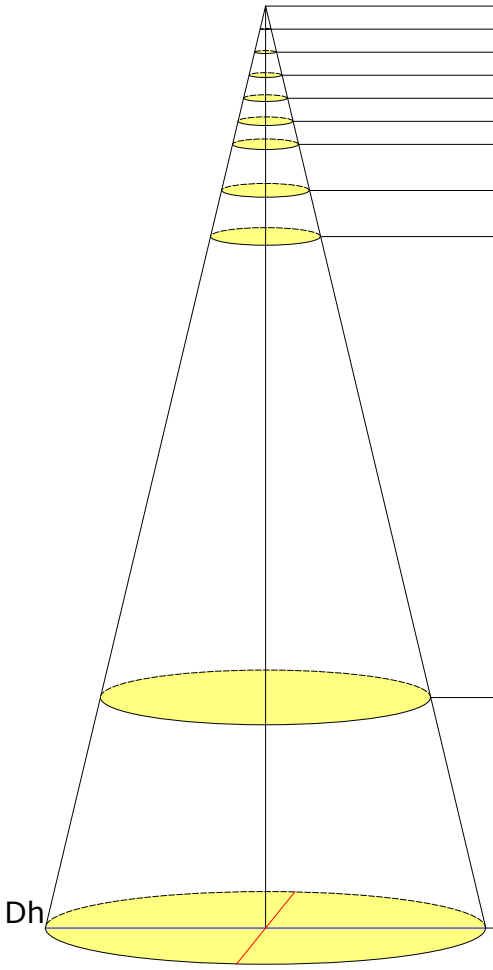


Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
0.5	12832.76	0.54/0.54	0.2	5181.51
1.0	3208.19	1.08/1.08	0.9	1295.38
1.5	1425.86	1.62/1.63	2.1	575.72
2.0	802.05	2.16/2.17	3.7	323.84
2.5	513.31	2.70/2.71	5.7	207.26
3.0	356.47	3.24/3.25	8.3	143.93
4.0	200.51	4.32/4.33	14.7	80.96
5.0	128.33	5.41/5.42	23.0	51.82
15.0	14.26	16.22/16.25	206.9	5.76
20.0	8.02	21.62/21.67	367.8	3.24

Beam Angle(B): H56.8 V56.9 Field Angle(F): H80.9 V81.0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Vertical IsoLux Plot

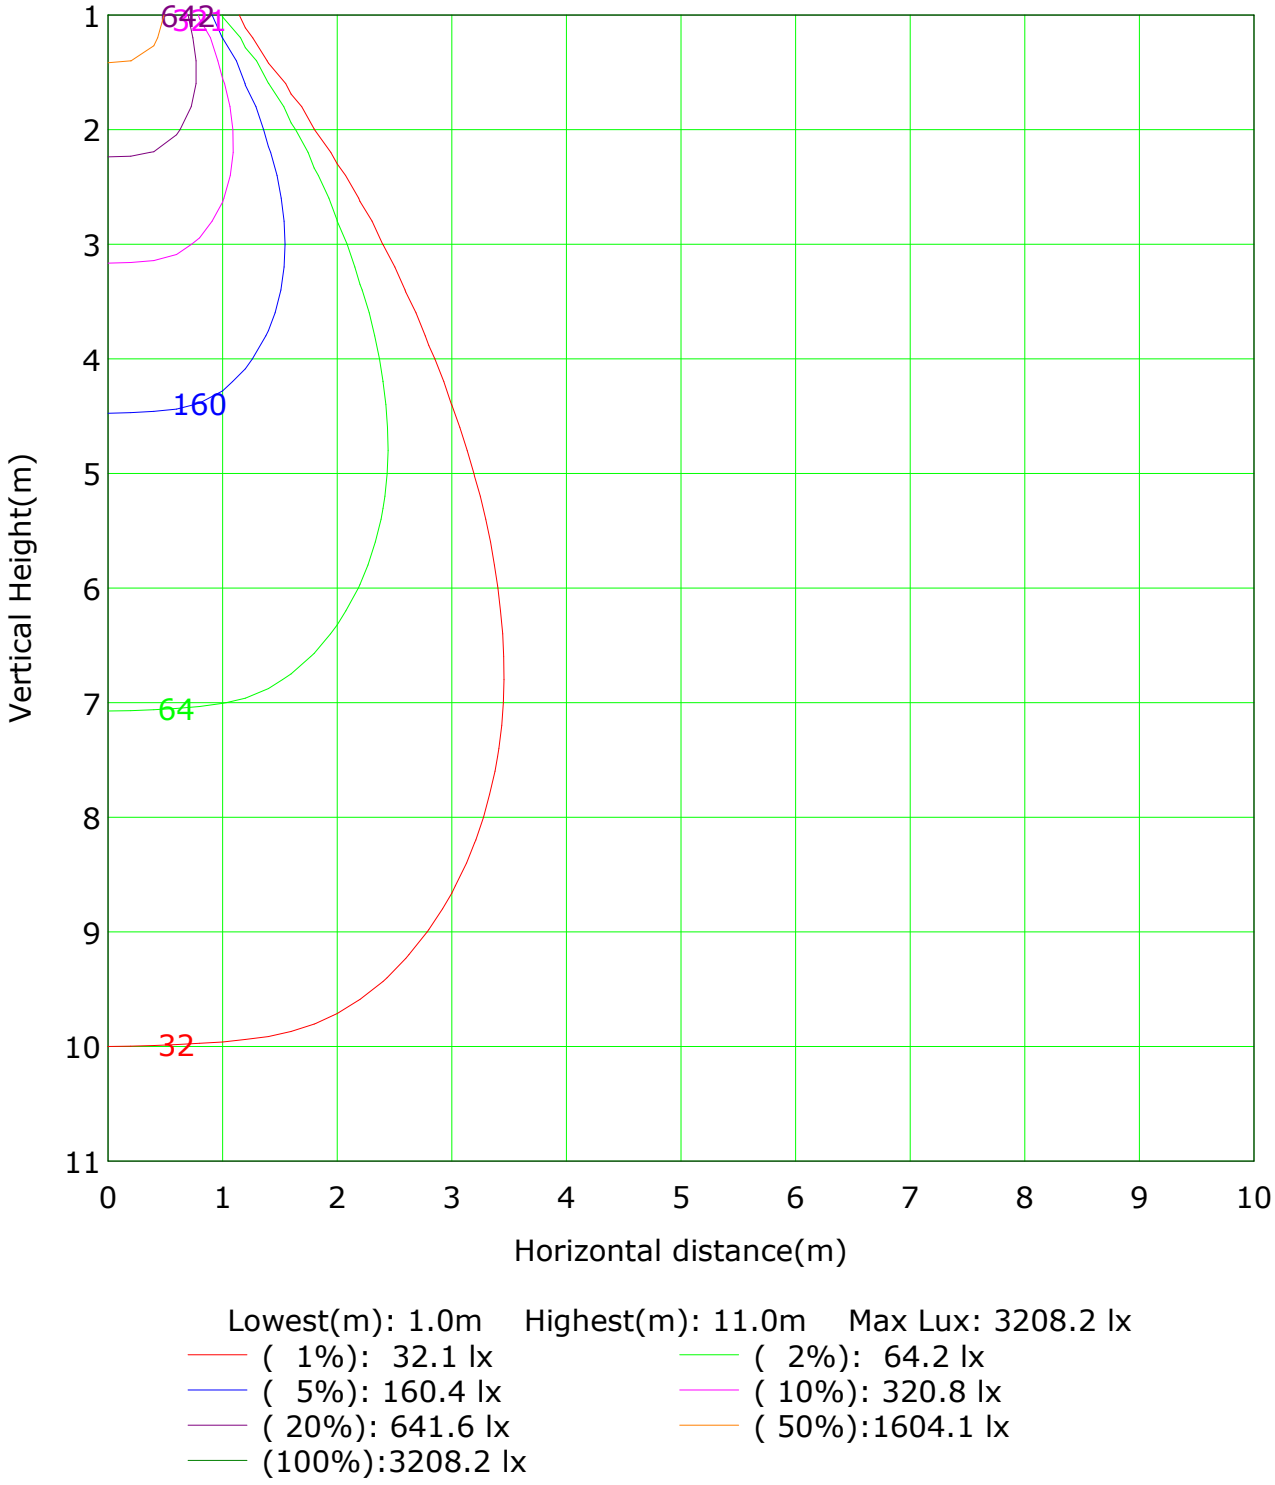

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 3208.2 lx

(1%): 32.1 lx
(2%): 64.2 lx
(5%): 160.4 lx
(10%): 320.8 lx
(20%): 641.6 lx
(50%):1604.1 lx
(100%):3208.2 lx

C Plane (°):0.0-180.0: 180.0
Gamma Plane (°):0.0-90.0:1.0
Test Lab:
Test Device: CHL-6E
Test Type: TYPE C
Distance: 3.010 m
Temperature:
Humidity:
Operator:
Inspector:

Area Flux Table


Unit: lm

Horizontal plane	Vertical plane																									
	90	80	70	60	50	40	30	20	10	0	-10	-20	-30	-40	-50	-60	-70	-80	-90	Flux(T)	Flux(E)
-90	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
-70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0
-60	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.3	0.5	0.5	0.4	0.3	0.1	0.1	0.0	0.0	0.0	0.0	0.0	2.9	0.0
-50	0.0	0.0	0.0	0.0	0.1	0.3	0.7	1.3	2.1	2.9	2.1	1.3	0.7	0.3	0.1	0.0	0.0	0.0	0.0	14.4	0.0
-40	0.0	0.0	0.0	0.0	0.2	0.8	2.0	6.0	13.1	18.5	13.1	6.0	2.0	0.8	0.2	0.0	0.0	0.0	0.0	81.5	65.8
-30	0.0	0.0	0.0	0.1	0.4	1.6	6.7	22.2	41.0	51.9	41.0	22.2	6.7	1.6	0.4	0.1	0.0	0.0	0.0	247.8	236.5
-20	0.0	0.0	0.0	0.1	0.7	2.8	15.8	44.1	69.8	82.7	69.8	44.1	15.8	2.8	0.7	0.1	0.0	0.0	0.0	432.2	421.8
-10	0.0	0.0	0.0	0.1	0.9	4.1	23.3	58.5	86.2	96.3	86.2	58.5	23.3	4.1	0.9	0.1	0.0	0.0	0.0	538.6	528.2
0	0.0	0.0	0.0	0.1	0.9	4.1	23.5	59.0	86.8	96.8	86.8	59.0	23.5	4.1	0.9	0.1	0.0	0.0	0.0	542.5	532.2
10	0.0	0.0	0.0	0.1	0.7	2.8	16.3	45.5	71.8	85.1	71.8	45.5	16.3	2.8	0.7	0.1	0.0	0.0	0.0	444.7	434.5
20	0.0	0.0	0.0	0.1	0.4	1.6	7.0	23.5	43.4	55.4	43.4	23.5	7.0	1.6	0.4	0.1	0.0	0.0	0.0	262.9	251.6
30	0.0	0.0	0.0	0.0	0.2	0.8	2.1	6.5	14.4	20.5	14.4	6.5	2.1	0.8	0.2	0.0	0.0	0.0	0.0	88.9	74.3
40	0.0	0.0	0.0	0.0	0.1	0.3	0.7	1.3	2.2	3.1	2.2	1.3	0.7	0.3	0.1	0.0	0.0	0.0	0.0	15.1	0.8
50	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.3	0.4	0.5	0.4	0.3	0.1	0.1	0.0	0.0	0.0	0.0	0.0	2.9	0.0
60	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.0
70	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
80	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90		0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2675	
Flux(T)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		2546
Flux(E)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2546	

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

The Average Illuminance Effective Figure

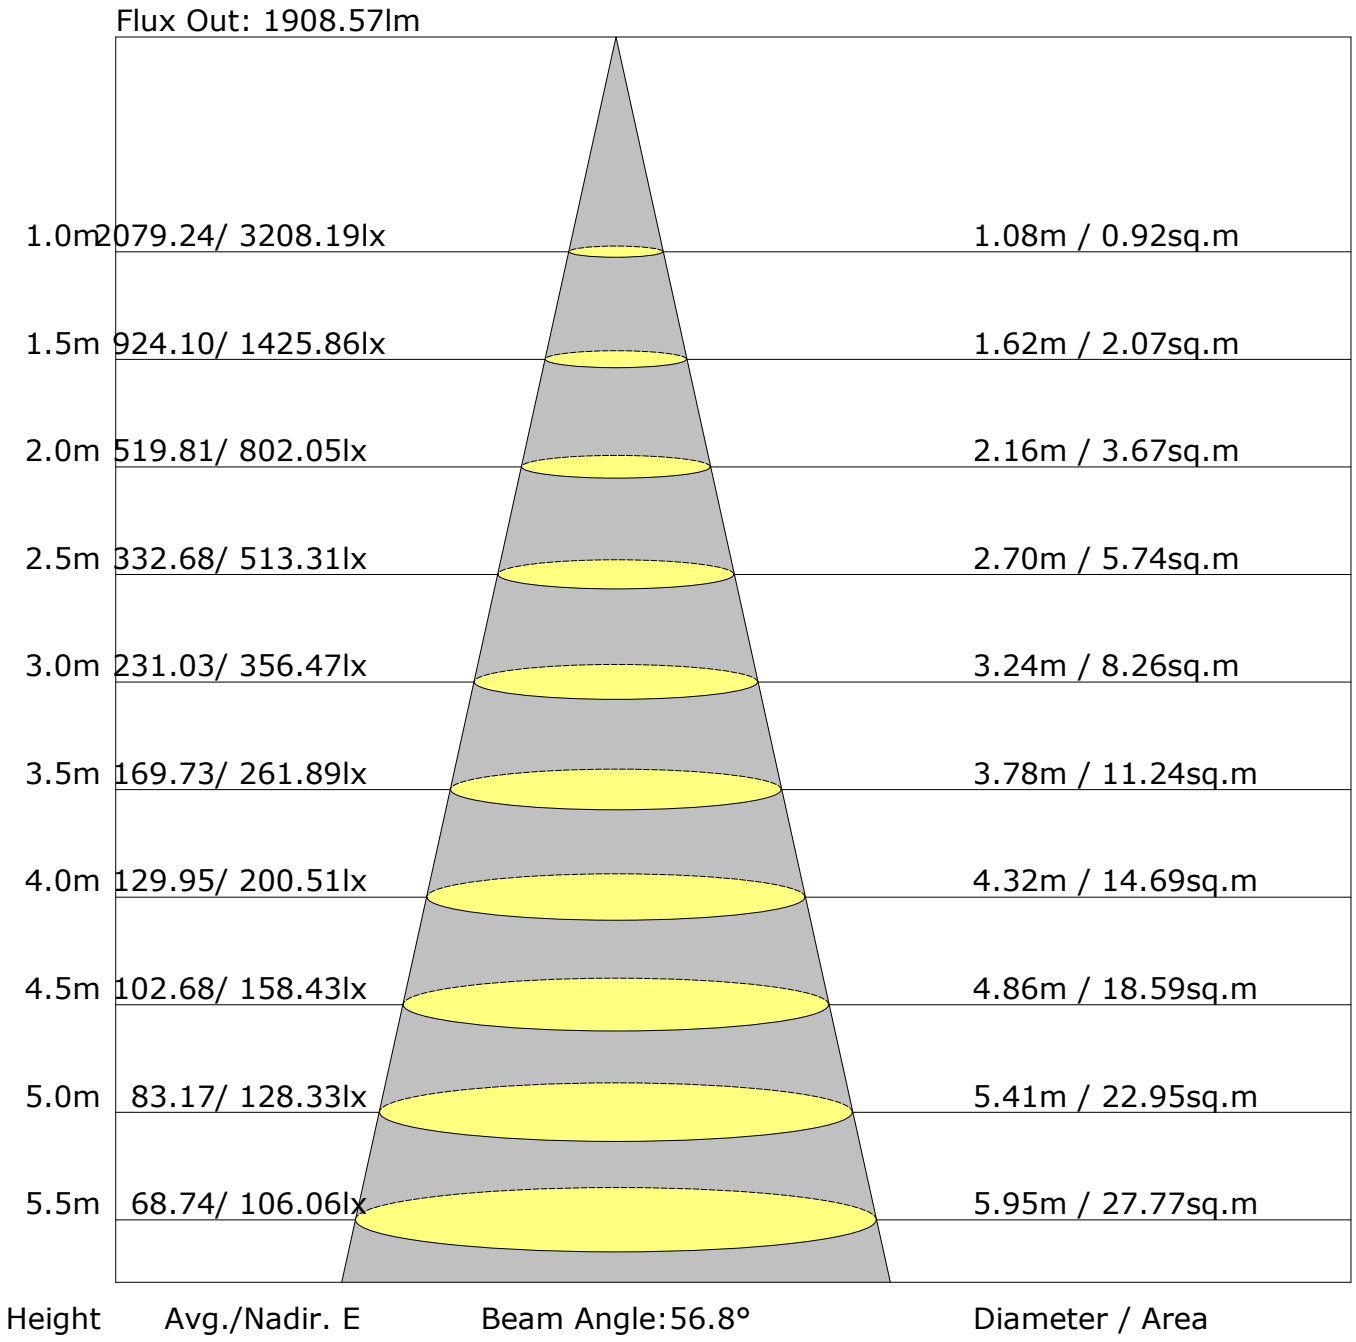

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	23.4	24.3	23.7	24.5	24.7	23.2	24.1	23.5	24.3	24.5
3H	23.3	24.0	23.6	24.3	24.5	23.1	23.8	23.4	24.1	24.3
4H	23.2	23.9	23.5	24.2	24.4	23.0	23.7	23.3	24.0	24.2
6H	23.1	23.8	23.5	24.1	24.4	22.9	23.6	23.3	23.9	24.2
8H	23.1	23.7	23.4	24.0	24.3	22.9	23.5	23.2	23.8	24.1
12H	23.1	23.7	23.4	24.0	24.3	22.9	23.5	23.2	23.8	24.1
X=4H Y=2H	23.2	23.9	23.5	24.2	24.5	23.0	23.7	23.3	24.0	24.2
3H	23.1	23.7	23.4	24.0	24.3	22.9	23.5	23.2	23.8	24.1
4H	23.0	23.5	23.4	23.9	24.2	22.8	23.3	23.2	23.7	24.0
6H	22.9	23.4	23.3	23.7	24.1	22.7	23.2	23.1	23.5	23.9
8H	22.9	23.3	23.3	23.7	24.1	22.7	23.1	23.1	23.5	23.9
12H	22.8	23.2	23.3	23.6	24.0	22.6	23.0	23.1	23.4	23.8
X=8H Y=4H	22.9	23.3	23.3	23.7	24.1	22.7	23.1	23.1	23.5	23.9
6H	22.8	23.1	23.2	23.5	24.0	22.6	22.9	23.0	23.3	23.8
8H	22.7	23.0	23.2	23.5	24.0	22.5	22.8	23.0	23.3	23.7
12H	22.7	22.9	23.2	23.4	23.9	22.5	22.7	23.0	23.2	23.7
X=12H Y=4H	22.8	23.2	23.3	23.6	24.0	22.6	23.0	23.1	23.4	23.8
6H	22.7	23.0	23.2	23.5	24.0	22.5	22.8	23.0	23.3	23.7
8H	22.7	22.9	23.2	23.4	23.9	22.5	22.7	23.0	23.2	23.7
Variations with the observer position at spacings:										
S=1.0H	+5.3/-11.9					+5.2/-11.7				
S=1.5H	+8.1/-17.6					+8.0/-17.6				
S=2.0H	+10.1/-24.8					+10.0/-25.3				

Calculate in accordance with CIE Pub.117. The table is revised with 2676lm (8log(F/F0) = 3.4).

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

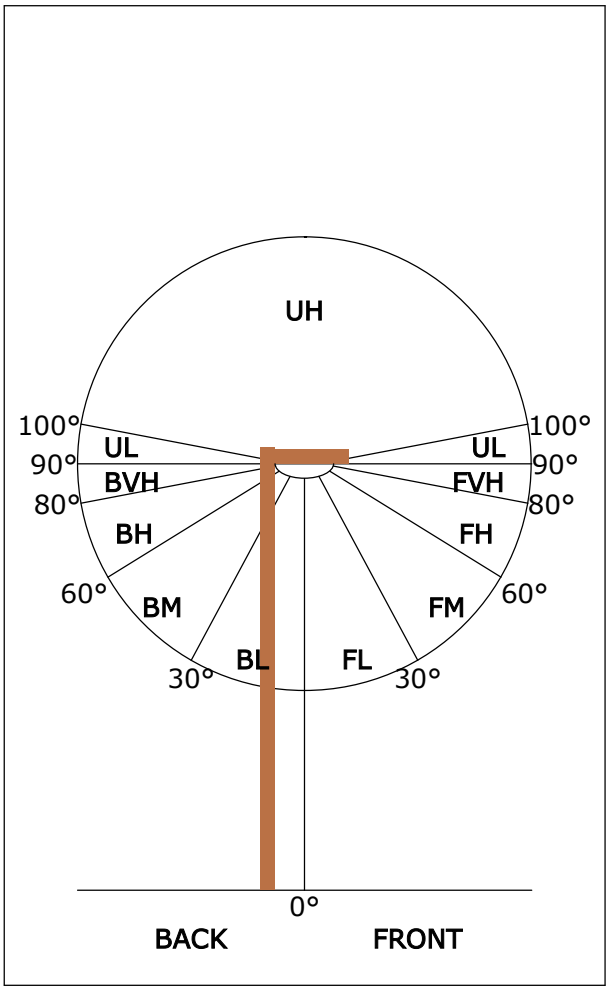

ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	1358	50.7
FL (0°-30°)	1031	38.5
FM (30°-60°)	324	12.1
FH (60°-80°)	2	0.1
FVH (80°-90°)	0	0.0
BACK LIGHT	1318	49.3
BL (0°-30°)	1007	37.6
BM (30°-60°)	308	11.5
BH (60°-80°)	2	0.1
BVH (80°-90°)	0	0.0
UP LIGHT	0	0.0
UL (90°-100°)	0	0.0
UH (100°-180°)	0	0.0
TRAPPED LIGHT	NA	NA

BUG(**B**acklight,**U**plight,**G**lare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B3 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B3 U0 G0

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3208.3	3.1	3.1	0.11	0.11
1.0-2.0	3208.1	9.2	12.3	0.34	0.46
2.0-3.0	3207.4	15.3	27.6	0.57	1.03
3.0-4.0	3207.0	21.5	49.1	0.80	1.83
4.0-5.0	3206.6	27.6	76.7	1.03	2.87
5.0-6.0	3206.7	33.7	110.4	1.26	4.13
6.0-7.0	3205.3	39.8	150.2	1.49	5.61
7.0-8.0	3201.7	45.8	196.0	1.71	7.33
8.0-9.0	3195.2	51.8	247.8	1.94	9.26
9.0-10.0	3181.9	57.6	305.4	2.15	11.41
10.0-11.0	3160.2	63.2	368.5	2.36	13.77
11.0-12.0	3129.6	68.4	437.0	2.56	16.33
12.0-13.0	3089.2	73.3	510.3	2.74	19.07
13.0-14.0	3040.5	77.8	588.1	2.91	21.98
14.0-15.0	2984.5	81.9	670.1	3.06	25.04
15.0-16.0	2919.5	85.6	755.6	3.20	28.24
16.0-17.0	2847.2	88.7	844.3	3.31	31.55
17.0-18.0	2769.6	91.3	935.6	3.41	34.97
18.0-19.0	2686.2	93.5	1029.1	3.49	38.46
19.0-20.0	2597.5	95.1	1124.2	3.55	42.01
20.0-21.0	2503.9	96.2	1220.3	3.59	45.61
21.0-22.0	2405.8	96.7	1317.0	3.61	49.22
22.0-23.0	2303.6	96.7	1413.7	3.61	52.83
23.0-24.0	2196.7	96.1	1509.8	3.59	56.42
24.0-25.0	2084.8	94.8	1604.6	3.54	59.97
25.0-26.0	1968.3	92.9	1697.5	3.47	63.44
26.0-27.0	1848.2	90.4	1787.9	3.38	66.82
27.0-28.0	1724.5	87.3	1875.3	3.26	70.08
28.0-29.0	1597.2	83.6	1958.8	3.12	73.21
29.0-30.0	1468.4	79.3	2038.1	2.96	76.17
30.0-31.0	1339.5	74.6	2112.7	2.79	78.96
31.0-32.0	1211.0	69.4	2182.1	2.59	81.55
32.0-33.0	1082.6	63.8	2245.8	2.38	83.93
33.0-34.0	957.0	57.9	2303.8	2.16	86.10
34.0-35.0	838.1	52.1	2355.8	1.95	88.04
35.0-36.0	727.5	46.3	2402.2	1.73	89.77

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	626.8	40.9	2443.0	1.53	91.30
37.0-38.0	536.0	35.8	2478.8	1.34	92.64
38.0-39.0	454.4	31.0	2509.8	1.16	93.80
39.0-40.0	383.2	26.7	2536.6	1.00	94.80
40.0-41.0	319.4	22.7	2559.3	0.85	95.65
41.0-42.0	253.8	18.4	2577.8	0.69	96.34
42.0-43.0	193.0	14.3	2592.1	0.53	96.87
43.0-44.0	148.5	11.2	2603.3	0.42	97.29
44.0-45.0	119.4	9.2	2612.4	0.34	97.63
45.0-46.0	100.9	7.9	2620.3	0.30	97.93
46.0-47.0	87.9	7.0	2627.3	0.26	98.19
47.0-48.0	77.8	6.3	2633.6	0.24	98.43
48.0-49.0	69.4	5.7	2639.3	0.21	98.64
49.0-50.0	62.2	5.2	2644.5	0.19	98.83
50.0-51.0	55.5	4.7	2649.2	0.18	99.01
51.0-52.0	48.9	4.2	2653.4	0.16	99.16
52.0-53.0	42.1	3.7	2657.1	0.14	99.30
53.0-54.0	35.4	3.1	2660.2	0.12	99.42
54.0-55.0	29.3	2.6	2662.8	0.10	99.52
55.0-56.0	24.1	2.2	2665.0	0.08	99.60
56.0-57.0	19.6	1.8	2666.8	0.07	99.66
57.0-58.0	16.1	1.5	2668.3	0.06	99.72
58.0-59.0	13.7	1.3	2669.5	0.05	99.77
59.0-60.0	11.8	1.1	2670.7	0.04	99.81
60.0-61.0	10.1	1.0	2671.6	0.04	99.85
61.0-62.0	8.5	0.8	2672.4	0.03	99.88
62.0-63.0	7.0	0.7	2673.1	0.03	99.90
63.0-64.0	5.7	0.6	2673.7	0.02	99.92
64.0-65.0	4.4	0.4	2674.1	0.02	99.94
65.0-66.0	3.5	0.3	2674.5	0.01	99.95
66.0-67.0	2.6	0.3	2674.7	0.01	99.96
67.0-68.0	1.8	0.2	2674.9	0.01	99.97
68.0-69.0	1.2	0.1	2675.0	0.00	99.97
69.0-70.0	0.8	0.1	2675.1	0.00	99.98
70.0-71.0	0.5	0.1	2675.2	0.00	99.98
71.0-72.0	0.3	0.0	2675.2	0.00	99.98

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	0.3	0.0	2675.2	0.00	99.98
73.0-74.0	0.3	0.0	2675.3	0.00	99.98
74.0-75.0	0.4	0.0	2675.3	0.00	99.98
75.0-76.0	0.4	0.0	2675.3	0.00	99.98
76.0-77.0	0.3	0.0	2675.4	0.00	99.99
77.0-78.0	0.2	0.0	2675.4	0.00	99.99
78.0-79.0	0.2	0.0	2675.4	0.00	99.99
79.0-80.0	0.3	0.0	2675.5	0.00	99.99
80.0-81.0	0.3	0.0	2675.5	0.00	99.99
81.0-82.0	0.3	0.0	2675.5	0.00	99.99
82.0-83.0	0.3	0.0	2675.6	0.00	99.99
83.0-84.0	0.3	0.0	2675.6	0.00	99.99
84.0-85.0	0.3	0.0	2675.6	0.00	99.99
85.0-86.0	0.3	0.0	2675.7	0.00	100.00
86.0-87.0	0.3	0.0	2675.7	0.00	100.00
87.0-88.0	0.3	0.0	2675.7	0.00	100.00
88.0-89.0	0.2	0.0	2675.7	0.00	100.00
89.0-90.0	0.2	0.0	2675.8	0.00	100.00

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C180.0								
G0.0	3208.2	3208.2								
G1.0	3207.9	3208.8								
G2.0	3209.1	3206.5								
G3.0	3210.0	3204.0								
G4.0	3211.2	3202.8								
G5.0	3212.5	3200.1								
G6.0	3217.1	3197.1								
G7.0	3215.1	3192.1								
G8.0	3215.9	3183.9								
G9.0	3209.8	3171.1								
G10.0	3197.8	3148.7								
G11.0	3176.2	3118.1								
G12.0	3143.5	3080.7								
G13.0	3102.9	3029.7								
G14.0	3055.6	2973.7								
G15.0	2999.3	2909.3								
G16.0	2932.8	2836.6								
G17.0	2863.6	2755.8								
G18.0	2787.5	2671.4								
G19.0	2705.5	2580.3								
G20.0	2618.6	2485.7								
G21.0	2524.8	2386.6								
G22.0	2426.1	2285.7								
G23.0	2322.5	2180.2								
G24.0	2214.9	2069.2								
G25.0	2102.0	1953.2								
G26.0	1984.1	1834.1								
G27.0	1860.5	1714.2								
G28.0	1733.4	1590.1								
G29.0	1599.7	1465.7								
G30.0	1469.0	1339.3								
G31.0	1335.9	1213.7								
G32.0	1204.7	1089.6								
G33.0	1070.3	965.8								
G34.0	942.7	849.0								
G35.0	822.6	737.9								
G36.0	712.9	636.4								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C180.0								
G37.0	614.7	543.4								
G38.0	525.0	461.1								
G39.0	443.4	388.0								
G40.0	373.7	327.8								
G41.0	306.3	269.6								
G42.0	233.2	206.1								
G43.0	175.2	157.6								
G44.0	136.0	125.1								
G45.0	110.8	105.8								
G46.0	94.9	92.2								
G47.0	83.0	81.7								
G48.0	73.3	73.1								
G49.0	65.6	65.5								
G50.0	58.8	58.8								
G51.0	52.4	52.1								
G52.0	45.6	45.3								
G53.0	38.9	38.4								
G54.0	32.0	32.3								
G55.0	26.6	26.4								
G56.0	21.6	21.8								
G57.0	17.4	17.7								
G58.0	14.7	14.7								
G59.0	12.8	12.6								
G60.0	11.0	10.8								
G61.0	9.6	9.2								
G62.0	7.8	7.4								
G63.0	6.6	6.2								
G64.0	5.1	4.8								
G65.0	4.2	3.6								
G66.0	3.3	2.7								
G67.0	2.4	2.0								
G68.0	1.8	1.2								
G69.0	1.2	0.8								
G70.0	0.9	0.4								
G71.0	0.4	0.2								
G72.0	0.4	0.2								
G73.0	0.4	0.2								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C180.0								
G74.0	0.4	0.3								
G75.0	0.4	0.3								
G76.0	0.4	0.3								
G77.0	0.4	0.2								
G78.0	0.2	0.2								
G79.0	0.4	0.2								
G80.0	0.6	0.2								
G81.0	0.3	0.2								
G82.0	0.4	0.2								
G83.0	0.4	0.2								
G84.0	0.4	0.2								
G85.0	0.4	0.2								
G86.0	0.4	0.2								
G87.0	0.4	0.2								
G88.0	0.2	0.3								
G89.0	0.2	0.3								
G90.0	0.2	0.2								

C Plane (°):0.0-180.0: 180.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-90.0:1.0
Test Device: CHL-6E
Distance: 3.010 m
Humidity:
Inspector: